


COMMERCIAL RIBLINE ROOFING PARAPET HEAD APRON INTERNAL CLADDING

DETAIL NO. CRR008A
 DATE DRAWN 1/0/03/12
 FILE REFERENCE RI-CRR008A.DWG


SEPERATION BARRIER BETWEEN CONCRETE
 & FLASHING (SELF ADHESIVE TAPE OR SIM)
 FIX CAPPING TO CONCRETE WITH MASONRY
 FASTENERS AT 600mm CRS

NOTE:
 (1) MINIMUM PITCH 3°
 (2) FOAM CLOSURE STRIPS ONLY REQUIRED IN HIGH
 RISK SITUATIONS OF WIND BLOWN MOISTURE ENTERING.


- NOTES:
- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries.
 - The building designer is ultimately responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project. Details of the supporting structure are indicative only and are the responsibility of the building designer.
 - Thermal break or cavity battens may be required in some circumstances.
 - Underlay selection and building wrap types are the responsibility of the designer. Alternative support to galvanised netting should be used in severe coastal environments including when aluminum is used.
 - These details are for Roofing Industries profiles as nominated and may not be applicable to other profiles.
 - This drawing is the copyright of Roofing Industries and can only be copied or reproduced with their permission.
 - Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metalroofer.org.nz & www.roof.co.nz
 - Where necessary adjust drawings for purlin battens or cavity battens. Details are for steel based materials, other substrate may require some changes.

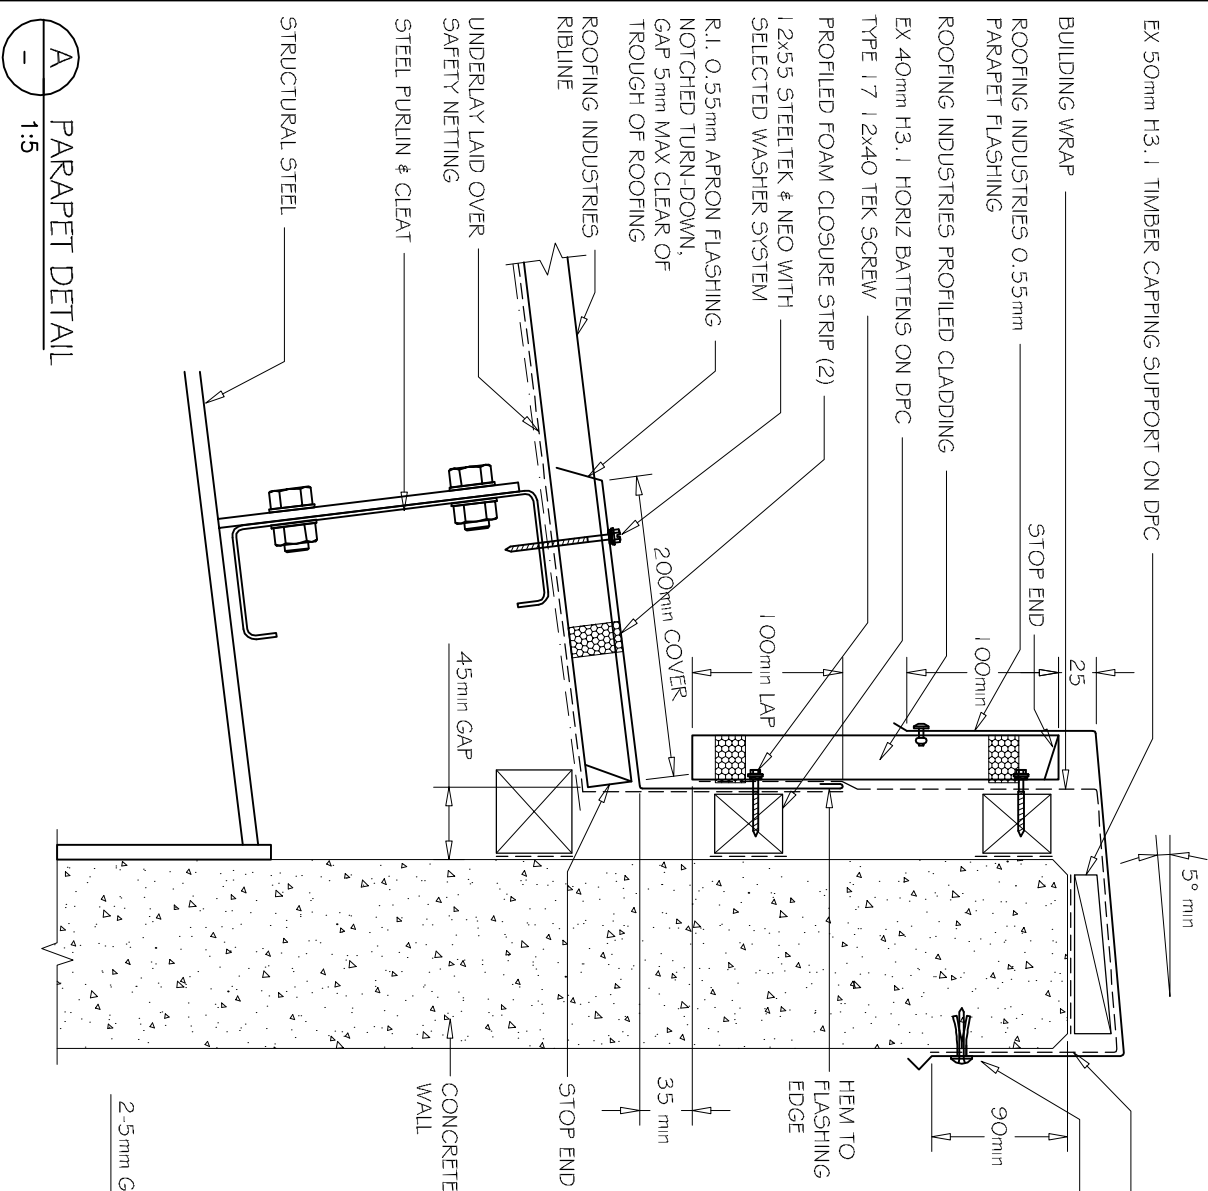

A PARAPET DETAIL
 1:5

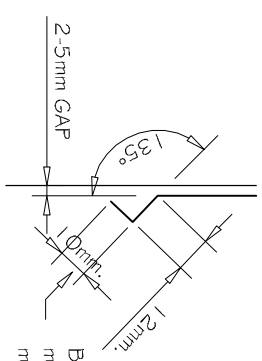

Birds break dimension may vary between manufacturing locations.



©COPYRIGHT DETAIL 2012