

COMMERCIAL RIBLINE ROOFING 175 BOX GUTTER DETAIL (External Bracket)

DETAIL NO. CRR031B

DATE DRAWN 13/03/12

FILE REFERENCE R1-CRR031B.DWG


12x55 STEELTEK & NEO
WITH SELECTED WASHER SYSTEM,
FASTEN FAVES AT EVERY CREST

50 mm MIN.
OVERHANG

Ø6x20mm GALV
GUTTER BOLT OR TYPE
17 12x25 TEK SCREW

DRIP FORM SHEETS

ROOFING INDUSTRIES
GUTTER APRON, REFER
DETAIL CRR030A

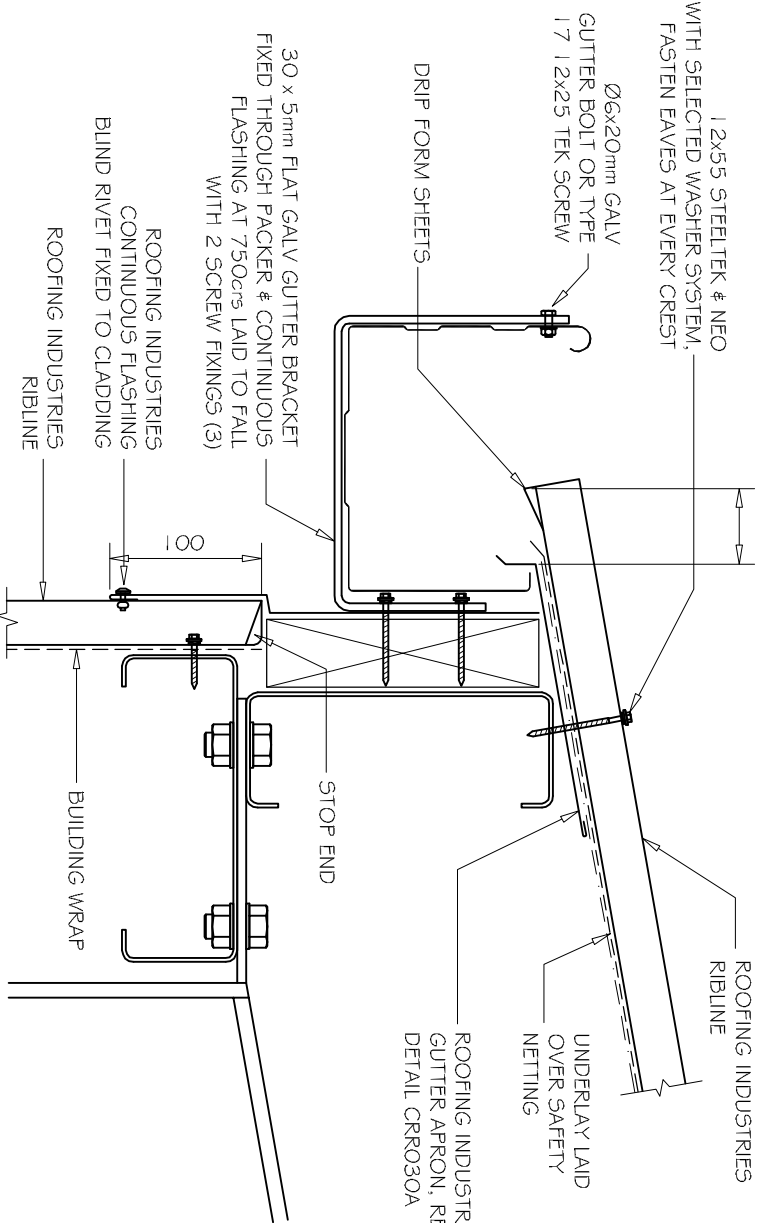

NOTES:
(1) MINIMUM PITCH 3°
(2) FOR CAPACITY CALCULATION REFER TO NZMRM CODE OF PRACTICE.
(3) SNOW STRAPS & BRACKETS TO BE FITTED AT 600c/s TO ALL GUTTERS IN AREAS SUBJECT TO SNOW.

NOTES:

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries.
- The building designer is ultimately responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure are indicative only and are the responsibility of the building designer.
- Thermal break or cavity battens may be required in some circumstances.
- Underlay selection and building wrap types are the responsibility of the designer, alternative support to galvanised netting should be used in severe coastal environments, including when aluminum is used.
- These details are for Roofing Industries profiles as nominated and may not be applicable to other profiles.
- This drawing is the copyright of Roofing Industries and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metaloof.co.nz & www.roof.co.nz
- Where necessary, adjust drawings for purlin battens or cavity battens.
- Details are for steel based materials, other substrate may require some changes.

A
— 175 BOX GUTTER RIBLINE PROFILE
1:5

©COPYRIGHT DETAIL 2012

