


## 'SURREAL' (NO RAIL)

THIS SPECIFICATION APPLIES TO BARRIERS TO PROTECT DOMESTIC RESIDENTIAL USES ONLY. This specification details the members to be used, glass thicknesses required and the maximum spacing for the various posts for this style. A separate specification must be referred to for fixing to the substrate (refer to Chapter 3). Post spacing must not exceed the lesser of the spacing from both Chapter 2 and Chapter 3. NOTE: For the Surreal Style we recommend always using 4 Substrate fixings per baseplate to give lateral stability to the post, even if 2 fixings is structurally adequate. Refer to Page 56 for notes on balustrade deflection.

1. Glass shall be GRADE A EVA TOUGHENED LAMINATED SAFETY GLASS suitable for exterior applications in accordance with AS/NZS 2208, with a minimum thickness as determined from the Table below. Glass shall be supported and glazed in accordance with NZS 4223. All exposed edges to be Flat Polished.
2. Fabrication and Installation to be in accordance with Assembly Specification AS.36.00 on Page 126, the Installation Guides in Chapter 5, and all other relevant portions of the UNEX Fabricators Manual.
3. APS and APE may be used for either "top fixed" or "side fixed" installations. API and APT are for "side fixed" ONLY situations.
4. Both the vertical edges of the glass shall fully attach to the post with structural silicone, for the full height and thickness of the glass.
5. UNEX standard specifications and these Vertical Dimensions are based on the top of the glass being 100mm above the top of the post, which must be at the MINIMUM BARRIER HEIGHT in accordance with NZBC F4/AS1.

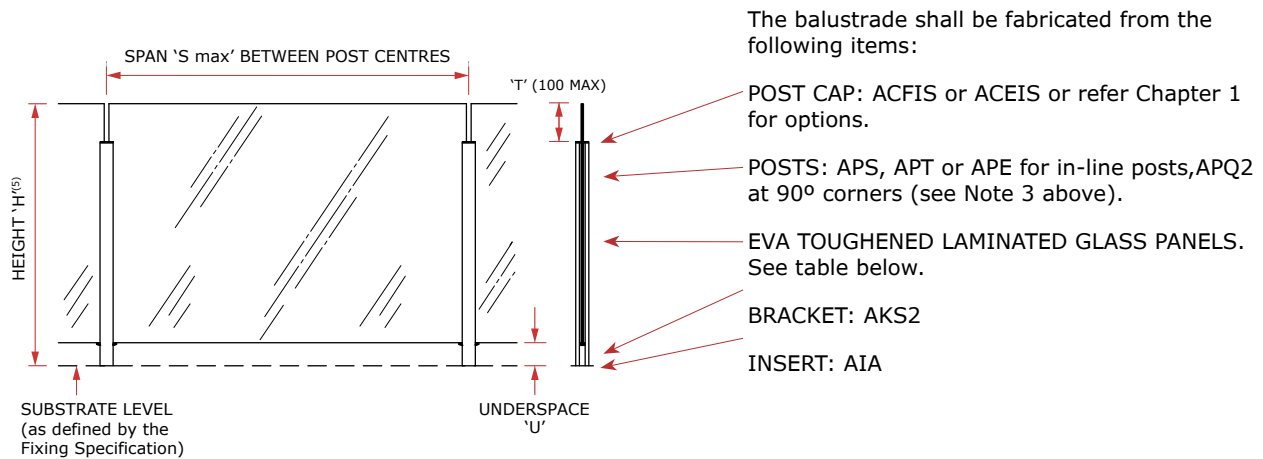

MAXIMUM POST CENTRES 'S max' (metres)																						
ALWAYS TAKE THE LESSER OF THE VALUE BELOW AND THE VALUE FROM THE FIXING SPECIFICATION																						
HEIGHT <sup>(3)</sup>	Post Type <sup>(2)</sup>	Toughened Glass Thickness	Line No.	LOADING CLASS <sup>(1)</sup>																		
				N07C/N07R								N03R	Not Preventing Falls									
				Design Wind Speed <sup>(4)</sup>									Design Wind Speed <sup>(4)</sup>									
				VH		EH							M		H				VH		EH	
50	52	54	56	58	60	62	64	N/A	38	40	42	44	46	48	50	52	54	56				
1.0	APR2 or APS	10	1	1.39	1.39	1.39	1.38	1.29	1.20	1.13	1.06	1.65	1.50	1.50	1.50	1.50	1.50	1.50	1.50	1.49	1.38	
		12	2	1.39	1.39	1.39	1.38	1.29	1.20	1.13	1.06	2.00	1.80	1.80	1.80	1.80	1.80	1.80	1.73	1.60	1.49	1.38
	APE	12	3	1.77	1.77	1.77	1.76	1.64	1.53	1.44	1.35	2.00	1.80	1.80	1.80	1.80	1.80	1.80	1.80	1.80	1.76	
		15	4	1.77	1.77	1.77	1.76	1.64	1.53	1.44	1.35	2.00	2.40	2.40	2.40	2.33	2.24	2.15	2.07	1.98	1.90	1.76
1.1	APR2 or APS	10	5	1.26	1.26	1.22	1.14	1.06	0.99	0.93	0.87	1.65	1.50	1.50	1.50	1.50	1.50	1.48	1.39	1.30	1.22	1.14
		12	6	1.26	1.26	1.22	1.14	1.06	0.99	0.93	0.87	2.00	1.80	1.80	1.80	1.69	1.59	1.48	1.39	1.30	1.22	1.14
	APE	12	7	1.61	1.61	1.55	1.46	1.36	1.27	1.19	1.11	2.00	1.80	1.80	1.80	1.80	1.80	1.73	1.64	1.55	1.46	
		15	8	1.61	1.61	1.55	1.46	1.36	1.27	1.19	1.11	2.00	2.36	2.24	2.13	2.02	1.92	1.82	1.73	1.64	1.55	1.46
1.2	APR2 or APS	10	9	1.03	0.96	0.89	0.83	0.78	0.73	0.68	0.64	1.65	1.50	1.50	1.41	1.30	1.20	1.11	1.03	0.96	0.89	0.83
		12	10	1.03	0.96	0.89	0.83	0.78	0.73	0.68	0.64	1.96	1.66	1.53	1.41	1.30	1.20	1.11	1.03	0.96	0.89	0.83
	APE	12	11	1.37	1.28	1.20	1.12	1.06	0.99	0.93	0.88	2.00	1.80	1.80	1.78	1.66	1.56	1.46	1.37	1.28	1.20	1.12
		15	12	1.37	1.28	1.20	1.12	1.06	0.99	0.93	0.88	2.00	2.02	1.90	1.78	1.66	1.56	1.46	1.37	1.28	1.20	1.12
<div>1. LOADING CLASS: Refer to Page 176 for the scope of the Loading Class designations.</div> <div>2. POST TYPES: Refer to Chapter 1 for details.</div> <div>3. HEIGHT 'H': is the overall height of the balustrade above the substrate level shown. Interpolate for Heights between those shown.</div> <div>4. DESIGN WIND SPEED: in m/s, Refer to Pages 51 to 52 for details of applicable wind codes and the methods for determining the Design Wind Speed for any particular site.</div>																						

1. LOADING CLASS: Refer to Page 176 for the scope of the Loading Class designations.  
2. POST TYPES: Refer to Chapter 1 for details.  
3. HEIGHT 'H': is the overall height of the balustrade above the substrate level shown. Interpolate for Heights between those shown.  
4. DESIGN WIND SPEED: in m/s, Refer to Pages 51 to 52 for details of applicable wind codes and the methods for determining the Design Wind Speed for any particular site.