


MASONRY - TOP FIXING, EPOXY-SET ANCHORS, 65MM CRS

Refer to all notes on Pages 100 and 101 which shall apply to this specification and the relevant pages in Chapter 5 Installation Guides. Refer also to Chapter 2 for the Style Specification.

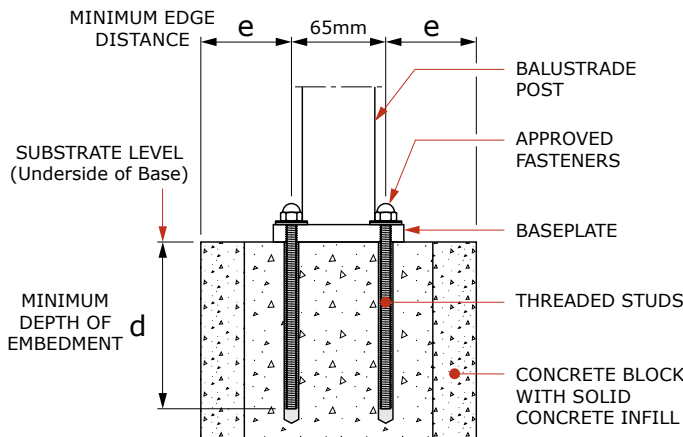

1. For details of approved fasteners refer to General Notes on Page 100 note 3. All threaded studs shall have a minimum ultimate tensile stress of 560 MPa.
2. Washers to be fitted under all stud dome nuts as follows
 - For 8mm studs - 22mm O.D. S/S washer (Part No. FW8-22) with a polymer washer (Part No. FWP8-22G) between the S/S and the aluminium.
 - For 10mm studs - 21mm O.D. S/S washer (Part No. FW10-21) with a polymer washer (Part No. FWP10-22G) between the S/S and the aluminium.
3. For details of anchoring studs to the substrate refer to General Notes Page 101 note 6.
4. Substrate design, including waterproofing, is beyond the scope of this specification and shall be carried out by others. Infill Concrete shall have a 28 day Compressive Strength of 17.5MPa or more (as required for substrate design). Refer also to General Notes on Page 101 note 10.

		MAXIMUM POST CENTRES 'S max' (metres)																						
		ALWAYS TAKE THE LESSER OF THE VALUE BELOW AND THE VALUE FROM THE STYLE SPECIFICATION																						
Height ⁽³⁾	Baseplate Size D x W	Fasteners - Qty and Type ⁽²⁾	'e' (See diagram)	'd' (See diagram)	Line No.	LOADING CLASS ⁽¹⁾																		
						N07C/N07R								N03R	Not Preventing Fall									
						Design Wind Speed ⁽⁴⁾									Design Wind Speed ⁽⁴⁾									
						VH				EH					M			H		VH		EH		
50	52	54	56	58	60	62	64	N/A	38	40	42	44	46	48	50	52	54	56						
1.0	90 x 115 or 90 x 90	4 x M8	50	115	1	1.26	1.26	1.26	1.25	1.17	1.09	1.02	0.96	2.70	2.46	2.46	2.23	2.03	1.86	1.70	1.57	1.45	1.34	1.25
		4 x M10	50	115	2	1.48	1.48	1.48	1.48	1.38	1.29	1.20	1.13	3.17	2.89	2.89	2.62	2.39	2.18	2.01	1.85	1.71	1.58	1.48
1.1	90 x 115 or 90 x 90	4 x M8	50	115	3	1.14	1.14	1.11	1.04	0.96	0.90	0.85	0.79	2.45	2.23	2.03	1.84	1.68	1.53	1.41	1.30	1.20	1.11	1.04
		4 x M10	50	115	4	1.34	1.34	1.31	1.22	1.14	1.06	1.00	0.93	2.88	2.63	2.39	2.17	1.97	1.80	1.66	1.53	1.41	1.31	1.22
1.2	90 x 115 or 90 x 90	4 x M8	50	115	5	1.05	1.01	0.93	0.87	0.81	0.76	0.71	0.67	2.25	1.89	1.70	1.55	1.41	1.29	1.18	1.09	1.01	0.93	0.87
		4 x M10	50	115	6	1.23	1.19	1.10	1.02	0.96	0.89	0.84	0.78	2.64	2.22	2.01	1.82	1.66	1.52	1.39	1.28	1.19	1.10	1.02

1. LOADING CLASS: Refer to Page 176 for the scope of the Loading Class designations.
 2. FASTENER DESIGNATIONS: D10 Fasteners in the table refer to UNEX Part No FD10 S/S Dynabolts
 3. HEIGHT 'H': is the overall height of the balustrade above the substrate level shown. Interpolate for Heights between those shown.
 4. DESIGN WIND SPEED: in m/s, Refer to Pages 51 to 52 for details of applicable wind codes and the methods for determining the Design Wind Speed.