
## PENETRATION ROUND & WATERSHED TO UNDER RIDGE COMMERCIAL TRIMRIB ROOFING

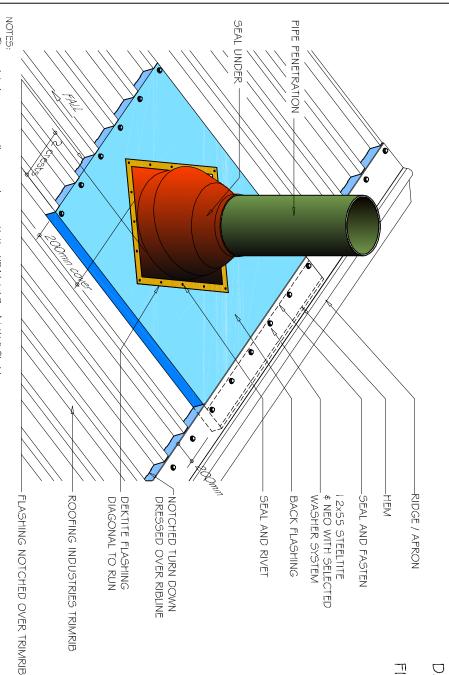

DETAIL NO.

CTRO 17A

DATE DRAWN

28/03/12

FILE REFERENCE

RI-CTRO I 7A.DWG

## NOTES

- (2) MAX ROOF PITCH FOR THIS FLASHING 45°, (1) SUITABLE FOR PIPES UP TO 500mm DIAMETER
- (3) ADDITIONAL SUPPORT FRAMING MAYBE REQUIRED WHEN PENETRATION EXCEEDS 200mm THROUGH ROOF MIN PITCH 3°

## (4) REFER TO SECTION 6 OF NZMRM CODE OF PRACTICE FOR CATCHMENT AREA LIMITATIONS.

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries
- the requirements of the NZ Building Code for the specific project. The building designer is ultimately responsible to ensure that details used meet
- of the building designer. Details of the supporting structure are indicative only and are the responsibility
- Thermal break or cavity battens may be required in some circumstances
- environments including when aluminium is used. Alternative support to galvanised netting should be used in severe coastal Underlay selection and building wrap types are the responsibility of the designer,
- applicable to other profiles. These details are for Roofing Industries profile/s as nominated and may not be
- reproduced with their permission. This drawing is the copyright of 'Roofing Industries' and can only be copied or
- of Practice www.metalroofer.org.nz & www.roof.co.nz Further information can be obtained from the NZ Metal Roof & Wall Cladding Code
- Where necessary adjust drawings for purlin battens or cavity battens
- Details are for steel based materials, other substrate may require some changes

©COPYRIGHT DETAIL 2012

