
COMMERCIAL TRIMRIB ROOFING 125 BOX GUTTER DETAIL (External Bracket)

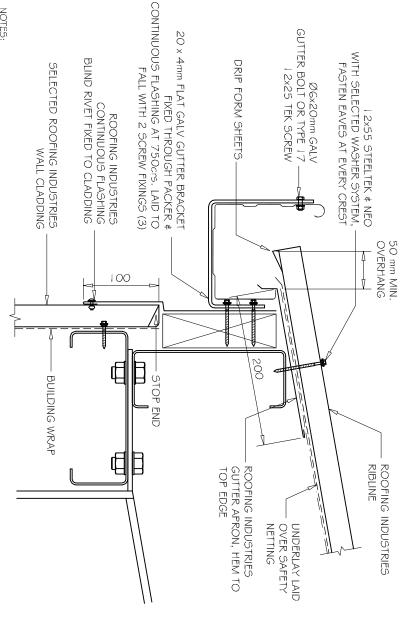

DETAIL NO.

CTR030B

DATE DRAWN

FILE REFERENCE

28/03/12

RI-CTR030B.DWG

NOTES.

- (1) MINIMUM PITCH 3°
- (2) FOR CAPACITY CALCULATION REFER TO NZMRM CODE OF PRACTICE.
- (3) SNOW STRAPS & BRACKETS TO BE FITTED AT 600cm TO ALL GUTTERS IN AREAS SUBJECT TO SNOW.



©COPYRIGHT DETAIL 2012



Thermal break or cavity battens may be required in some circumstances.

Details of the supporting structure are indicative only and are the responsibility

the requirements of the NZ Building Code for the specific project

Code of Practice and in some cases specific details by Roofing industries!
The building designer is ultimately responsible to ensure that details used meet

These details are generally in compliance with the NZ Metal Roof & Wall Cladding

of the building designer.

- Underlay selection and building wrap types are the responsibility of the designer.
 Alternative support to galvanised netting should be used in severe coastal environments including when aluminium is used.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metalroofer.org.nz & www.roof.co.nz
- Where necessary adjust drawings for purlin battens or cavity battens
- Details are for steel based materials, other substrate may require some changes.