


CTR03 | A-1

28/03/12

RI-CTRO3 | A-1.DWG

NOTES

- (1) MINIMUM PITCH 3°
- (2) FOR CAPACITY CALCULATION REFER TO NZMRM CODE OF PRACTICE.
- (3) EXTERNAL BRACKETS ARE RECOMMENDED TO ALL GUTTERS IN AREAS SUBJECT TO SNOW.

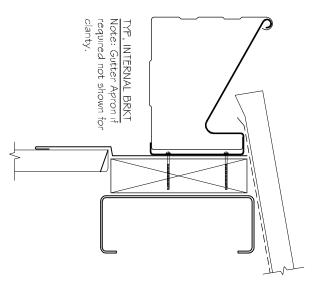

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding
- Code of Practice and in some cases specific details by Roofing Industries the requirements of the NZ Building Code for the specific project The building designer is ultimately responsible to ensure that details used meet
- of the building designer Details of the supporting structure are indicative only and are the responsibility
- Underlay selection and building wrap types are the responsibility of the designer Thermal break or cavity battens may be required in some circumstances
- environments including when aluminium is used Alternative support to galvanised netting should be used in severe coastal
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- reproduced with their permission. This drawing is the copyright of 'Roofing Industries' and can only be copied or
- of Practice www.metalroofer.org.nz & www.roof.co.nz Further information can be obtained from the NZ Metal Roof \$ Wall Cladding Code
- Where necessary adjust drawings for purlin battens or cavity battens
- Details are for steel based materials, other substrate may require some changes



