
COMMERCIAL TRIMRIB ROOFING 75 BOX GUTTER DETAIL (External Bracket)

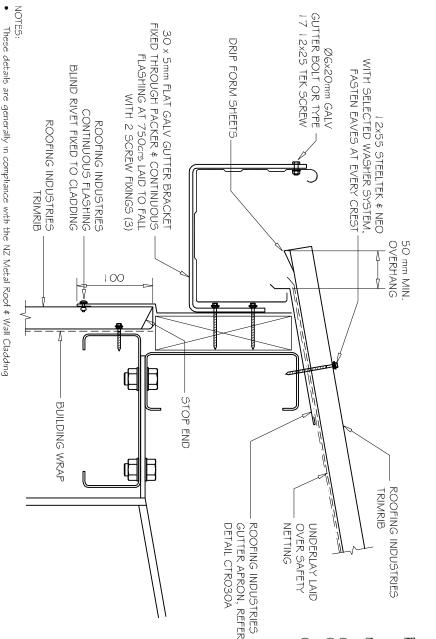

DETAIL NO

CTRO3 I B

DATE DRAWN

28/03/12

FILE REFERENCE

RI-CTRO3 | B.DWG

NOTES

- (1) MINIMUM PITCH 3°
- (2) FOR CAPACITY CALCULATION REFER TO NZMRM CODE OF PRACTICE.
- (3) SNOW STRAPS \$ BRACKETS TO BE FITTED AT 600crs TO ALL GUTTERS IN AREAS SUBJECT TO SNOW.





Thermal break or cavity battens may be required in some circumstances

the requirements of the NZ Building Code for the specific project The building designer is ultimately responsible to ensure that details used meet

Code of Practice and in some cases specific details by 'Koofing Industries'

of the building designer. Details of the supporting structure are indicative only and are the responsibility

environments including when aluminium is used. Alternative support to galvanised netting should be used in severe coastal Underlay selection and building wrap types are the responsibility of the designer

applicable to other profiles. These details are for Roofing Industries profile/s as nominated and may not be

reproduced with their permission. This drawing is the copyright of 'Roofing Industries' and can only be copied or

of Practice www.metalroofer.org.nz & www.roof.co.nz Further information can be obtained from the NZ Metal Roof \$ Wall Cladding Code

Where necessary adjust drawings for purlin battens or cavity battens

Details are for steel based materials, other substrate may require some changes