

COMMERCIAL RT7 ROOFING STEP FLASHING

DETAIL NO.

CRT7R01 1A-1

DATE DRAWN

28/03/12

FILE REFERENCE

RI-CRT7R01 1A-1.DWG

ROOFING INDUSTRIES
RT7

R.I. 0.55mm STEP FLASHING
NOTCHED TURN-DOWN OVER
MULTIRIB. GAP 5mm MAX CLEAR
OF TROUGH OF ROOFING

12x65 STEELTEK & NEO WITH
SELECTED WASHER SYSTEM.

VENTED PROFILED FOAM
CLOSURE STRIP (2)


DRIP FORM SHEETS

ROOFING INDUSTRIES
RT7

UNDERLAY LAID OVER
SAFETY NETTING

STEP SUPPORT FLASHING
TYPE 17 12x25 TEK SCREW

STEEL PURLIN & CLEAT

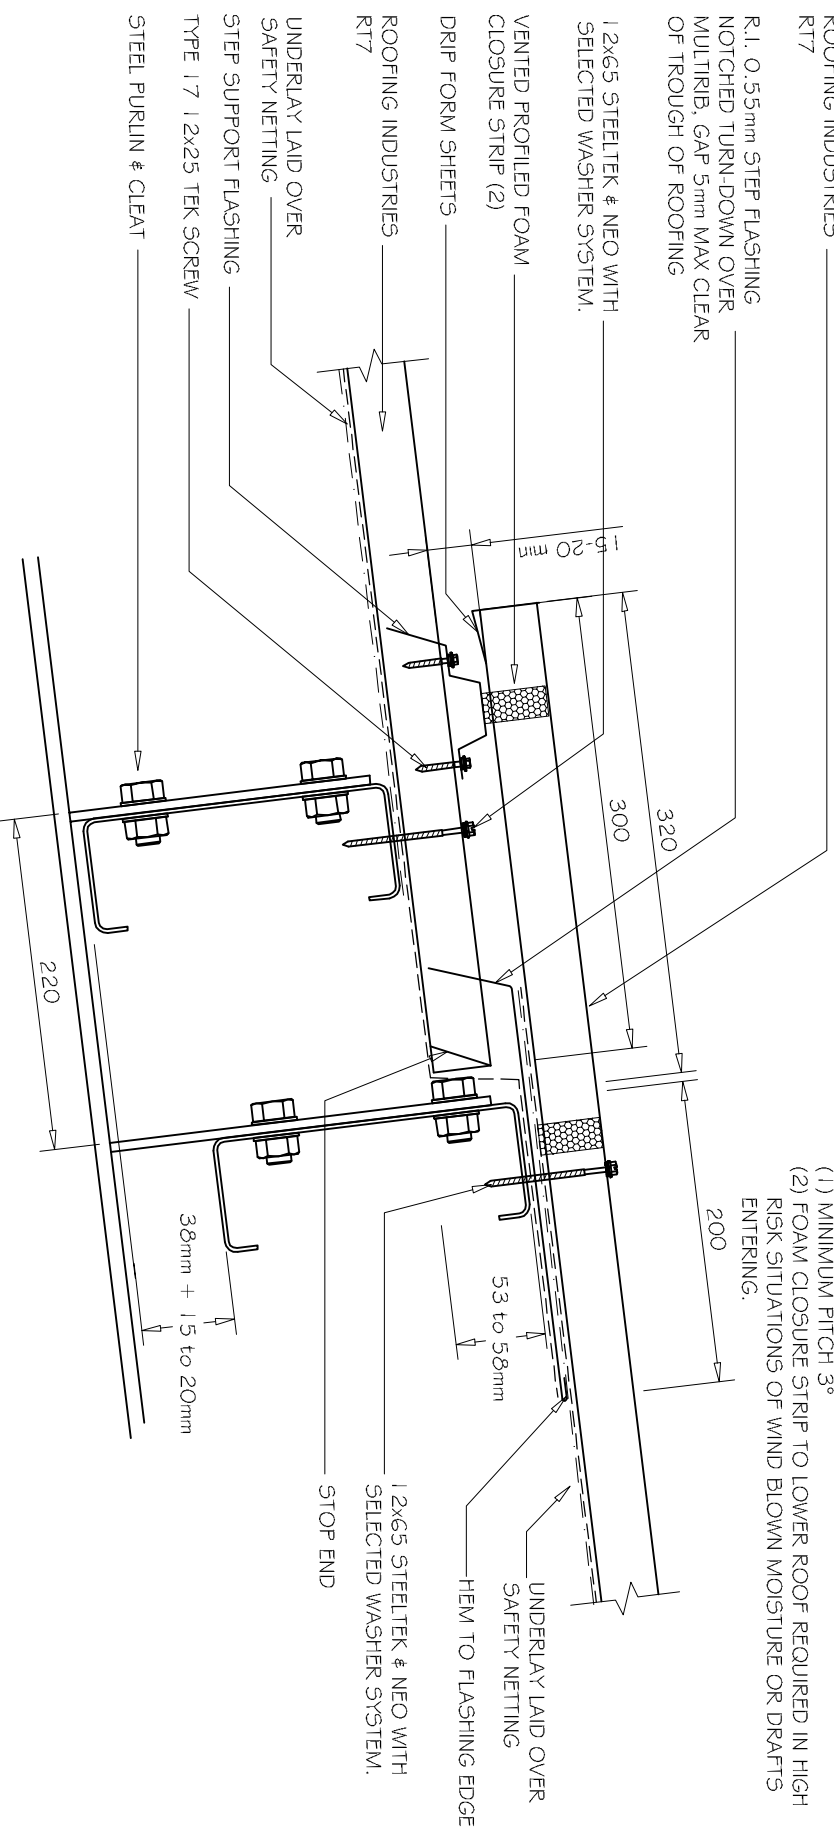

NOTE:
(1) MINIMUM PITCH 3°
(2) FOAM CLOSURE STRIP TO LOWER ROOF REQUIRED IN HIGH
RISK SITUATIONS OF WIND BLOWN MOISTURE OR DRAFTS
ENTERING.

A
—
1:5
TYPICAL STEP IN ROOF

NOTES:

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries;
- The building designer is ultimately responsible to ensure that details used meet the requirements of the Building Code for the specific project.
- Details of the supporting structure are indicative only and are the responsibility of the building designer.
- Thermal break or cavity battens may be required in some circumstances.
- Underlay selection and building wrap types are the responsibility of the designer. Alternative support to galvanised netting should be used in severe coastal environments including when aluminium is used.
- These details are for Roofing Industries profiles as nominated and may not be applicable to other profiles. This drawing is the copyright of Roofing Industries and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metlroofer.org.nz & www.roof.co.nz
- Where necessary adjust drawings for purlin battens or cavity battens.
- Details are for steel based materials, other substrate may require some changes.

©COPYRIGHT DETAIL 2012

