


COMMERCIAL RT7 ROOFING
175 BOX GUTTER DETAIL
(Internal Bracket - Alternative)

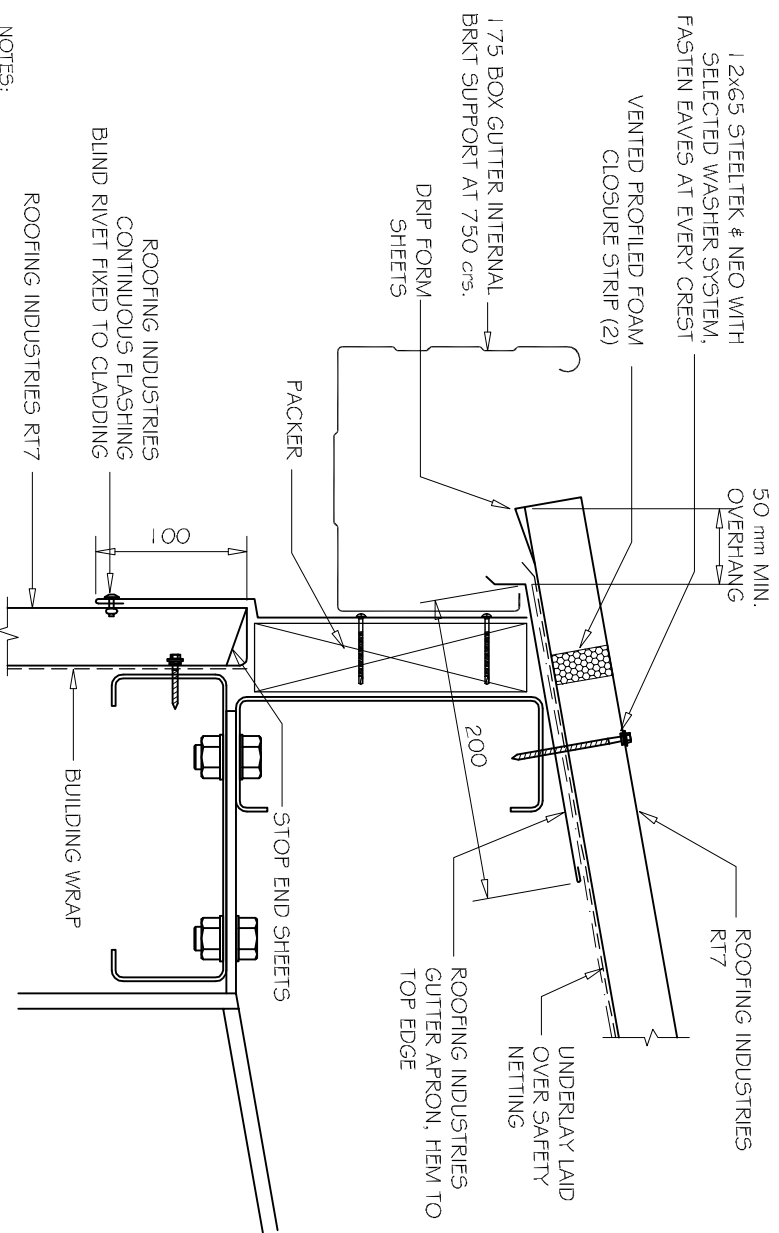

- NOTES:
- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries¹.
 - The building designer is ultimately responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project.
 - Details of the supporting structure are indicative only and are the responsibility of the building designer.
 - Thermal break or cavity battens may be required in some circumstances.
 - Underlayment selection and building wrap types are the responsibility of the designer; Alternative support to galvanneal decking should be used in severe coastal environments including when aluminium is used.
 - These details are for Roofing Industries' profiles as nominated and may not be applicable to other profiles.
 - This drawing is the copyright of Roofing Industries¹ and can only be copied or reproduced with their permission.
 - Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metaloofers.org.nz & www.roof.co.nz
 - Where necessary adjust drawings for purlin battens or cavity battens.
 - Details are for steel based materials, other substrate may require some changes.


DETAIL NO. CRT7R031A-1

DATE DRAWN 28/03/12

FILE REFERENCE R1-CRT7R031A-1.DWG

- NOTES:

- (1) MINIMUM PITCH 3°
- (2) FOAM CLOSURE STRIP ONLY REQUIRED IN HIGH RISK SITUATIONS OF WIND BLOWN MOISTURE ENTERING OR IF BIRD OR VERMIN PROOFING IS REQUIRED.
- (3) FOR CAPACITY CALCULATION REFER TO NZMCM CODE OF PRACTICE.
- (4) EXTERNAL BRACKETS ARE RECOMMENDED TO ALL GUTTERS IN AREAS SUBJECT TO SNOW.

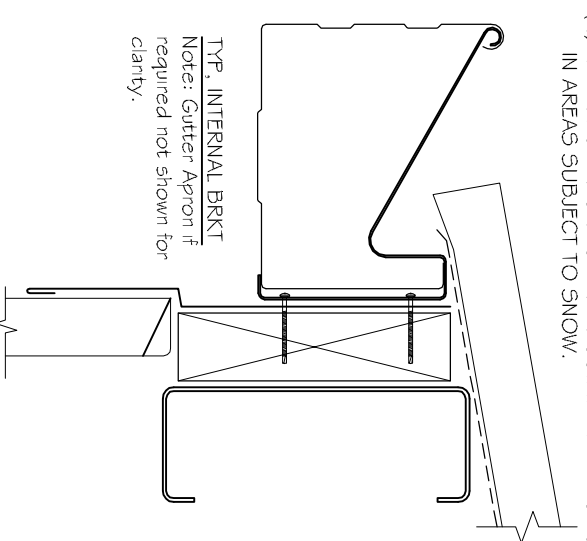

TYP, INTERNAL BRKT
Note: Gutter Apron if
required not shown for
clarity.

©COPYRIGHT DETAIL 2012

(A) 175 BOX GUTTER RT7 PROFILE

