


COMMERCIAL RT7 WALL CLADDING TILT PANEL / VERTICAL CLADDING JUNCTION

DETAIL NO. CRT7W006A

DATE DRAWN 28/03/12

FILE REFERENCE R1-CRT7W006A.DWG

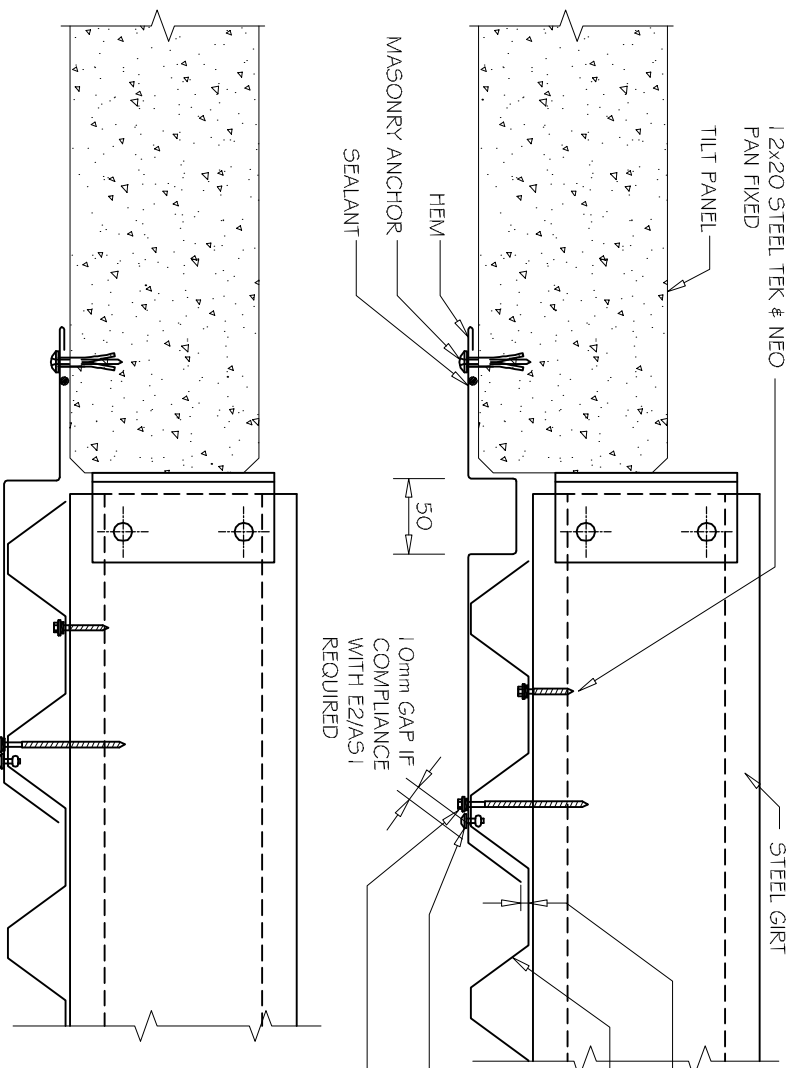


ROOFING INDUSTRIES 0.55mm BMT
INTERNAL CORNER FLASHING (2 CRT5'S)
4.8Ø ALUM RIVETS BETWEEN GIRTS
WHERE APPLICABLE (offset for clarity)
12x65 STEEL TEK & NEO

OPTION 2

B TILT PANEL VERTICAL CLADDING JUNCTION
1:5

- NOTES:
- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries.
 - The building designer is ultimately responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project.
 - Details of the supporting structure are indicative only and are the responsibility of the building designer.
 - Thermal break or cavity battens may be required in some circumstances.
 - Underlay selection and building wrap types are the responsibility of the designer.
 - Alternative support to galvanised netting should be used in severe coastal environments including when aluminum is used.
 - These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles. This drawing is the copyright of Roofing Industries and can only be copied or reproduced with their permission.
 - Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metaloofeer.org.nz & www.roof.co.nz
 - Where necessary adjust drawings for purlin battens or cavity battens.
 - Details are for steel based materials, other substrate may require some changes.



©COPYRIGHT DETAIL 2012