

COMMERCIAL MULTIRIB ROOFING STEP FLASHING

DETAIL NO. CMRRO11A-1

DATE DRAWN 01/03/12

FILE REFERENCE R1-CMRRO11A.DWG

ROOFING INDUSTRIES
MULTIRIB

R.I. 0.55mm STEP FLASHING
NOTCHED TURN-DOWN OVER
MULTIRIB. GAP 5mm MAX CLEAR
OF TROUGH OF ROOFING

1 2x65 STEELTEK & NEO
WITH SELECTED WASHER
SYSTEM

VENTED PROFILED FOAM
CLOSURE STRIP (2)

DRIP FORM SHEETS


ROOFING INDUSTRIES
MULTIRIB

UNDERLAY LAID OVER
SAFETY NETTING

STEP SUPPORT FLASHING

TYPE 17 1 2x25 TEK SCREW

STEEL PURLIN & CLEAT

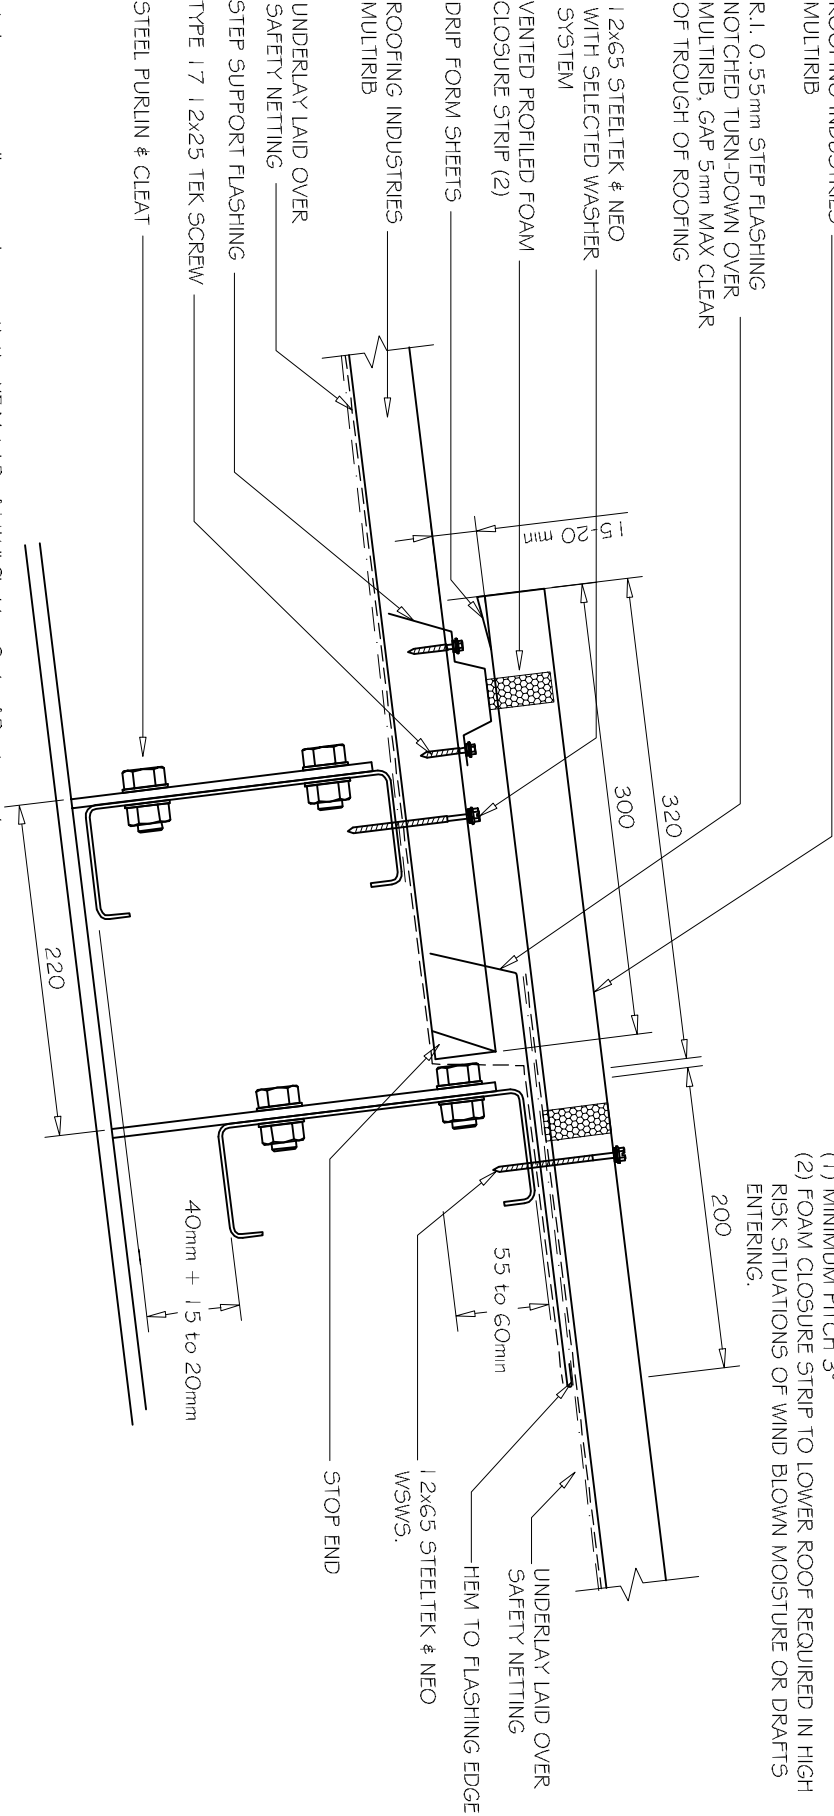

NOTE:
(1) MINIMUM PITCH 3°
(2) FOAM CLOSURE STRIP TO LOWER ROOF REQUIRED IN HIGH
RISK SITUATIONS OF WIND BLOWN MOISTURE OR DRAFTS
ENTERING.

220

40mm + 15 to 20mm

55 to 60mm

1 2x65 STEELTEK & NEO
WSWS.

UNDERLAY LAID OVER
SAFETY NETTING

HEM TO FLASHING EDGE

STOP END

15

20 min

300

320

200

1 2x65 STEELTEK & NEO
WITH SELECTED WASHER
SYSTEM

VENTED PROFILED FOAM
CLOSURE STRIP (2)

DRIP FORM SHEETS

ROOFING INDUSTRIES
MULTIRIB

NOTES:

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries.
- The building designer is ultimately responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure are indicative only and are the responsibility of the building designer.
- Thermal break or cavity battens may be required in some circumstances.
- Underlay selection and building wrap types are the responsibility of the designer. Alternative support to galvanised netting should be used in severe coastal environments including when aluminium is used.
- These details are for Roofing Industries profiles as nominated and may not be applicable to other profiles.
- This drawing is the copyright of Roofing Industries and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metalroofer.org.nz & www.roof.co.nz
- Where necessary adjust drawings for purlin battens or cavity battens.
- Details are for steel based materials, other substrate may require some changes.

A
—
1:5

TYPICAL STEP IN ROOF

©COPYRIGHT DETAIL 2012

