
PENETRATION ROUND & WATERSHED TO UNDER RIDGE COMMERCIAL MULTIRIB ROOFING

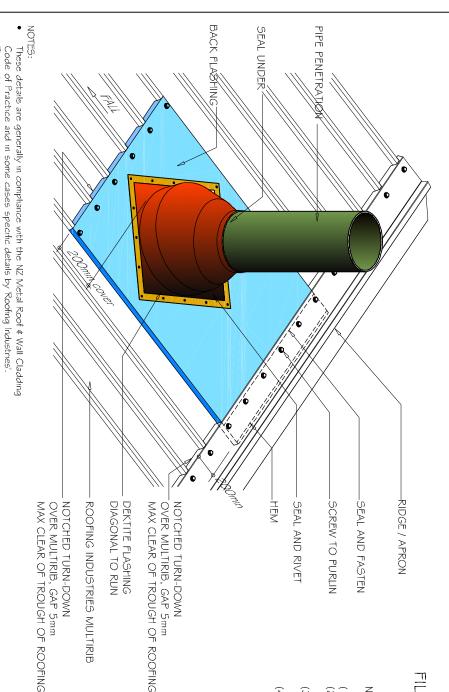

DETAIL NO.

CMRR017A

DATE DRAWN

01/03/12

NOTES

FILE REFERENCE

RI-CMRRO I 7A.DWG

(1) SUITABLE FOR PIPES UP TO 500mm DIAMETER (2) MAX ROOF PITCH FOR THIS FLASHING 45°,

MIN PITCH 3°
(3) ADDITIONAL SUPPORT FRAMING MAYBE REQUIRED WHEN PENETRATION EXCEEDS 200mm THROUGH ROOF

WHEN FENE IRALION EXCEEDS 200mm I HROUGH ROOM (4) REFER TO SECTION 6 OF NZMRM CODE OF PRACTICE FOR CATCHMENT AREA LIMITATIONS.

©COPYRIGHT DETAIL 2012



Thermal break or cavity battens may be required in some circumstances.

the building designer.

the requirements of the NZ Building Code for the specific project.

Details of the supporting structure are indicative only and are the responsibility of

The building designer is ultimately responsible to ensure that details used meet

- Underlay selection and building wrap types are the responsibility of the designer, Alternative support to galvanised netting should be used in severe coastal environments including when aluminium is used.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metalroofer.org.nz & www.roof.co.nz
- Where necessary adjust drawings for purlin battens or cavity battens.
- Details are for steel based materials, other substrate may require some changes