

DETAIL NO


CMRW005A

DATE DRAWN

01/03/12

FILE REFERENCE

RI-CMRW005A.DWG

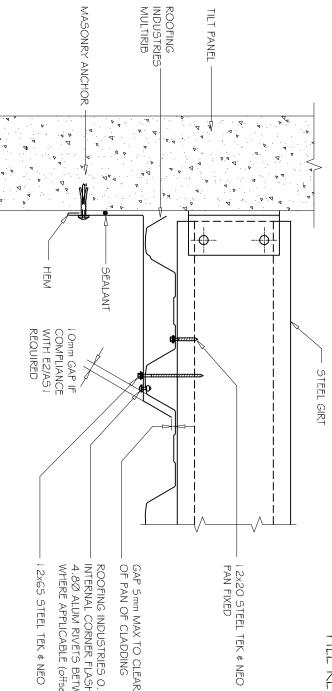

OF PAN OF CLADDING

WHERE APPLICABLE (offset for clarity) ROOFING INDUSTRIES 0.55mm BMT INTERNAL CORNER FLASHING (2 CRESTS) 4.80 ALUM RIVETS BETWEEN GIRTS

TILT PANEL VERTICAL CLADDING JUNCTION

NOTES:

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries!
- requirements of the NZ Building Code for the specific project. The building designer is ultimately responsible to ensure that details used meet the
- the building designer. Details of the supporting structure are indicative only and are the responsibility of
- Underlay selection and building wrap types are the responsibility of the designer, Thermal break or cavity battens may be required in some circumstances
- environments including when aluminium is used.
 These details are for Roofing Industries profile/s as nominated and may not be Alternative support to galvanised netting should be used in severe coastal
- applicable to other profiles.
- reproduced with their permission. This drawing is the copyright of 'Roofing Industries' and can only be copied or
- Practice www.metalroofer.org.nz & www.roof.co.nz Further information can be obtained from the NZ Metal Roof \$ Wall Cladding Code of
- Where necessary adjust drawings for purlin battens or cavity battens
- Details are for steel based materials, other substrate may require some changes

©COPYRIGHT DETAIL 2012

