


COMMERCIAL MULTIDEK ROOFING TYPICAL WALL/ROOF JUNCTION (At Head of Roof)

DETAIL NO. CMDR010A
DATE DRAWN 21/02/12
FILE REFERENCE R1-CMDR010A.DWG

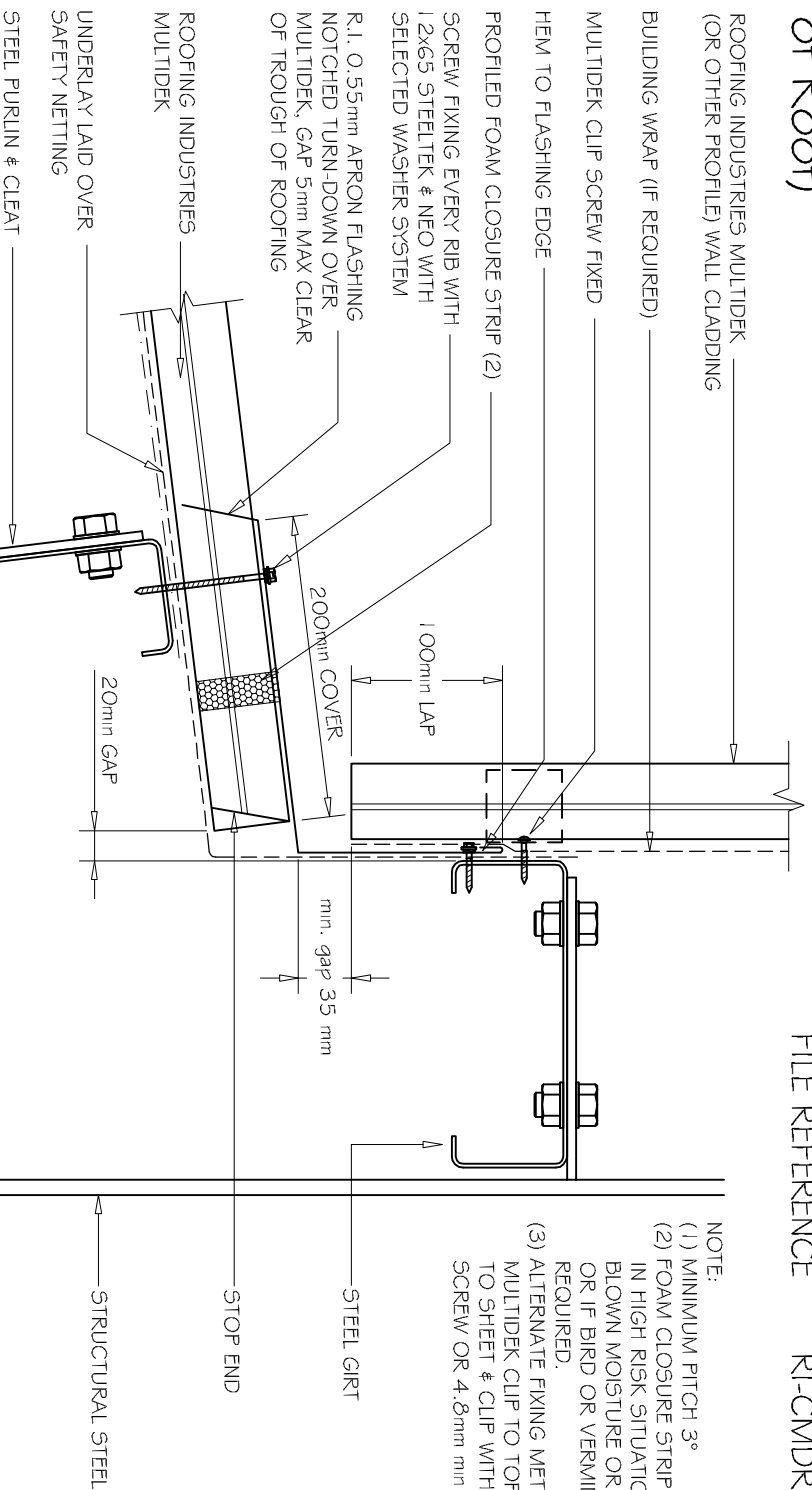

- NOTE:
- (1) MINIMUM PITCH 3°
 - (2) FOAM CLOSURE STRIP ONLY REQUIRED IN HIGH RISK SITUATIONS OF WIND BLOWN MOISTURE OR DRAFTS ENTERING OR IF BIRD OR VERMIN PROOFING IS REQUIRED.
 - (3) ALTERNATE FIXING METHOD IS TO USE A MULTIDEK CLIP TO TOP PURLIN & FIX APRON TO SHEET & CLIP WITH 12x25mm TYPE 17 SCREW OR 4.8mm min RIVET.

NOTES:

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by 'Roofing Industries'.
- The building designer is ultimately responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure are indicative only and are the responsibility of the building designer.
- Thermal break or cavity battens may be required in some circumstances.
- Underlay selection and building wrap types are the responsibility of the designer. Alternative support to galvanised netting should be used in severe coastal environments including when aluminium is used.
- These details are for Roofing Industries profiles as nominated and may not be applicable to other profiles.
- This drawing is the copyright of Roofing Industries and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metaloofers.org.nz & www.roof.co.nz
- Where necessary adjust drawings for purlin battens or cavity battens.
- Details are for steel based materials, other substrate may require some changes.



TYPICAL WALL/ROOF JUNCTION
1:5

©COPYRIGHT DETAIL 2012

