


COMMERCIAL MULTIDEK ROOFING PENETRATION SOAKER FLASHING

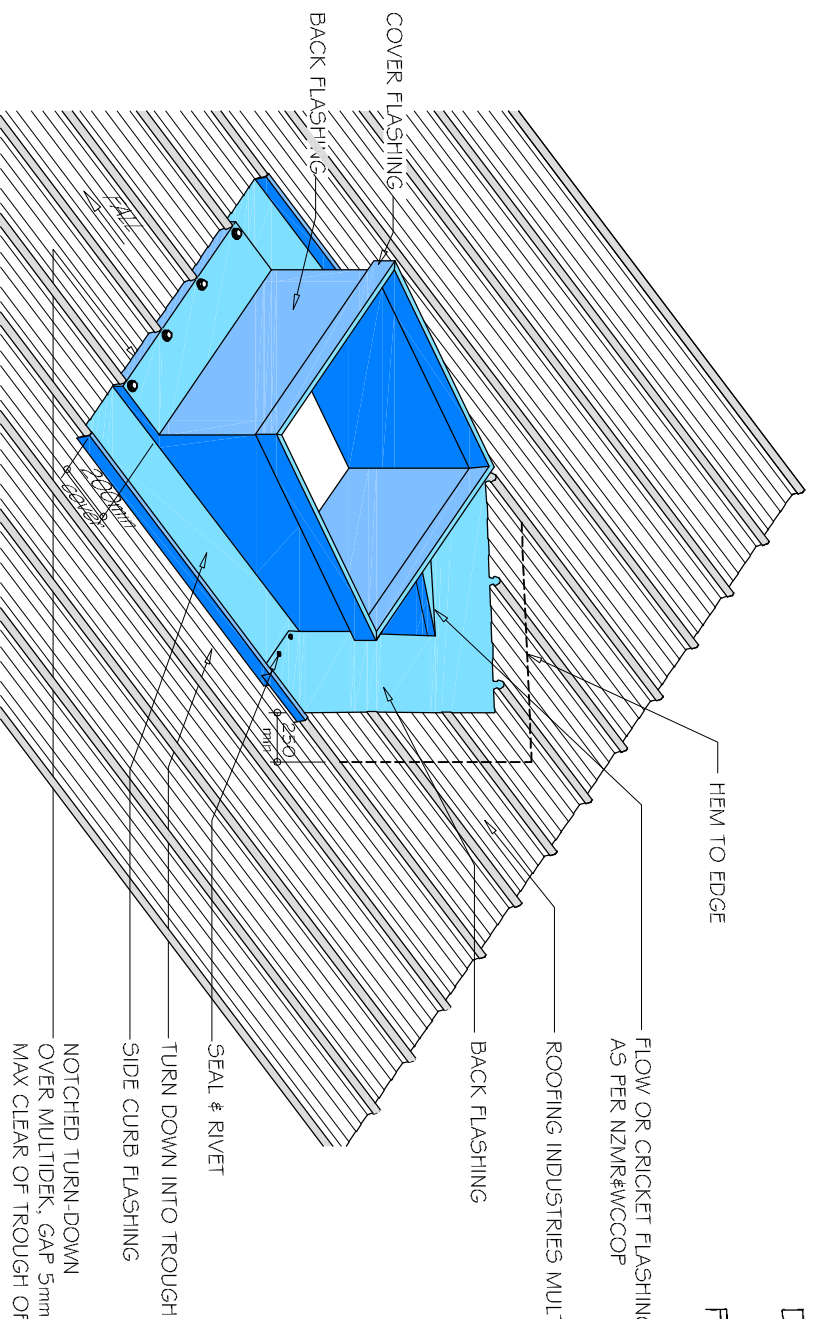

DETAIL NO. CMDR019A
 DATE DRAWN 21/02/12
 FILE REFERENCE R1-CMDR019A.DWG

NOTE:
 (1) ADDITIONAL SUPPORT FRAMING MAYBE
 REQUIRED WHEN PENETRATION EXCEEDS
 200mm THROUGH ROOF.
 (2) REFER TO SECTION 6 OF NZMRM CODE OF
 PRACTICE FOR CATCHMENT AREA LIMITATIONS.

FLOW OR CRICKET FLASHING
 AS PER NZMR&CCOP
 ROOFING INDUSTRIES MULTIDEK
 BACK FLASHING
 SEAL & RIVET
 TURN DOWN INTO TROUGH
 SIDE CURB FLASHING
 NOTCHED TURN-DOWN
 OVER MULTIDEK, GAP 5mm
 MAX CLEAR OF TROUGH OF ROOFING

NOTES:

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries.
- The building designer is ultimately responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure are indicative only and are the responsibility of the building designer.
- Thermal break or cavity battens may be required in some circumstances.
- Underlay selection and building wrap types are the responsibility of the designer, Alternative support to galvanised netting should be used in severe coastal environments including when aluminum is used.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metlroofer.org.nz & www.roof.co.nz
- Where necessary adjust drawings for purlin battens or cavity battens.
- Details are for steel based materials, other substrate may require some changes.

©COPYRIGHT DETAIL 2012

