
## (Internal Bracket - Alternative) COMMERCIAL MULTIDEK ROOFING 25 BOX GUTTER DETAIL

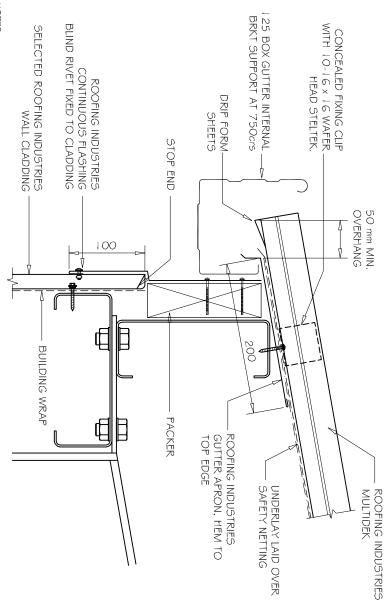

DETAIL NO

CMDR030A-I

DATE DRAWN


21/02/12

FILE REFERENCE

RI-CMDR030A-I.DWG

NOTES

- (1) MINIMUM PITCH 3°
- (2) FOR CAPACITY CALCULATION REFER TO NZMRM CODE OF PRACTICE.
- (3) EXTERNAL BRACKETS ARE RECOMMENDED TO ALL GUTTERS IN AREAS SUBJECT TO SNOW, REFER DWG CMDRO30B

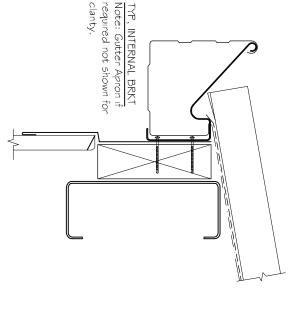





of the building designer.

Details of the supporting structure are indicative only and are the responsibility

the requirements of the NZ Building Code for the specific project

The building designer is ultimately responsible to ensure that details used meet Code of Practice and in some cases specific details by 'Koofing Industries' These details are generally in compliance with the NZ Metal Roof & Wall Cladding

Underlay selection and building wrap types are the responsibility of the designer Thermal break or cavity battens may be required in some circumstances

environments including when aluminium is used. Alternative support to galvanised netting should be used in severe coastal

These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.

reproduced with their permission. This drawing is the copyright of 'Roofing Industries' and can only be copied or

of Practice www.metalroofer.org.nz & www.roof.co.nz Further information can be obtained from the NZ Metal Roof \$ Wall Cladding Code

Where necessary adjust drawings for purlin battens or cavity battens

Details are for steel based materials, other substrate may require some changes