
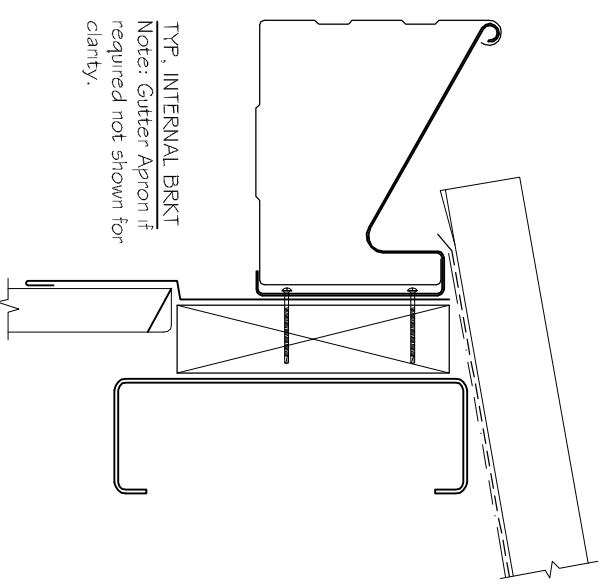


COMMERCIAL MULTIDEK ROOFING 175 BOX GUTTER DETAIL (Internal Bracket - Alternative)

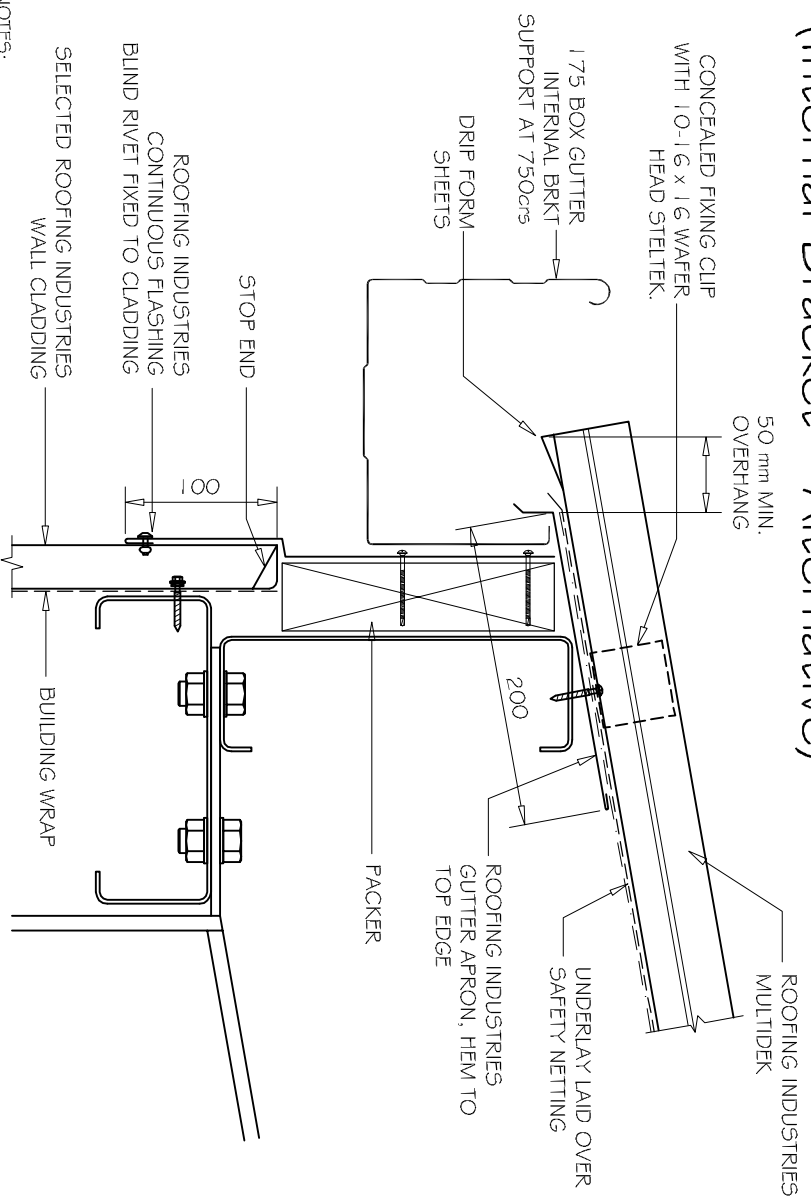

DETAIL NO. CMDR031A-1
 DATE DRAWN 21/02/12
 FILE REFERENCE R1-CMDR031A-1.DWG

NOTES:
 (1) MINIMUM PITCH 3°
 (2) FOR CAPACITY CALCULATION REFER TO NZMRM CODE OF PRACTICE.
 (3) EXTERNAL BRACKETS RECOMMENDED TO ALL GUTTERS IN AREAS SUBJECT TO SNOW.

A 175 BOX GUTTER MULTIDEK PROFILE
 1:5

- NOTES:
- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries.
 - The building designer is ultimately responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project.
 - Details of the supporting structure are indicative only and are the responsibility of the building designer.
 - Thermal break or cavity battens may be required in some circumstances.
 - Underlay selection and building wrap types are the responsibility of the designer. Alternative support to galvanised netting should be used in severe coastal environments, including when aluminum is used.
 - These details are for Roofing Industries profiles as nominated and may not be applicable to other profiles.
 - This drawing is the copyright of Roofing Industries and can only be copied or reproduced with their permission.
 - Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metaloof.co.nz & www.roof.co.nz
 - Where necessary, adjust drawings for purlin battens or cavity battens.
 - Details are for steel based materials, other substrate may require some changes.

