

# COMMERCIAL MULTIDEX ROOFING RAINWATER HEAD

DETAIL NO.


CMDR050A

DATE DRAWN


21/02/12

FILE REFERENCE

R1-CMDR050A.DWG

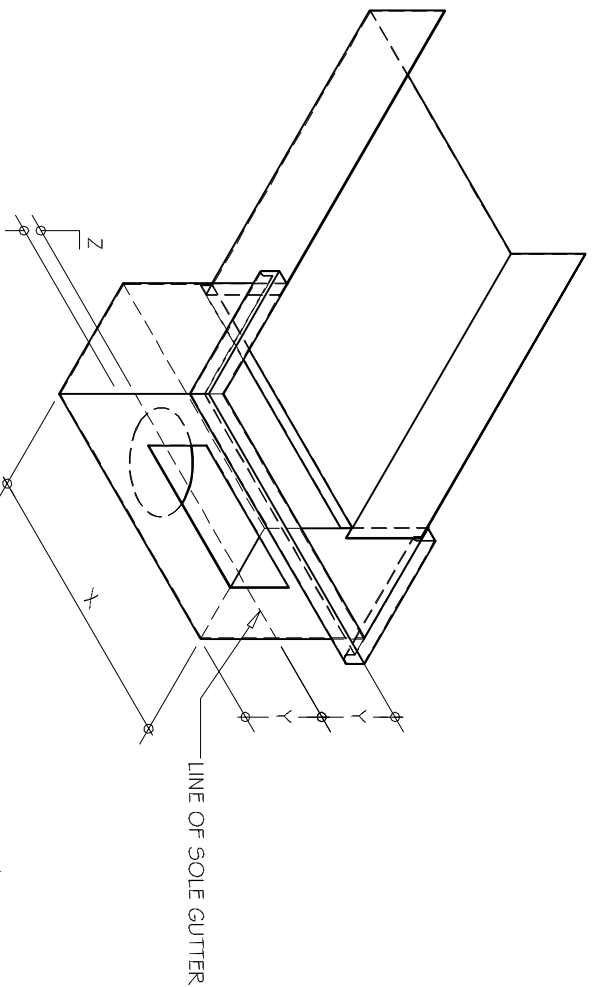

DIMENSION Y EQUAL TO DEPTH OF GUTTER AT OUTFLOW  
DIMENSION X EQUAL TO OR GREATER THAN WIDTH OF GUTTER  
DIMENSION Z GREATER THAN OR EQUAL TO 25mm  
CROSS-SECTION AREA OF OVERFLOW GREATER THAN OR  
EQUAL TO CROSS-SECTION AREA OF OUTFLET

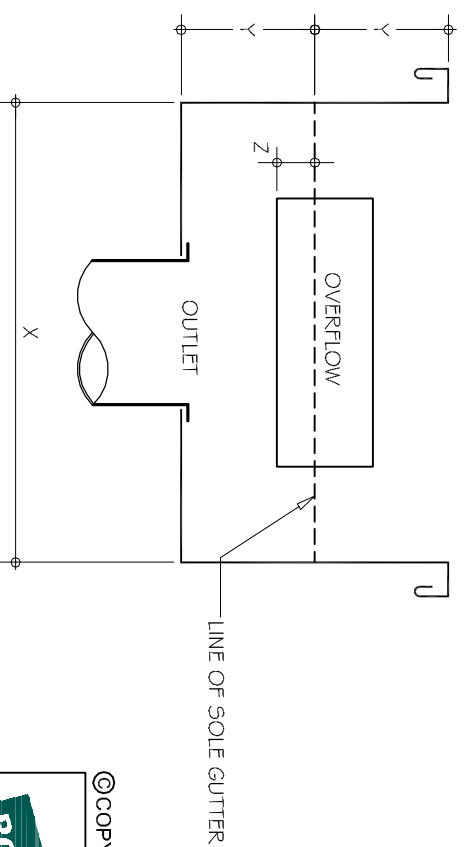

## NOTES:

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries.
- The building designer is ultimately responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure are indicative only and are the responsibility of the building designer.
- Thermal break or cavity battens may be required in some circumstances.
- Underlay selection and building wrap types are the responsibility of the designer.
- Alternative support to galvanised netting should be used in severe coastal environments including when aluminum is used.
- These details are for Roofing Industries profiles as nominated and may not be applicable to other profiles.
- This drawing is the copyright of Roofing Industries and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice [www.metalf.roofer.org.nz](http://www.metalf.roofer.org.nz) & [www.roof.co.nz](http://www.roof.co.nz)
- Where necessary adjust drawings for purlin battens or cavity battens.
- Details are for steel based materials, other substrate may require some changes.

©COPYRIGHT DETAIL 2012

