
## CABLE ENTRY PENETRATION FLASHING COMMERCIAL MAXISPAN ROOFING

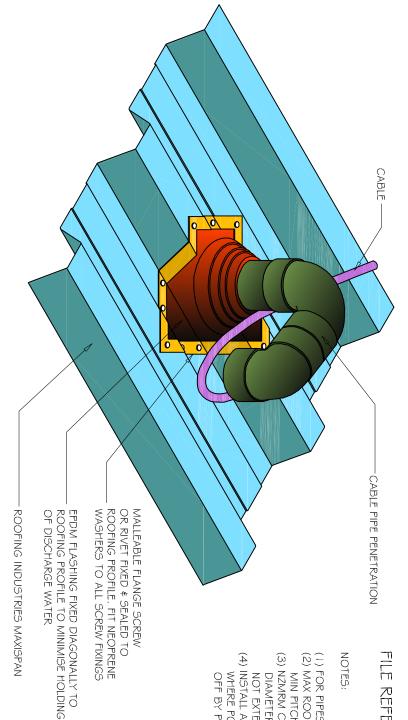

DETAIL NO.

CMSR020A

DATE DRAWN

02/03/12

FILE REFERENCE

RI-CMSRO2OA.DWG

NOTES.

- (1) FOR PIPES UP TO 85mm DIAMETER.(2) MAX ROOF PITCH FOR THIS FLASHING 45°. MIN PITCH 3°
- (3) NZMRM CODE OF PRACTICE ALLOWS LARGER THAN 85mm DIAMETER PENETRATION PROVIDED THE FLASHING DOES NOT EXTEND TO MORE THAN 50% OF PAN WIDTH.
- (4) INSTALL ADJACENT TO PURLIN FOR SUPPORT WHERE POSSIBLE. NO PANS TO BE FULLY BLOCKED OFF BY PIPE OR DEKTITE.

Code of Practice and in some cases specific details by Roofing Industries

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding
- the requirements of the NZ Building Code for the specific project The building designer is ultimately responsible to ensure that details used meet
- Details of the supporting structure are indicative only and are the responsibility
- Thermal break or cavity battens may be required in some circumstances
- environments including when aluminium is used. Alternative support to galvanised netting should be used in severe coastal Underlay selection and building wrap types are the responsibility of the designer,
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- of Practice www.metalroofer.org.nz & www.roof.co.nz Further information can be obtained from the NZ Metal Roof & Wall Cladding Code
- Where necessary adjust drawings for purlin battens or cavity battens
- Details are for steel based materials, other substrate may require some changes

©COPYRIGHT DETAIL 2012

