



COMMERCIAL MAXISPAN ROOFING RAINWATER HEAD

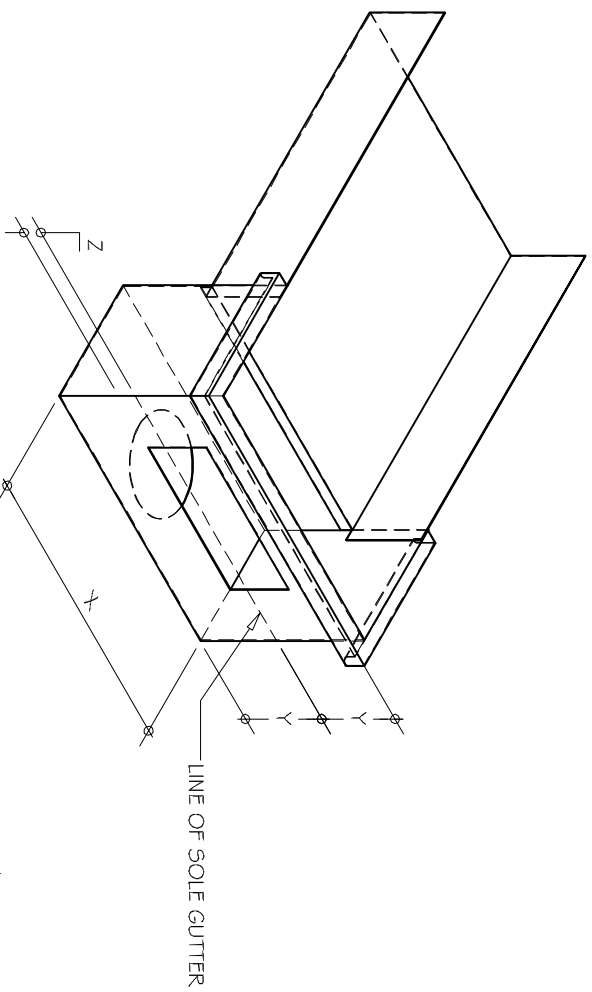

DETAIL NO. CMSR050A
 DATE DRAWN 11/03/12
 FILE REFERENCE R1-CMSR050A.DWG
 DIMENSION Y EQUAL TO DEPTH OF GUTTER AT OUTFLOW
 DIMENSION X EQUAL TO OR GREATER THAN WIDTH OF GUTTER
 DIMENSION Z GREATER THAN OR EQUAL TO 25mm
 CROSS-SECTION AREA OF OVERFLOW GREATER THAN OR
 EQUAL TO CROSS-SECTION AREA OF OUTFLET

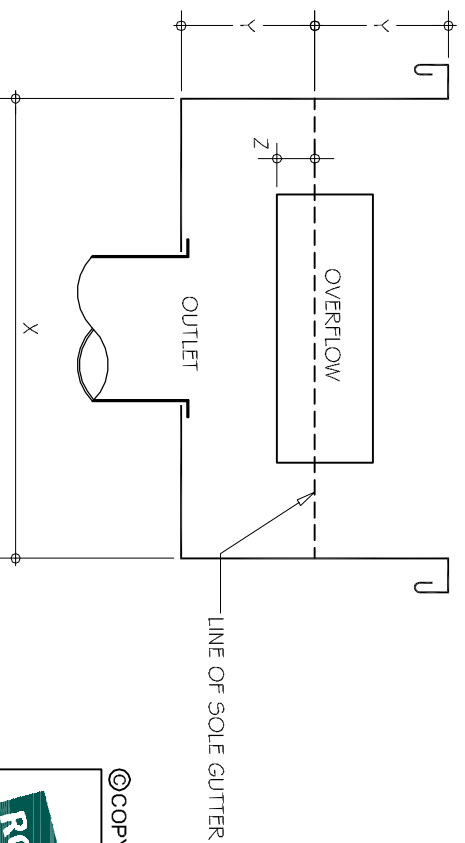

NOTES:

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries.
- The building designer is ultimately responsible to ensure that details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure are indicative only and are the responsibility of the building designer.
- Thermal break or cavity battens may be required in some circumstances.
- Underlay selection and building wrap types are the responsibility of the designer, Alternative support to galvanised netting should be used in severe coastal environments including when aluminium is used.
- These details are for Roofing Industries' profiles as nominated and may not be applicable to other profiles.
- This drawing is the copyright of Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice www.metd-roofer.org.nz & www.roof.co.nz
- Where necessary adjust drawings for purlin battens or cavity battens.
- Details are for steel based materials, other substrate may require some changes.



©COPYRIGHT DETAIL 2012