

DETAIL NO

CMSW090B

DATE DRAWN

FILE REFERENCE

RI-CMSW090B.DWG

1 1/03/12

10mm GAP IF COMPLIANCE

WITH E2/AS | REQUIRED

4.8mm ALUM RIVETS BETWEEN GIRTS WHERE 0.55mm BMT JAMB FLASHING (2 CRESTS) APPLICABLE (offset for clarity) ROOFING INDUSTRIES

14x90 STEEL TEK & NEO

ROOFING INDUSTRIES
MAXISPAN


GIRT

OF PAN OF CLADDING GAP 5mm MAX TO CLEAR

GUIDE RAIL FIXED TO DOOR MULLION

SCREW FIXING THROUGH PAN

BUILDING WRAP (If required)

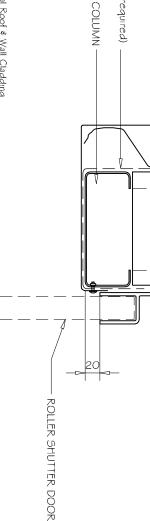

- These details are generally in compliance with the NZ Metal Roof & Wall Cladding Code of Practice and in some cases specific details by Roofing Industries
- requirements of the NZ Building Code for the specific project. The building designer is ultimately responsible to ensure that details used meet the
- the building designer. Details of the supporting structure are indicative only and are the responsibility of
- Thermal break or cavity battens may be required in some circumstances
- environments including when aluminium is used.

  These details are for Roofing Industries profile/s as nominated and may not be Alternative support to galvanised netting should be used in severe coastal Underlay selection and building wrap types are the responsibility of the designer,
- This drawing is the copyright of 'Roofing Industries' and can only be copied or applicable to other profiles.
- of Practice www.metalroofer.org.nz & www.roof.co.nz Where necessary adjust drawings for purlin battens or cavity battens Further information can be obtained from the NZ Metal Roof & Wall Cladding Code
- Details are for steel based materials, other substrate may require some changes

ROLLER DOOR JAMB VERTICAL MAXISPAN

©COPYRIGHT DETAIL 2012

