

# suPIR span

---

## COMMERCIAL ROOFING

### DETAIL LIST


		<u>Revision</u>	<u>Date</u>
00 / 15	COVER SHEET		
01 / 15	RIDGE DETAIL	1.0	14.2020
02 / 15	HEAD FLASHING DETAIL	1.0	14.2020
03 / 15	EAVES GUTTER DETAIL	1.0	14.2020
04 / 15	INSULATED GUTTER	1.0	14.2020
05 / 15	INSULATED BOX GUTTER	1.0	14.2020
06 / 15	BARGE CAPPING DETAIL	1.0	14.2020
07 / 15	BARGE/PARAPET DETAIL	1.0	14.2020
08 / 15	END LAP DETAIL	1.0	14.2020
09 / 15	EXPANSION STEP DETAIL	1.0	14.2020
10 / 15	SKYLIGHT PANEL DETAIL (OPTIONAL)	1.0	14.2020
11 / 15	INSULATED PENETRATION DETAIL	1.0	14.2020
12 / 15	SIDE LAP DETAIL	1.0	14.2020
13 / 15	FASCIA AND BARGE FLASHING DIMENSIONS	1.0	14.2020
14 / 15	SIDE BARGE FLASHING DIMENSIONS	1.0	14.2020
15 / 15	PANEL PROFILE AND SIZE	1.0	14.2020


**ACCEPTABLE SOLUTION** AS PER E2/AS1

SITUATION 1	SITUATION 2	SITUATION 3
1. LOW, MEDIUM, HIGH WIND ZONES, WHERE ROOF PITCH $\geq 10^\circ$	1. ALL ROOF PITCHES IN VERY HIGH WIND ZONE 2. LOW, MEDIUM, HIGH WIND ZONES WHERE ROOF PITCH $\leq 10^\circ$	1. FOR ALL ROOF PITCHES IN EXTRA HIGH WIND ZONES
X MIN. 130mm (EXCLUDING ANY SOFT EDGE OR TURN-DOWN TO ROOFING)	MIN. 200mm (EXCLUDING ANY SOFT EDGE OR TURN-DOWN TO ROOFING)	

**ALTERNATIVE SOLUTION** AS PER MRM CODE OF PRACTICE

CATEGORY A	CATEGORY B
1. NORMAL EXPOSURE 2. ROOF PITCH $>10^\circ$	1. EXPOSED (HIGHER RISK) & WIND LOAD EXCEEDS 1.5 kPa. 2. ROOF PITCH $<10^\circ$
X MIN. 130mm	MIN. 200mm

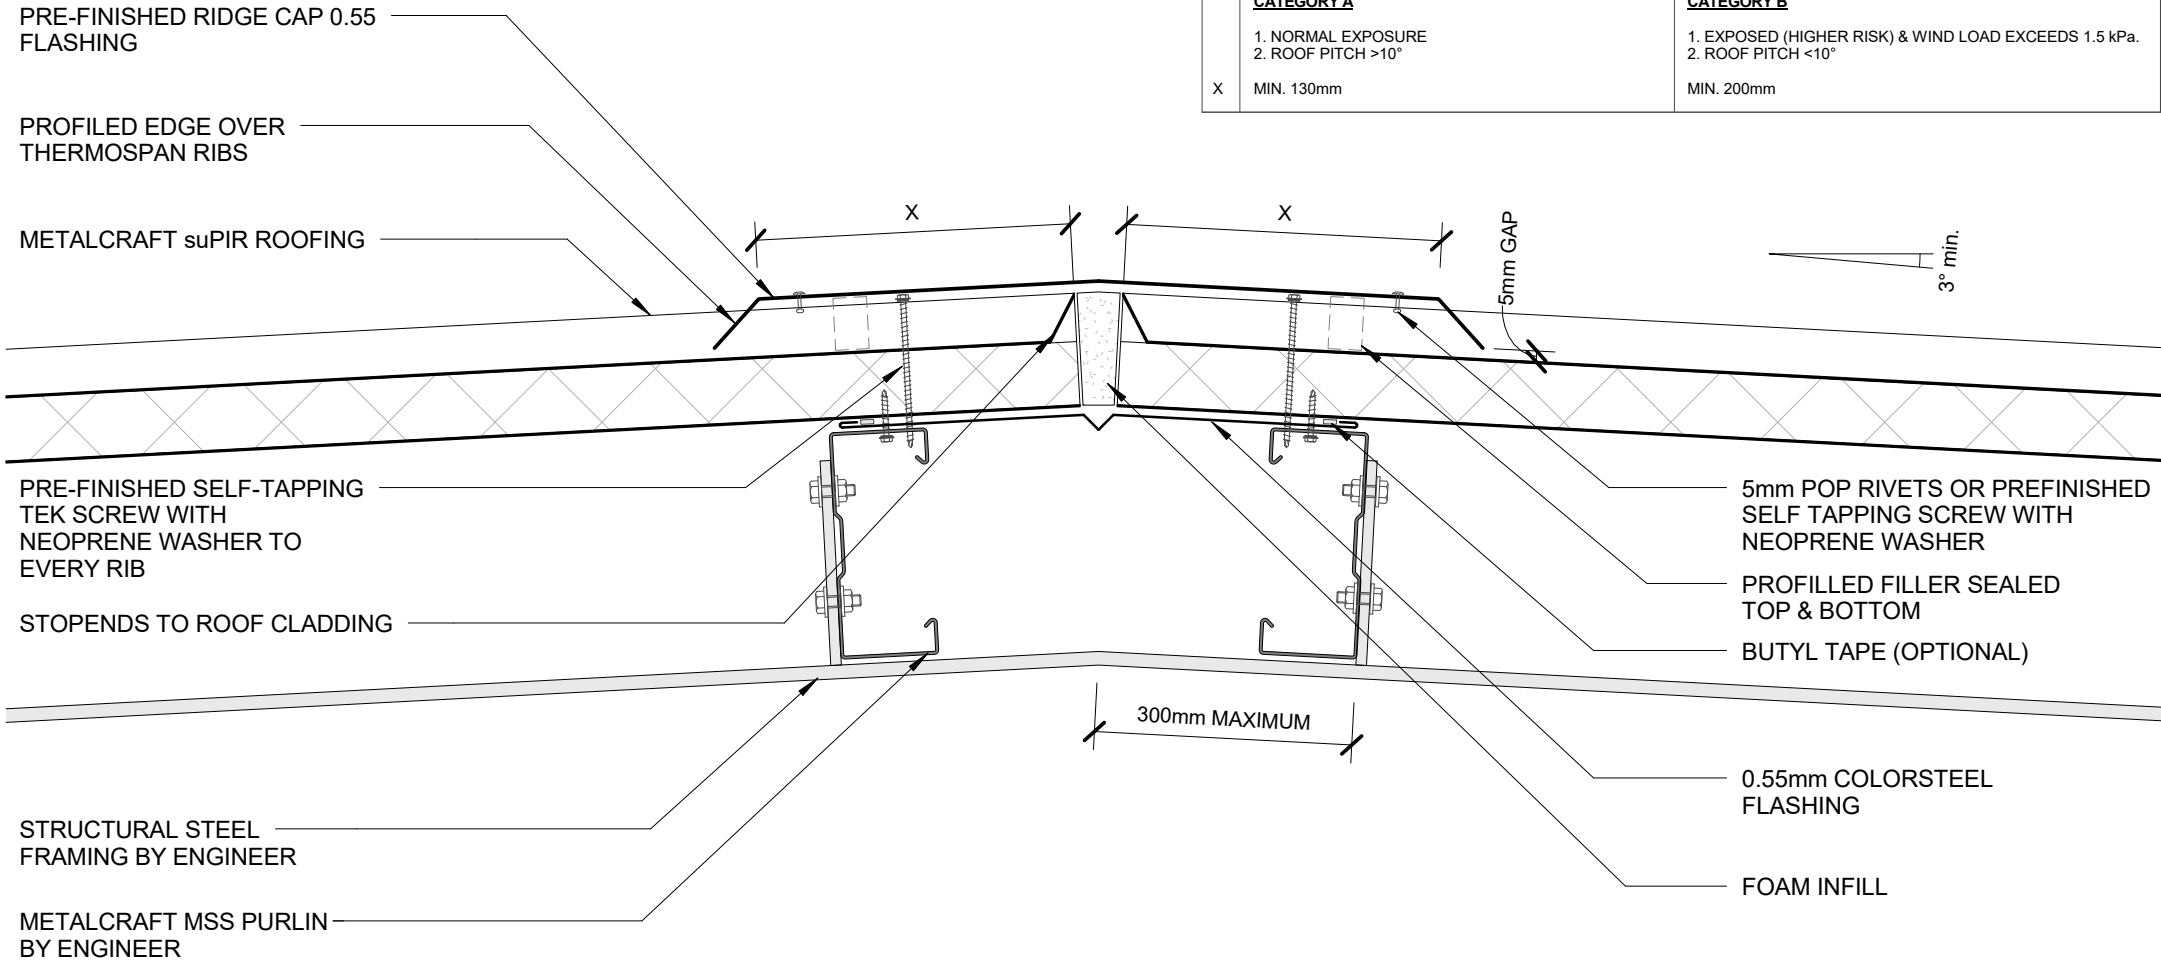

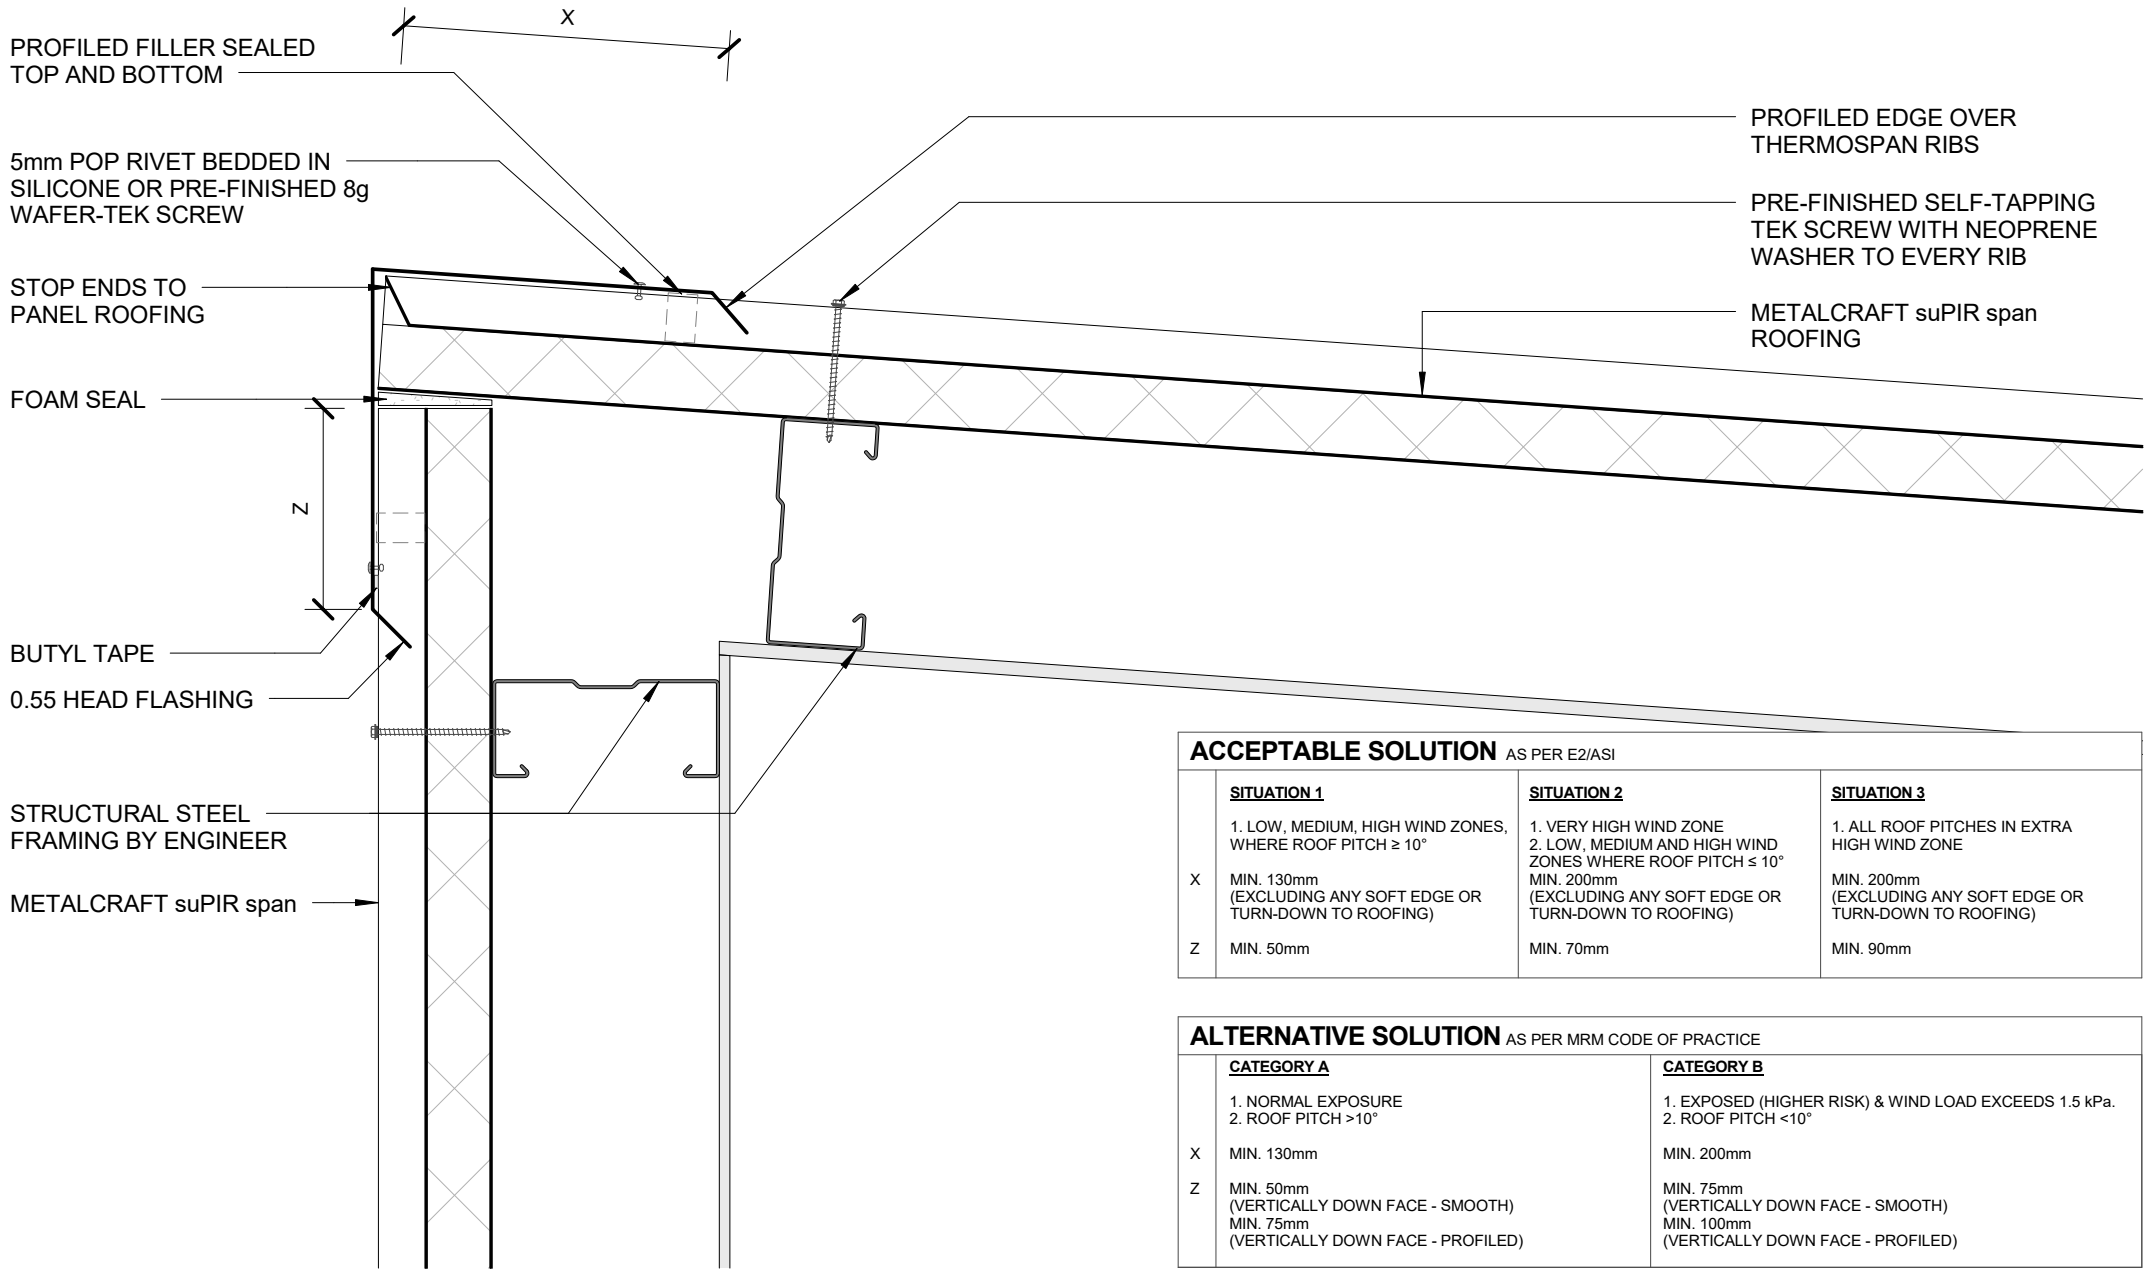

ACCEPTABLE SOLUTION AS PER E2/ASI			
	SITUATION 1	SITUATION 2	SITUATION 3
	1. LOW, MEDIUM, HIGH WIND ZONES, WHERE ROOF PITCH $\geq 10^\circ$	1. VERY HIGH WIND ZONE 2. LOW, MEDIUM AND HIGH WIND ZONES WHERE ROOF PITCH $\leq 10^\circ$	1. ALL ROOF PITCHES IN EXTRA HIGH WIND ZONE
X	MIN. 130mm (EXCLUDING ANY SOFT EDGE OR TURN-DOWN TO ROOFING)	MIN. 200mm (EXCLUDING ANY SOFT EDGE OR TURN-DOWN TO ROOFING)	MIN. 200mm (EXCLUDING ANY SOFT EDGE OR TURN-DOWN TO ROOFING)
Z	MIN. 50mm	MIN. 70mm	MIN. 90mm

ALTERNATIVE SOLUTION AS PER MRM CODE OF PRACTICE	
	CATEGORY A
	1. NORMAL EXPOSURE 2. ROOF PITCH $>10^\circ$
X	MIN. 130mm
Z	MIN. 50mm (VERTICALLY DOWN FACE - SMOOTH) MIN. 75mm (VERTICALLY DOWN FACE - PROFILED)
	CATEGORY B
	1. EXPOSED (HIGHER RISK) & WIND LOAD EXCEEDS 1.5 kPa. 2. ROOF PITCH $<10^\circ$
X	MIN. 200mm
Z	MIN. 75mm (VERTICALLY DOWN FACE - SMOOTH) MIN. 100mm (VERTICALLY DOWN FACE - PROFILED)

PRE-FINISHED SELF-TAPPING TEK SCREW WITH NEOPRENE WASHER TO EVERY RIB

FOAM SEAL

5mm POP RIVETS OR PRE-FINISHED SELF TAPPING SCREW WITH NEOPRENE WASHER

METALCRAFT BOX GUTTER 175 WITH EXTERNAL BRACKET

BUTYL TAPE

PRE-FINISHED 0.55 GUTTER FLASHING

INSULATED PANEL

3° min.

75

METALCRAFT SUPPIR ROOFING

FASTEN GUTTER BRACKET WITH SUITABLE LENGTH TEK SCREWS INTO FASCIA PURLIN (BY OTHERS)

STRUCTURAL STEEL FRAMING BY ENGINEER

**Metalcraft**  
Insulated Panels

DISCLAIMER:  
All details are to be used for indicative purposes only and the designer should consult both the MRM code of practice version 3.0 / 2017, E2 and all other relevant building codes.  
Details of the supporting mechanisms are indicative only. Compliance of the supporting mechanisms is the responsibility of the designer. Construction detail can vary for wall cladding. The underlay is detailed as a single line for simplicity and is indicative only. Building paper type and method of installation should comply with underlay manufacturers recommendations and NZBC regulations.

suPIR span

Rev. 1.0

Reference CRSUP


Date 14.2020


EAVES GUTTER DETAIL  
COMMERCIAL ROOFING

Scale 1 : 5


Sheet

03 / 15

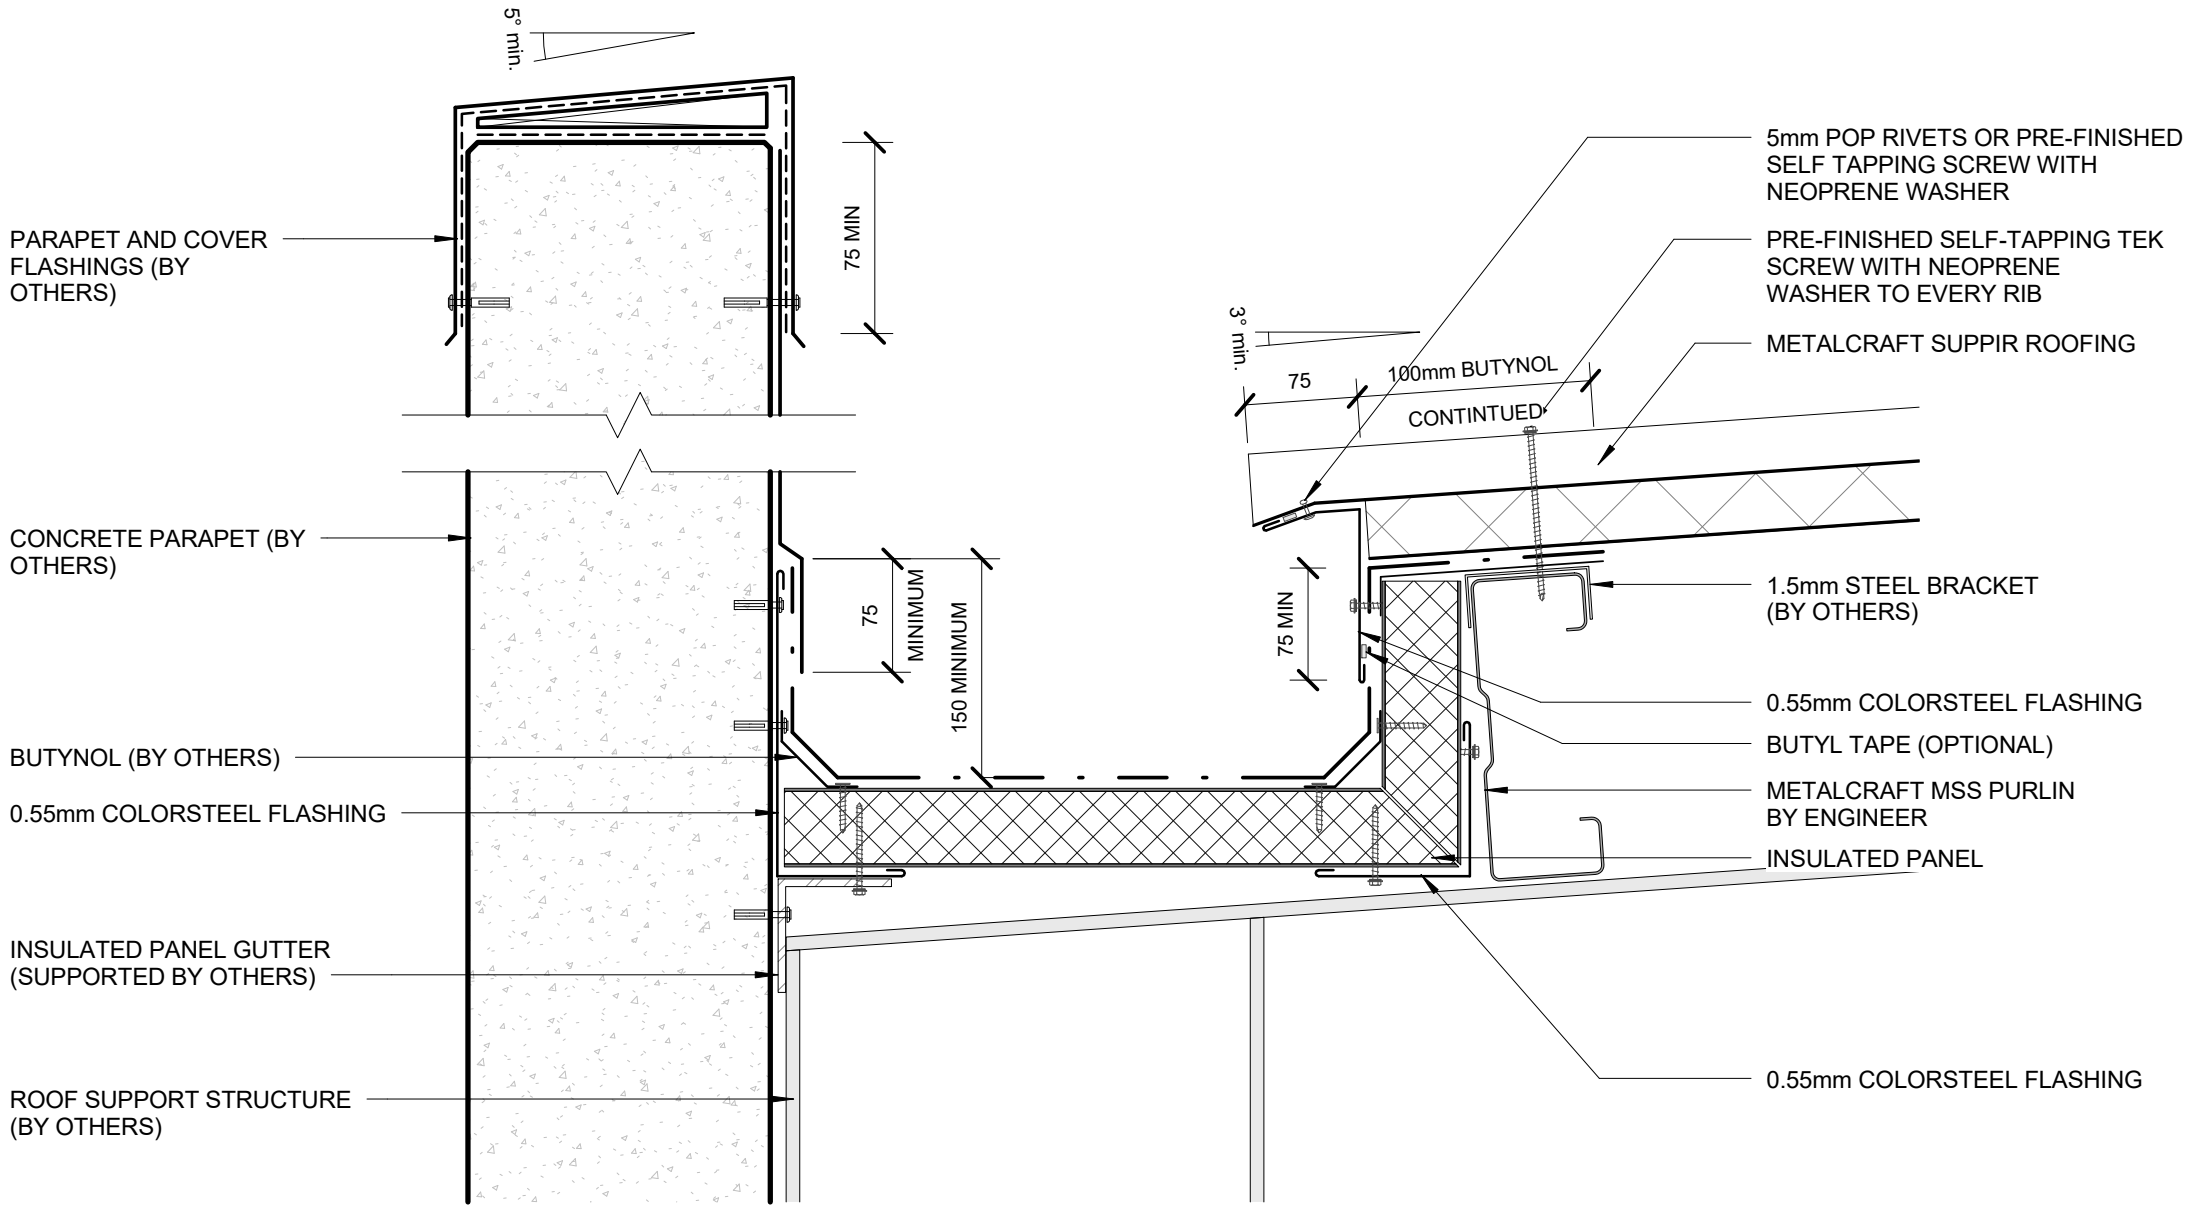

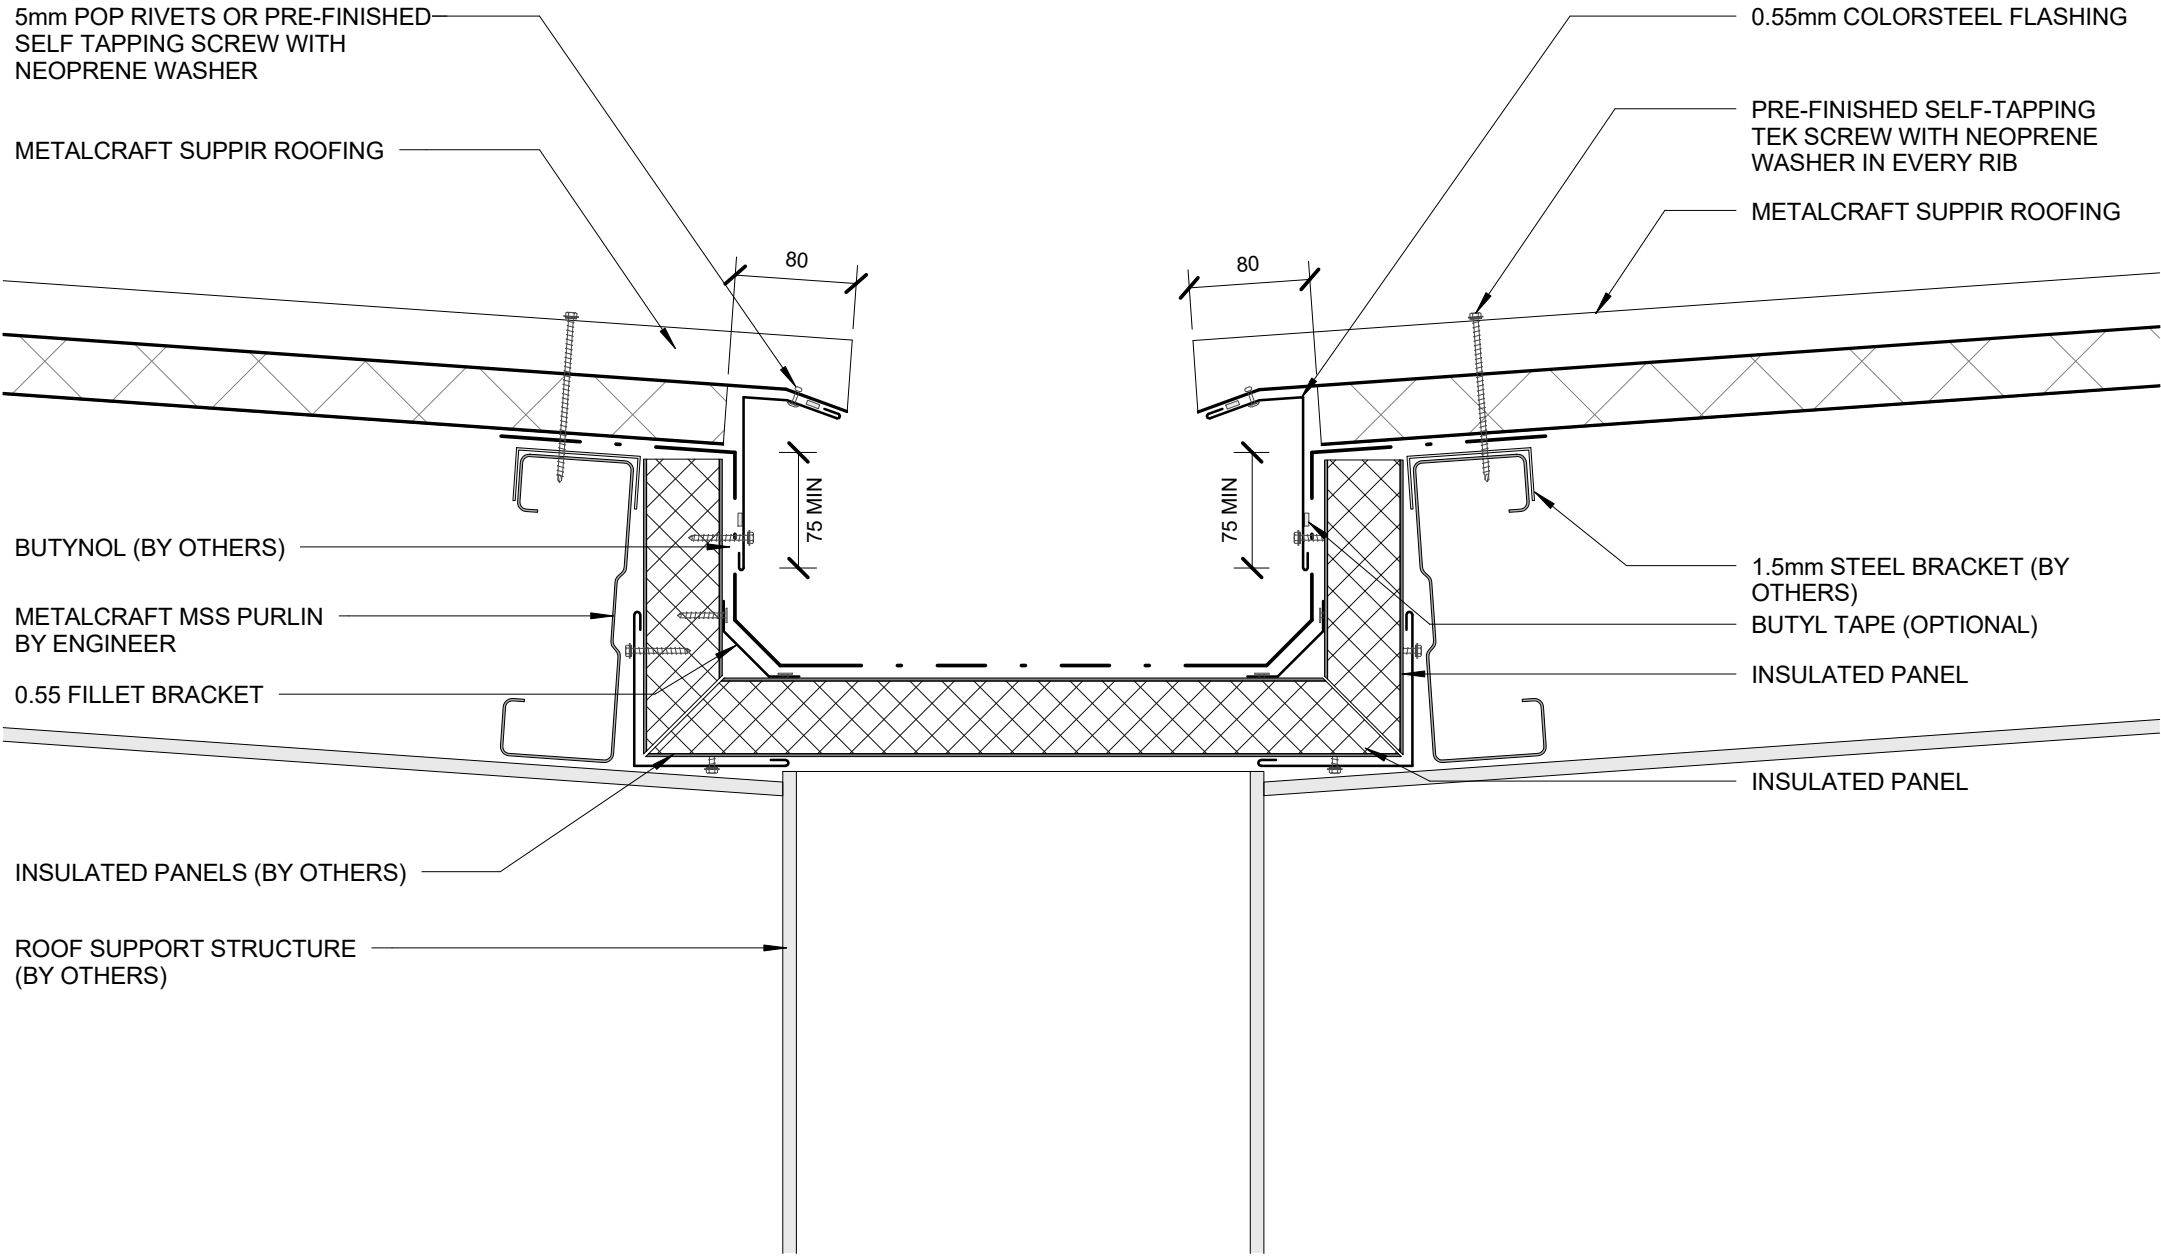

**INSULATED BOX GUTTER**  
**COMMERCIAL ROOFING**

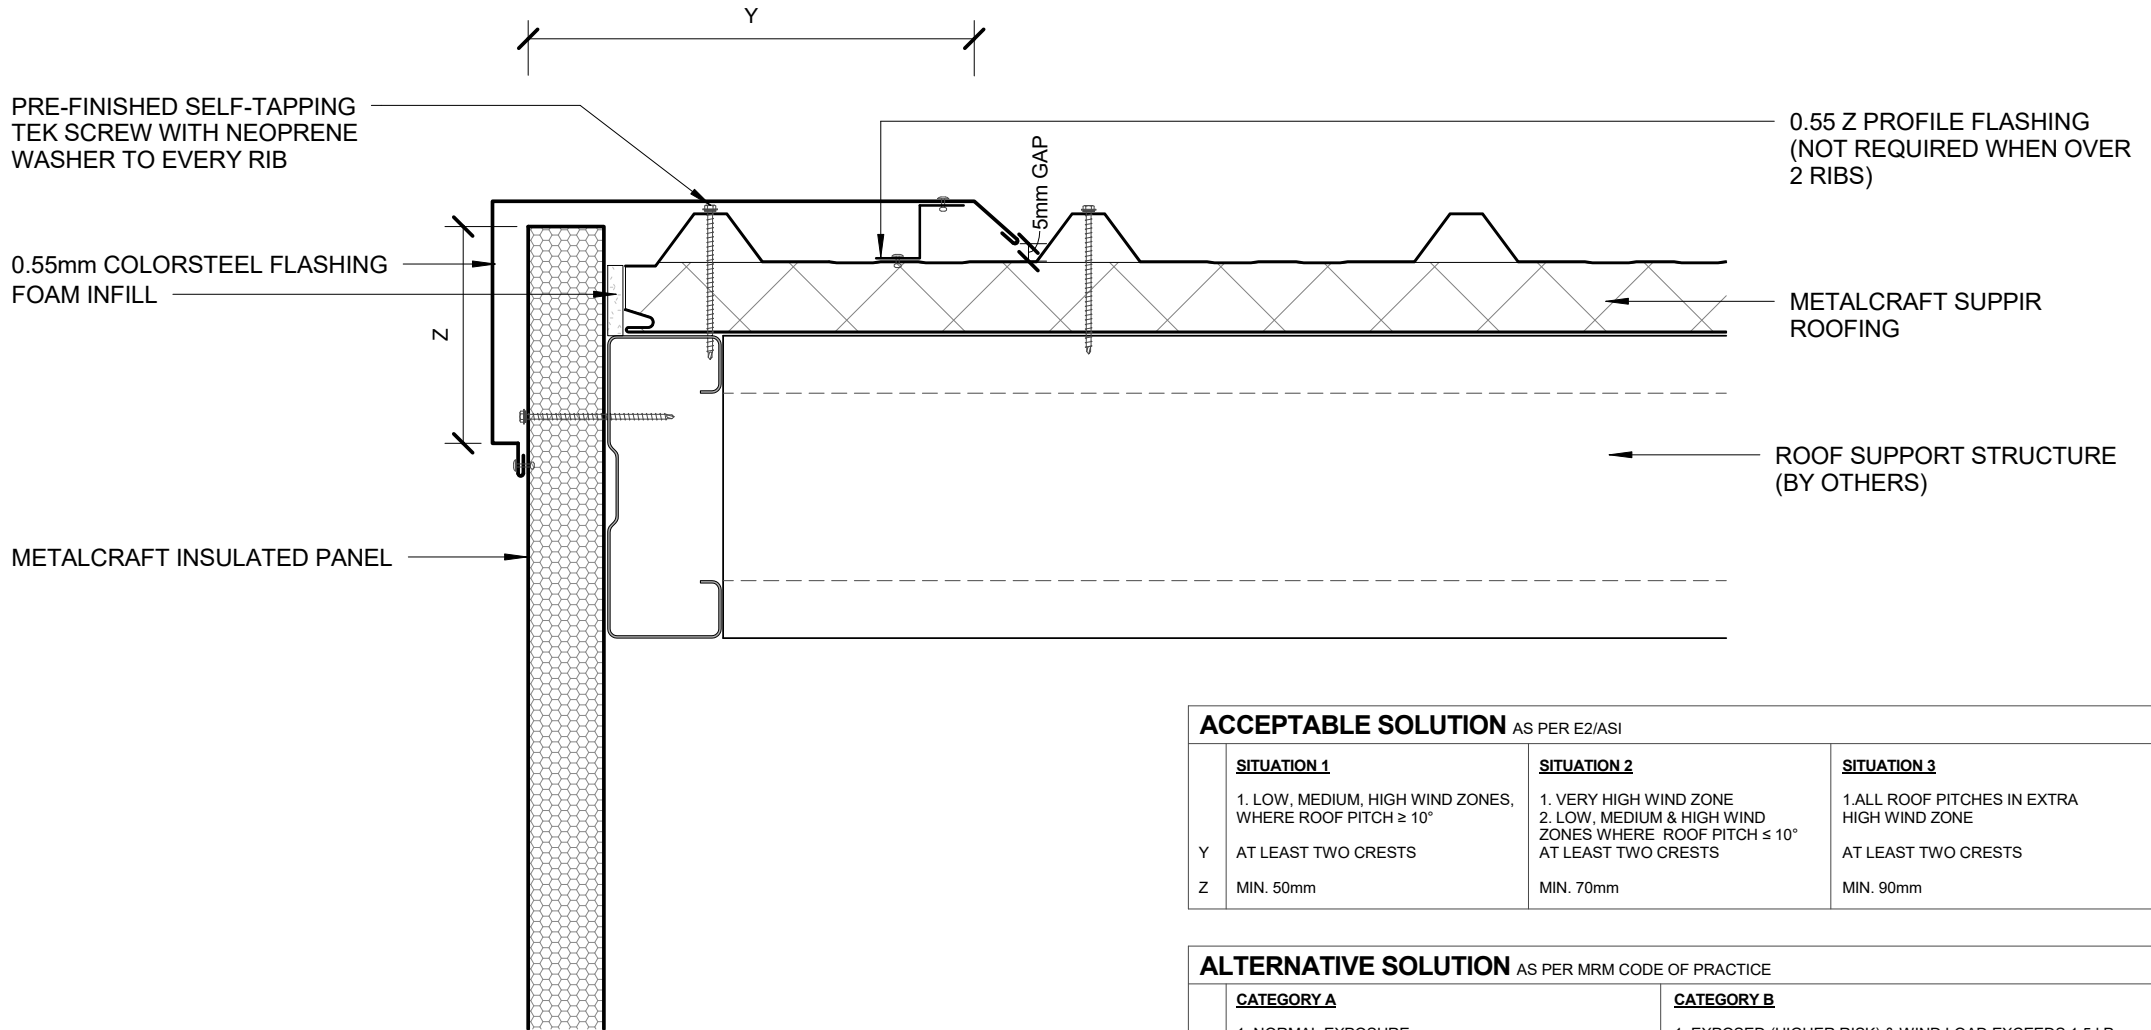


**ACCEPTABLE SOLUTION** AS PER E2/ASI

	<b>SITUATION 1</b>	<b>SITUATION 2</b>	<b>SITUATION 3</b>
	1. LOW, MEDIUM, HIGH WIND ZONES, WHERE ROOF PITCH $\geq 10^\circ$	1. VERY HIGH WIND ZONE 2. LOW, MEDIUM & HIGH WIND ZONES WHERE ROOF PITCH $\leq 10^\circ$	1. ALL ROOF PITCHES IN EXTRA HIGH WIND ZONE
Y	AT LEAST TWO CRESTS	AT LEAST TWO CRESTS	AT LEAST TWO CRESTS
Z	MIN. 50mm	MIN. 70mm	MIN. 90mm

**ALTERNATIVE SOLUTION** AS PER MRM CODE OF PRACTICE

	<b>CATEGORY A</b>	<b>CATEGORY B</b>
	1. NORMAL EXPOSURE 2. ROOF PITCH $> 10^\circ$	1. EXPOSED (HIGHER RISK) & WIND LOAD EXCEEDS 1.5 kPa. 2. ROOF PITCH $< 10^\circ$
Y	ONE RIB (TRAPEZOIDAL & TRAY) 2 CORRUGATIONS	ONE RIB, TWO RIBS ( $< 20\text{mm}$ ) (TRAPEZOIDAL & TRAY) 3 CORRUGATIONS
Z	MIN. 50mm (VERTICALLY DOWN FACE - SMOOTH) MIN. 75mm (VERTICALLY DOWN FACE - PROFILED)	MIN. 75mm (VERTICALLY DOWN FACE - SMOOTH) MIN. 100mm (VERTICALLY DOWN FACE - PROFILED)

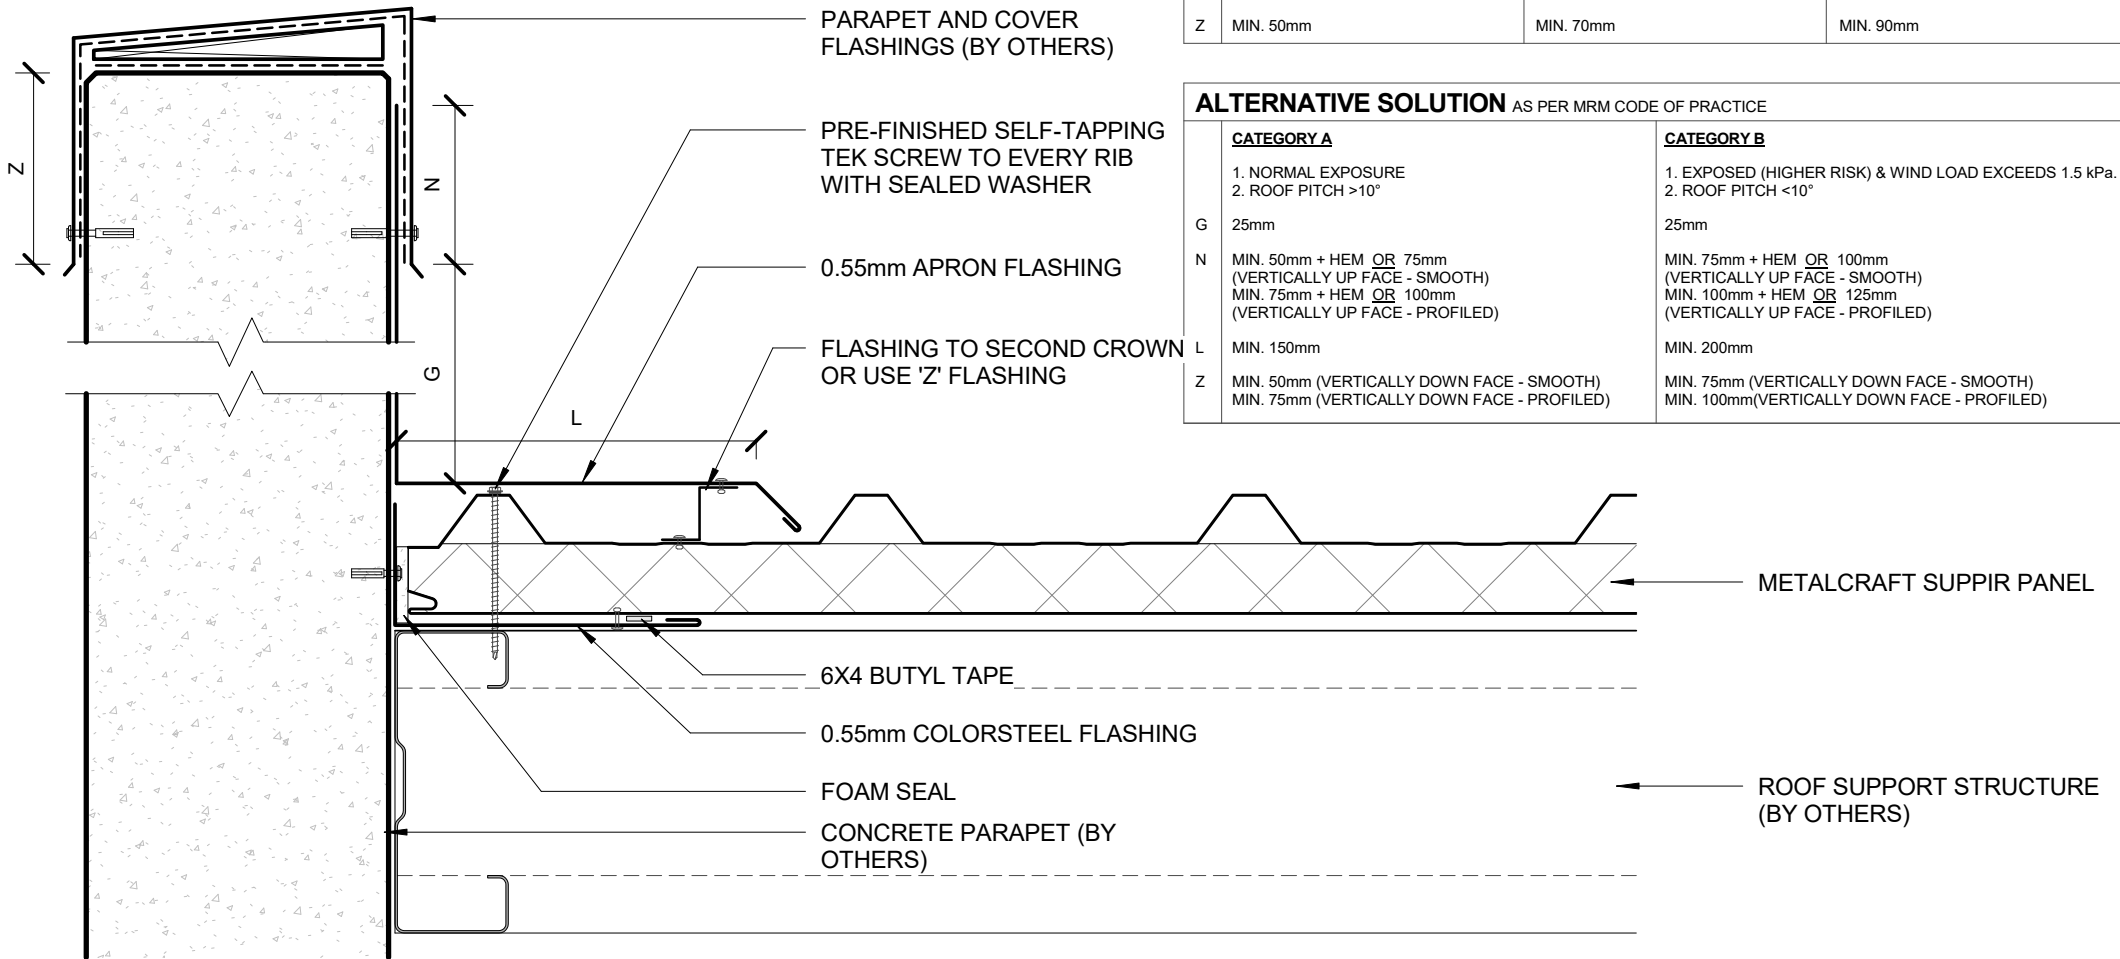

**ACCEPTABLE SOLUTION** AS PER E2/ASI



	<b>SITUATION 1</b>	<b>SITUATION 2</b>	<b>SITUATION 3</b>
	1. LOW, MEDIUM, HIGH WIND ZONES, WHERE ROOF PITCH $\geq 10^\circ$	1. ALL ROOF PITCHES IN VERY HIGH WIND ZONE 2. LOW, MEDIUM, & HIGH WIND ZONES WHERE ROOF PITCH $\leq 10^\circ$	1. ALL ROOF PITCHES IN EXTRA HIGH WIND ZONE
G	MIN. 35mm	MIN. 35mm	MIN. 35mm
N	MIN. 75mm	MIN. 75mm	MIN. 75mm
L	MIN. 130mm (EXCLUDING ANY SOFT EDGE OR TURN-DOWN TO ROOFING)	MIN. 200mm (EXCLUDING ANY SOFT EDGE OR TURN-DOWN TO ROOFING)	MIN. 200mm (EXCLUDING ANY SOFT EDGE OR TURN-DOWN TO ROOFING)
Z	MIN. 50mm	MIN. 70mm	MIN. 90mm

**ALTERNATIVE SOLUTION** AS PER MRM CODE OF PRACTICE


	<b>CATEGORY A</b>	<b>CATEGORY B</b>
	1. NORMAL EXPOSURE 2. ROOF PITCH $>10^\circ$	1. EXPOSED (HIGHER RISK) & WIND LOAD EXCEEDS 1.5 kPa. 2. ROOF PITCH $<10^\circ$
G	25mm	25mm
N	MIN. 50mm + HEM <u>OR</u> 75mm (VERTICALLY UP FACE - SMOOTH) MIN. 75mm + HEM <u>OR</u> 100mm (VERTICALLY UP FACE - PROFILED)	MIN. 75mm + HEM <u>OR</u> 100mm (VERTICALLY UP FACE - SMOOTH) MIN. 100mm + HEM <u>OR</u> 125mm (VERTICALLY UP FACE - PROFILED)
L	MIN. 150mm	MIN. 200mm
Z	MIN. 50mm (VERTICALLY DOWN FACE - SMOOTH) MIN. 75mm (VERTICALLY DOWN FACE - PROFILED)	MIN. 75mm (VERTICALLY DOWN FACE - SMOOTH) MIN. 100mm (VERTICALLY DOWN FACE - PROFILED)

**BARGE/PARAPET DETAIL**  
COMMERCIAL ROOFING




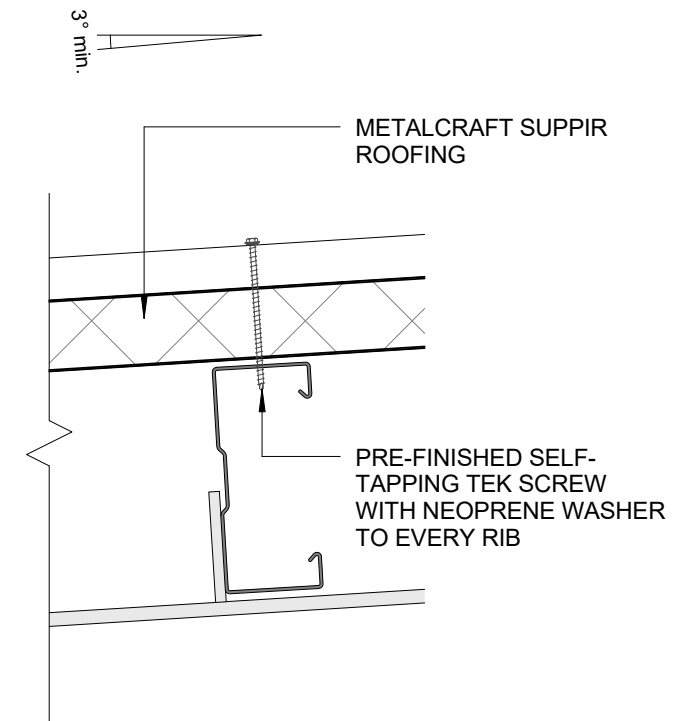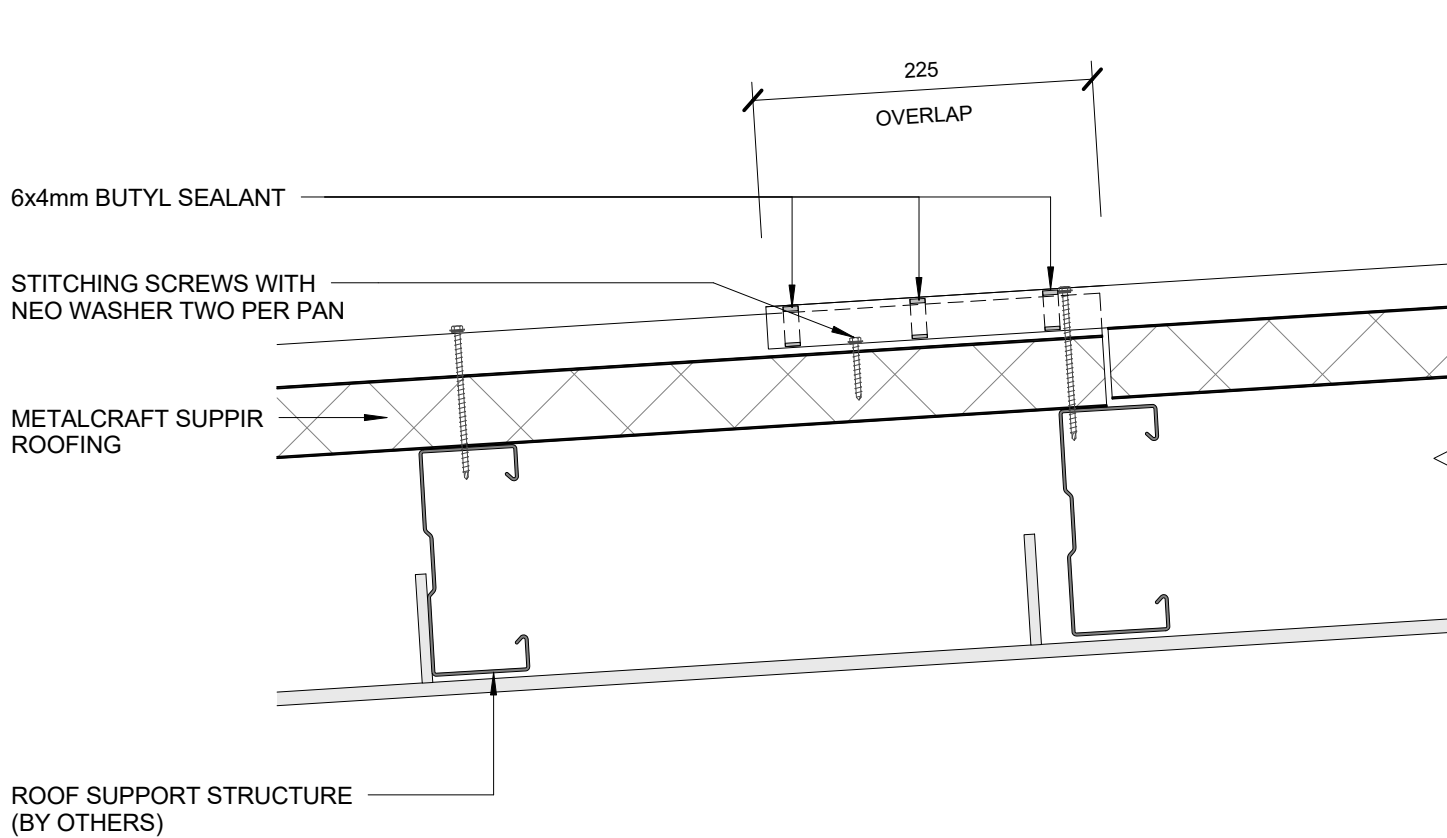



DETAIL RECOMMENDED  
WHERE ROOF RUNS  
EXCEED 16m

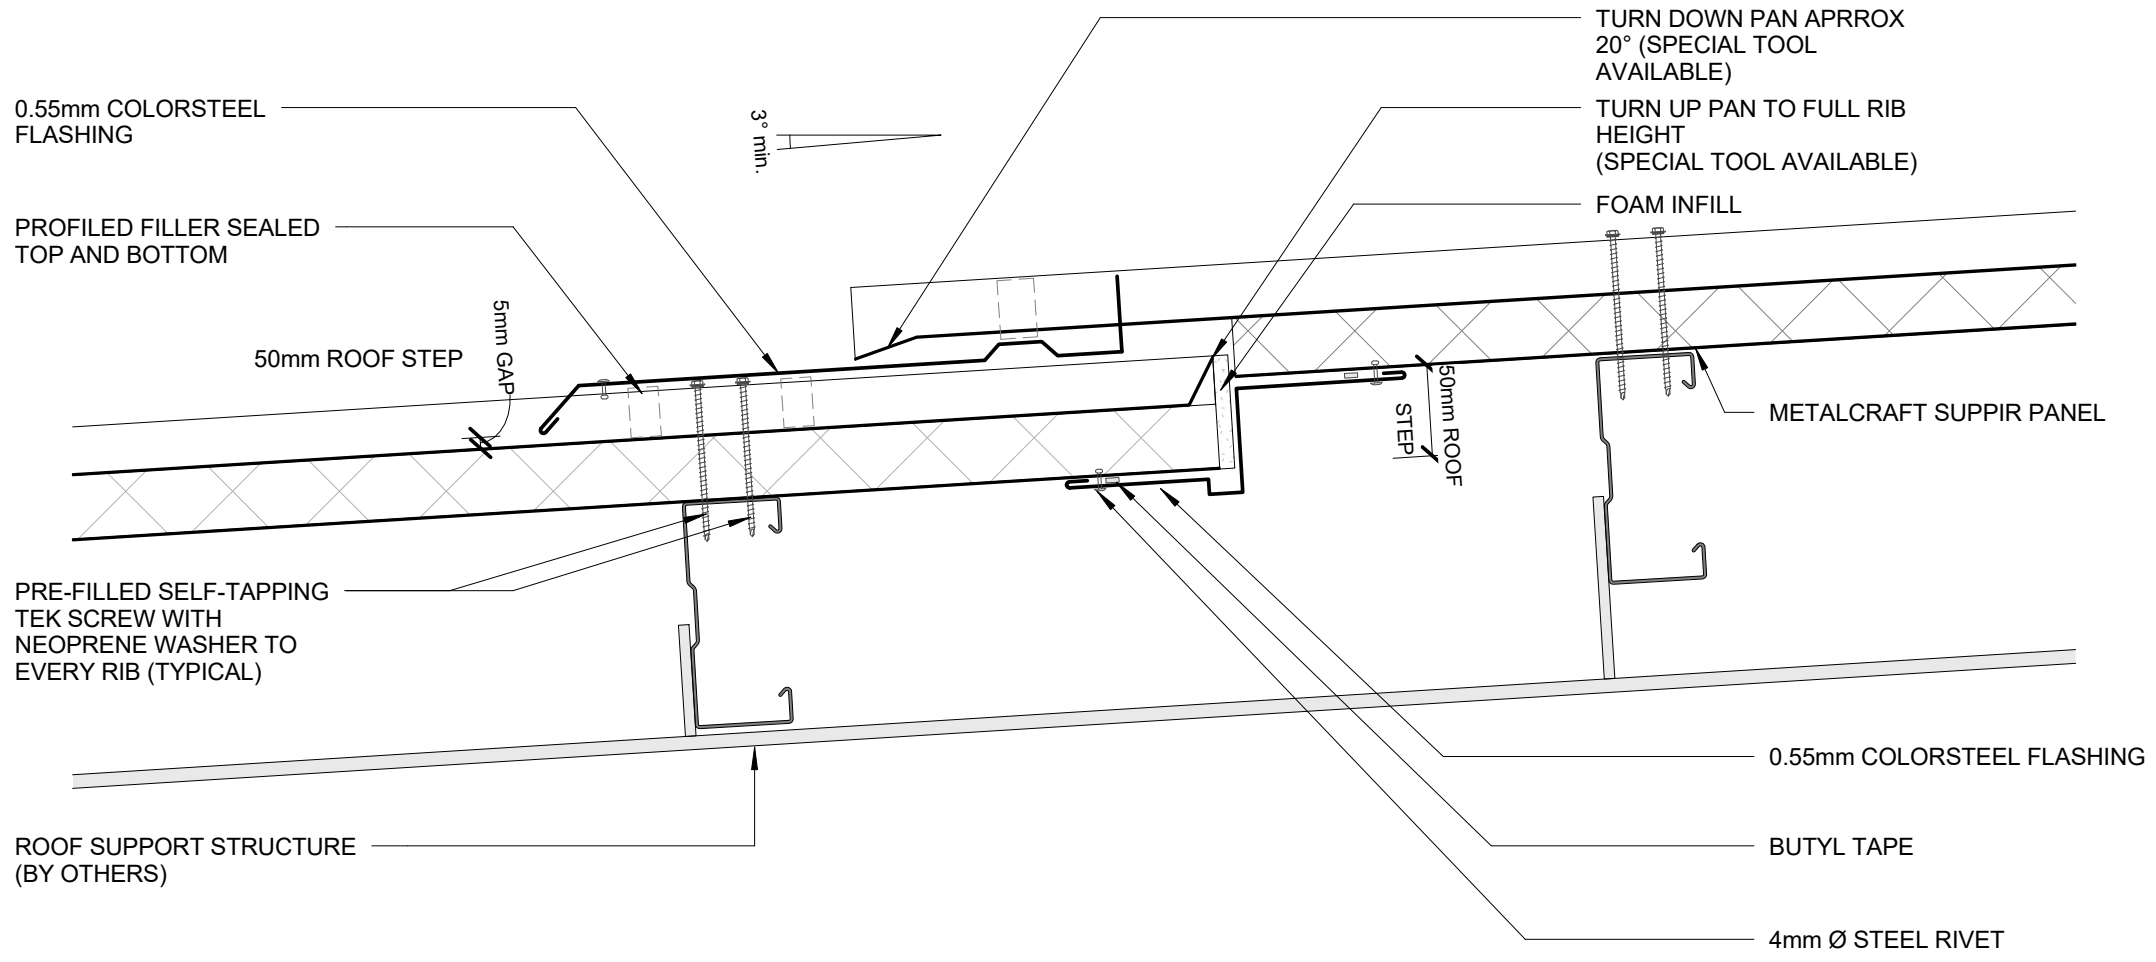

- ALSYNITE RECOMMEND CONTINUOUS RUN FROM RIDGE TO GUTTER
- R-VALUE OF ROOFLIGHT =0.57
- NO SAFETY MESH REQUIRED
- FOR MORE INFORMATION REFER [www.alsynite.co.nz](http://www.alsynite.co.nz)

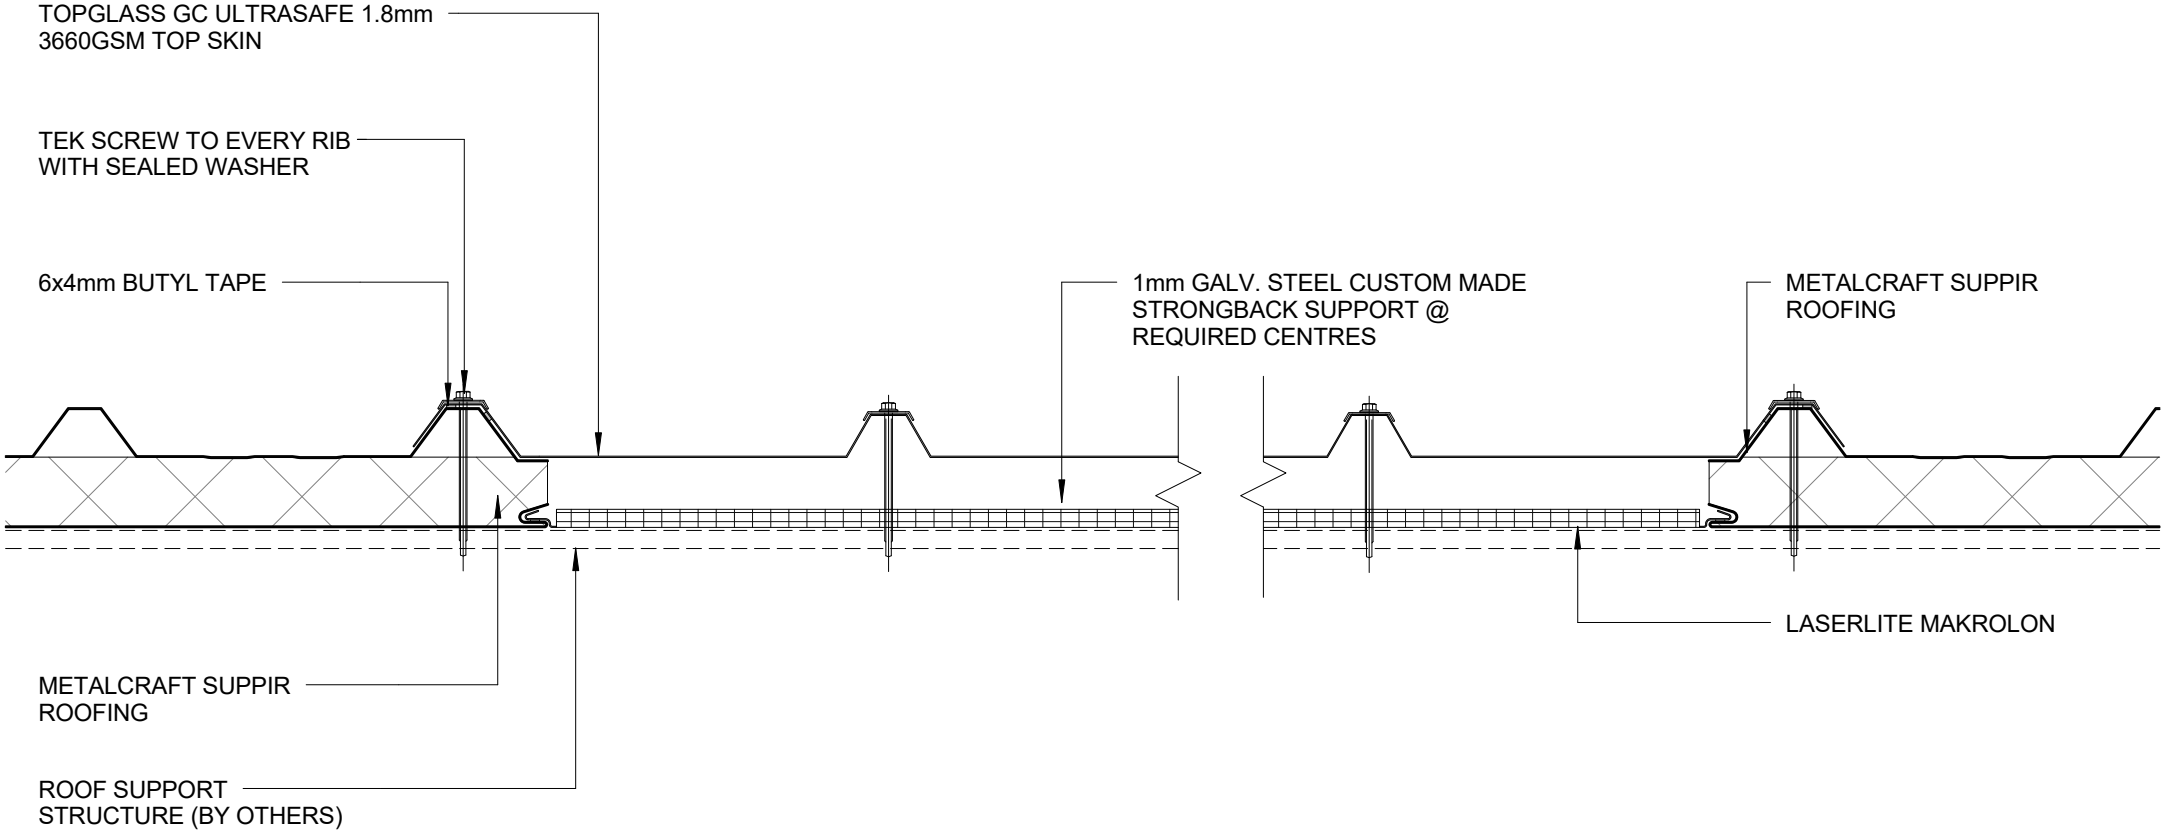


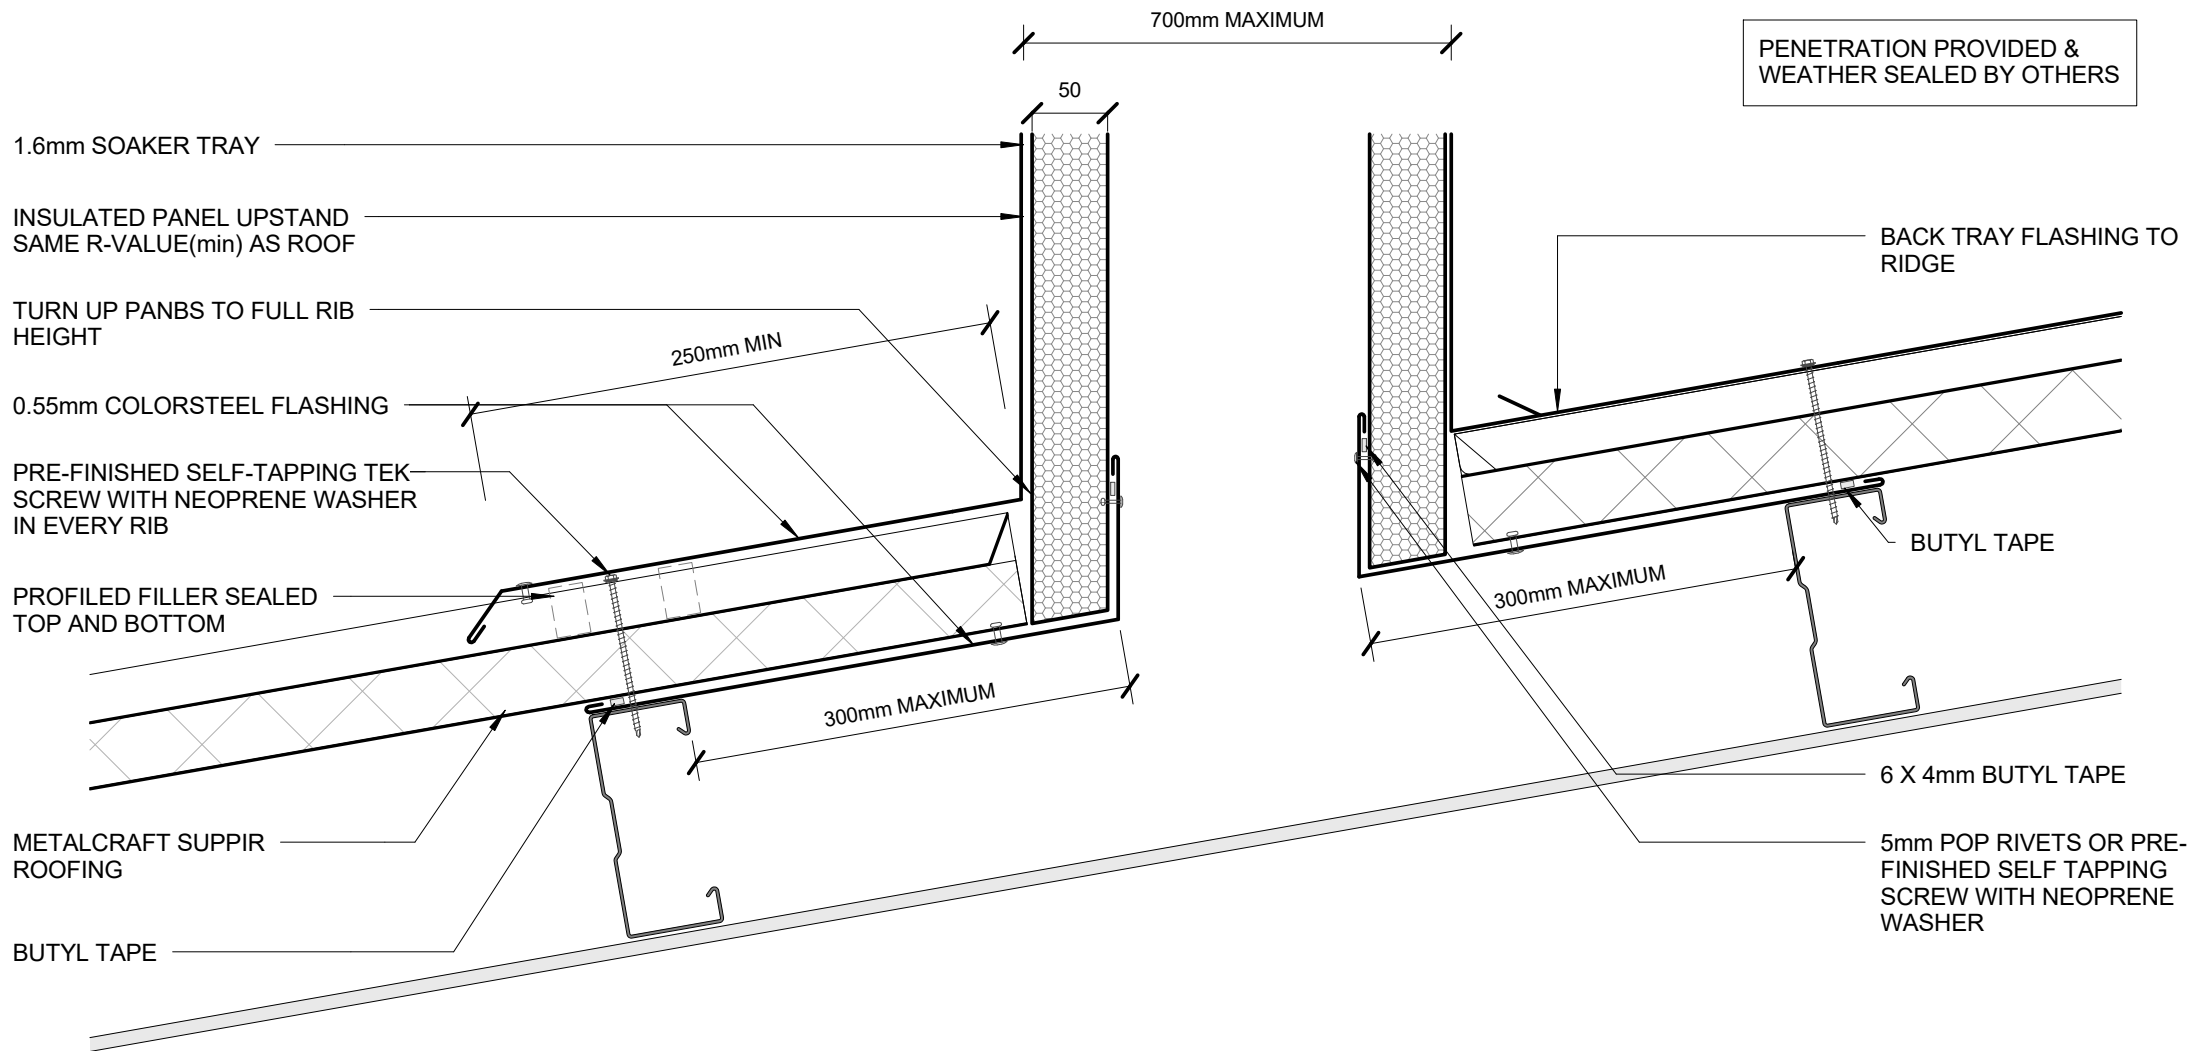



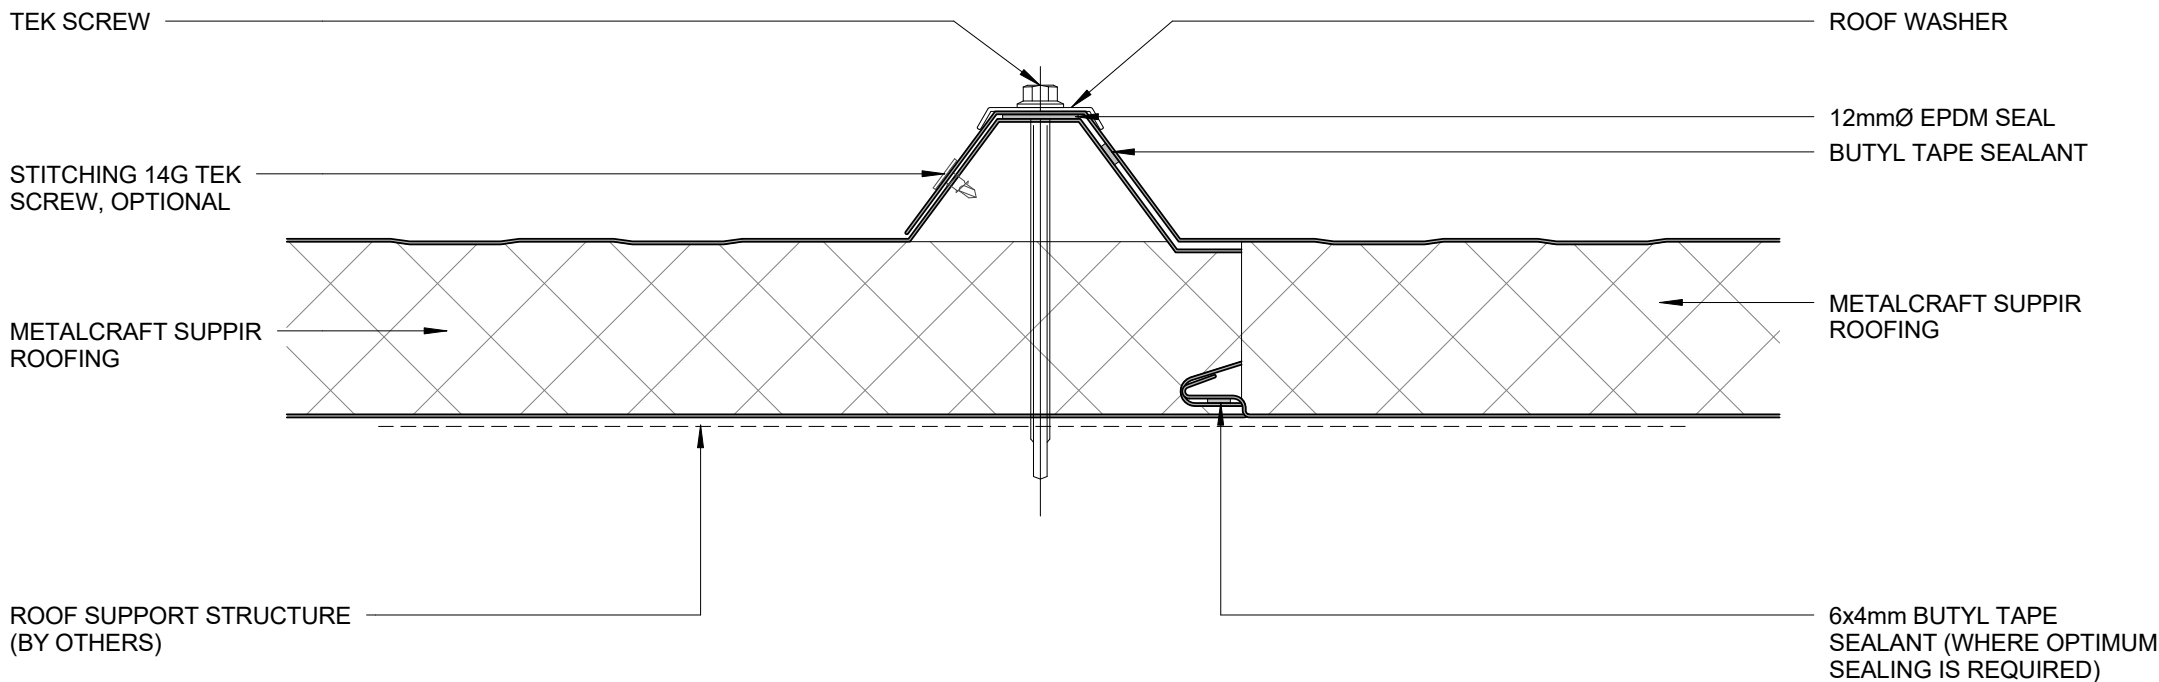


**SIDE LAP DETAIL**  
**COMMERCIAL ROOFING**

SUPPIR HEAD BARGE FLASHING

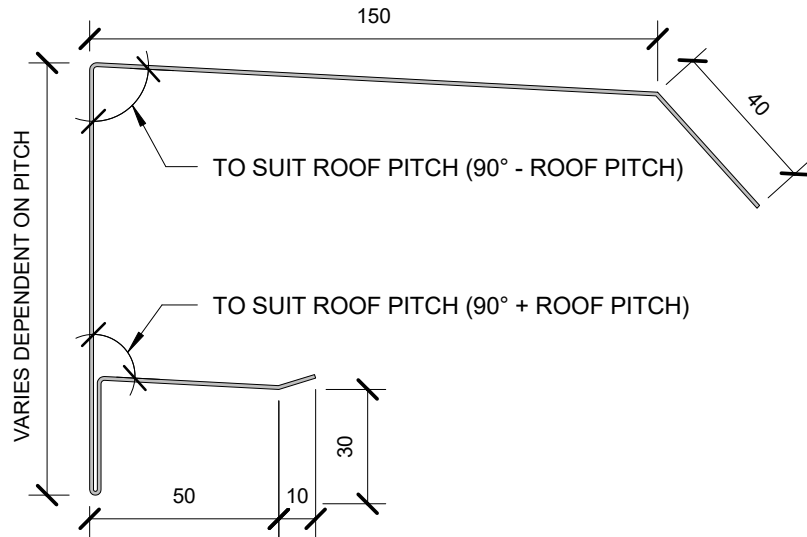

SUPPIR FACIA FLASHING

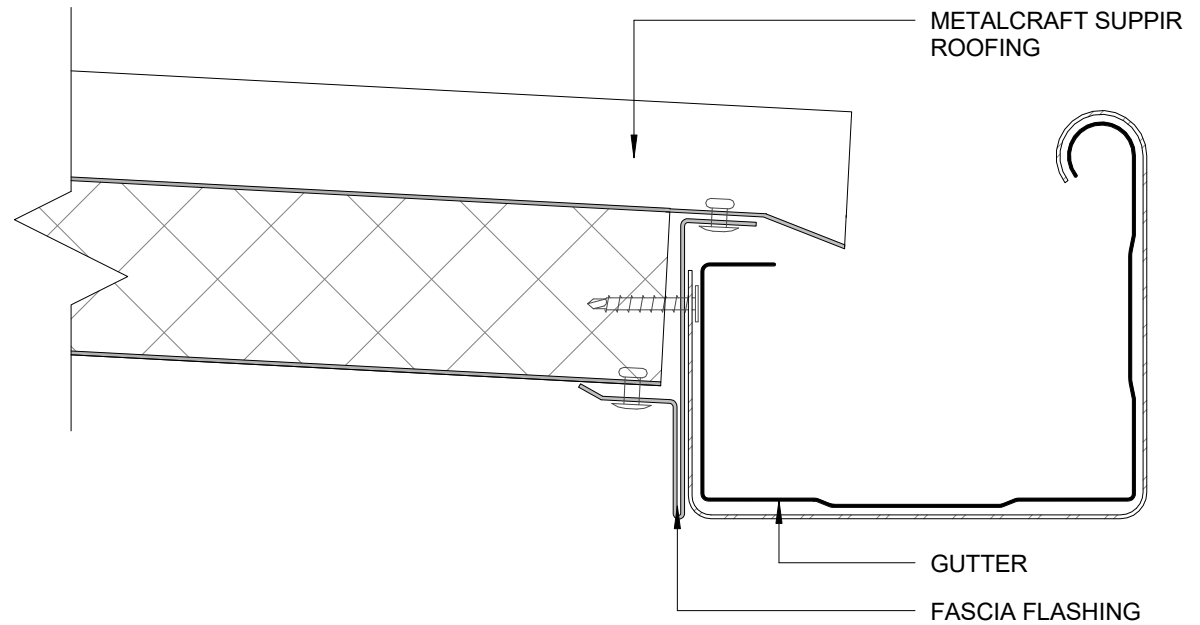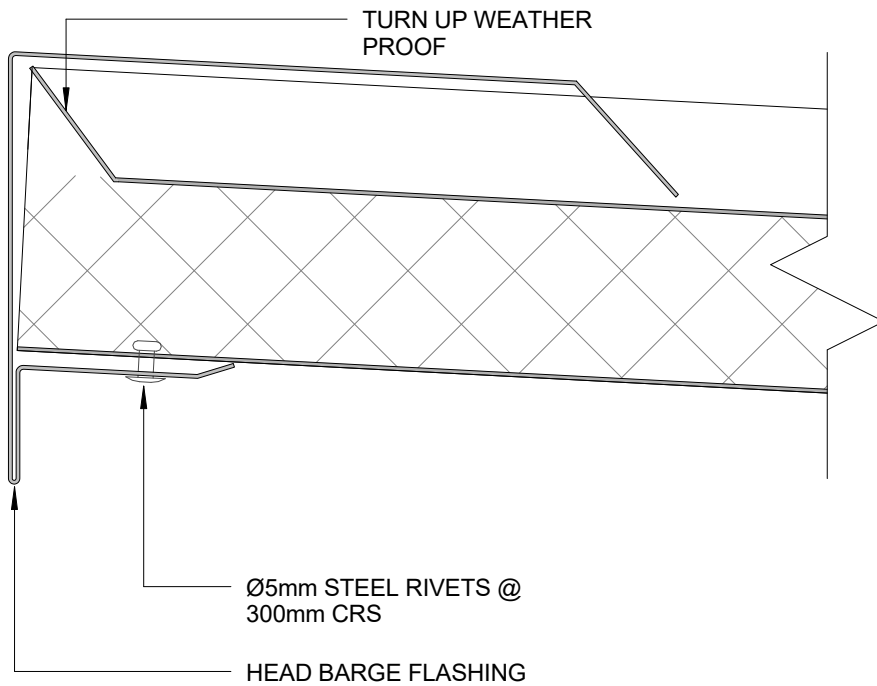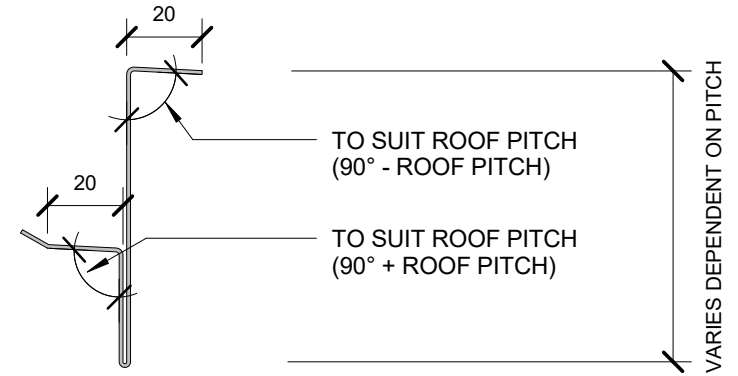

FASCIA AND BARGE FLASHING DIMENSIONS

suPIR span

Rev. 1.0

COMMERCIAL ROOFING

Reference CRSUP


Date 14.2020

Scale 1 : 2


Sheet

13 / 15

SUPPIR SIDE BARGE

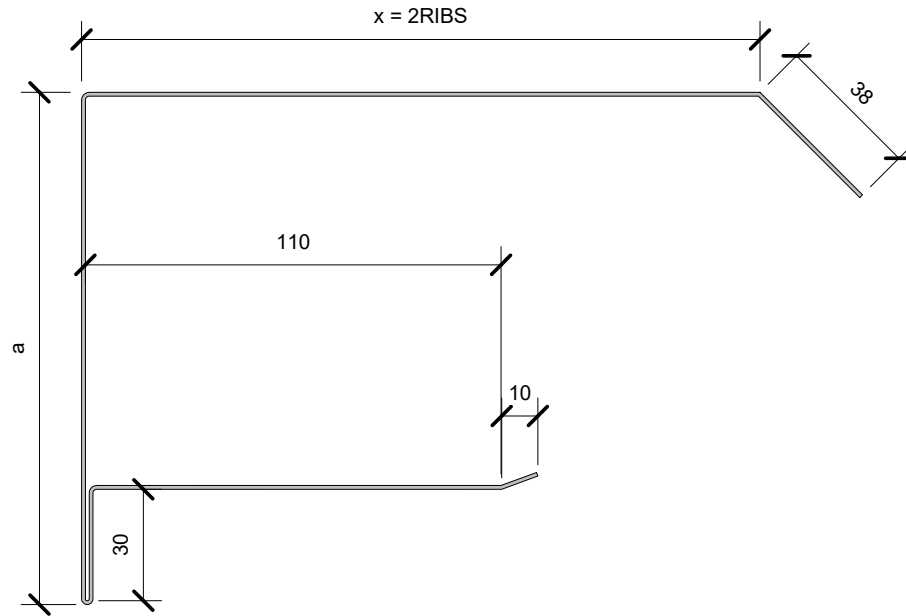


SIDE BARGE	
Thermospan thickness	Flashing Height (a)
50mm	115mm
75mm	140mm
100mm	165mm
125mm	190mm
150mm	215mm
200mm	265mm
250mm	315mm

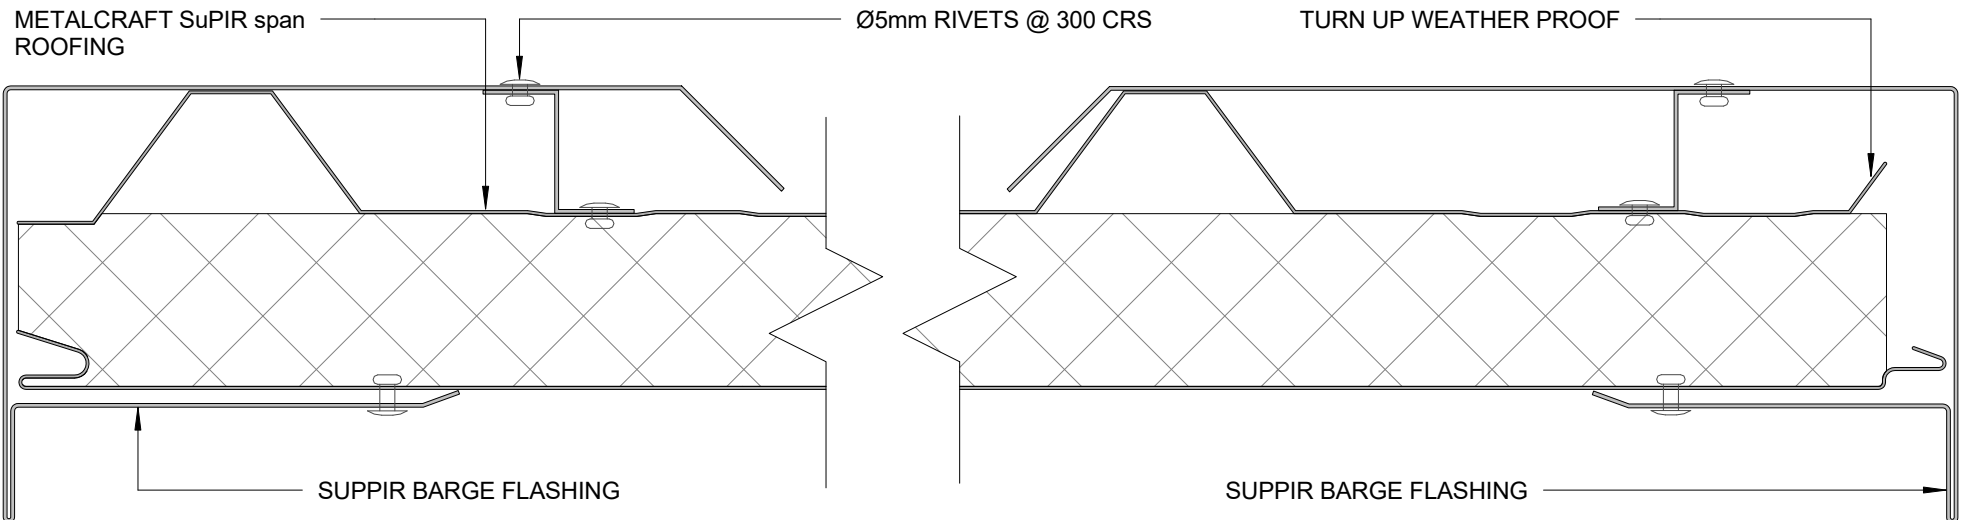

**SUPPIR-PIR CORE**

A = 50, 75, 100,  
125, 150, 200, 250

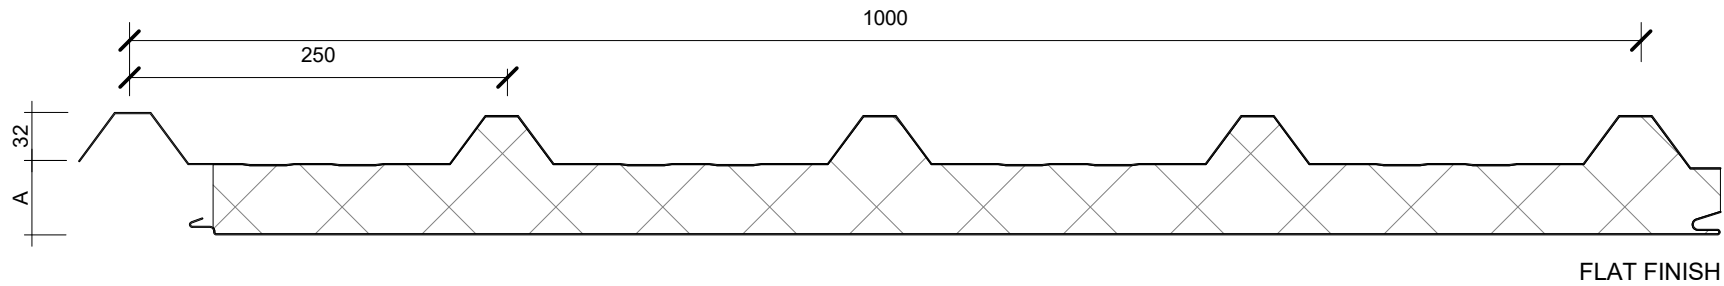

SCALE @ 1:5


**INTERNAL LINER FINISHES**

SCALE @ 1:2

SILKLINE FINISH



MESA FINISH

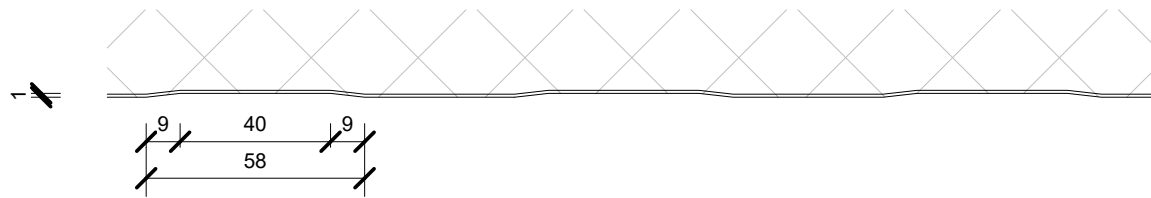

RIBBED FINISH

