

RESIDENTIAL TRIMRIB® ROOFING

RESIDENTIAL TRIMRIB® SHEET LIST

Detail Number: RI-RTR-00A

Date drawn: 16/12/2024

Scale: @ A3


RESIDENTIAL TRIMRIB ROOFING SHEET LIST		
Sheet Number	Type	Sheet Name
RI-RTR-00A	RESIDENTIAL TRIMRIB® ROOFING	RESIDENTIAL TRIMRIB® SHEET LIST
RI-RTR-00B	RESIDENTIAL TRIMRIB® ROOFING	PROFILES & ACCESSORIES
RI-RTR-00C	RESIDENTIAL TRIMRIB® ROOFING	PROFILE SUMMARY - TRIMRIB®
RI-RTR-010	RESIDENTIAL TRIMRIB® ROOFING	TYPICAL TRUSS ROOF
RI-RTR-020A	RESIDENTIAL TRIMRIB® ROOFING	TYPICAL RAFTER / SLOPING CEILING ROOF
RI-RTR-020B	RESIDENTIAL TRIMRIB® ROOFING	TYPICAL EXPOSED RAFTER ROOF
RI-RTR-030	RESIDENTIAL TRIMRIB® ROOFING	BARGE DETAIL
RI-RTR-040	RESIDENTIAL TRIMRIB® ROOFING	HEAD BARGE DETAIL
RI-RTR-050	RESIDENTIAL TRIMRIB® ROOFING	CHANGE IN PITCH
RI-RTR-060	RESIDENTIAL TRIMRIB® ROOFING	EAVES FLASHING
RI-RTR-070A	RESIDENTIAL TRIMRIB® ROOFING	RIDGE AND HIP FLASHING (ROLL TOP)
RI-RTR-070B	RESIDENTIAL TRIMRIB® ROOFING	RIDGE AND HIP FLASHING (SQUARE TOP)
RI-RTR-080	RESIDENTIAL TRIMRIB® ROOFING	VALLEY DETAIL
RI-RTR-090	RESIDENTIAL TRIMRIB® ROOFING	INTERNAL GUTTER
RI-RTR-100	RESIDENTIAL TRIMRIB® ROOFING	RIDGE - HIP FLASHING DETAIL
RI-RTR-110A	RESIDENTIAL TRIMRIB® ROOFING	PARALLEL APRON FLASHING (HORIZ RIBLINE ON CAVITY)
RI-RTR-110B	RESIDENTIAL TRIMRIB® ROOFING	PARALLEL APRON FLASHING (NON CAVITY)
RI-RTR-110C	RESIDENTIAL TRIMRIB® ROOFING	PARALLEL APRON 2 PIECE FLASHING (CAVITY)
RI-RTR-110D	RESIDENTIAL TRIMRIB® ROOFING	PARALLEL APRON FLASHING (CAVITY)
RI-RTR-120A	RESIDENTIAL TRIMRIB® ROOFING	APRON FLASHING (NON CAVITY)
RI-RTR-120B	RESIDENTIAL TRIMRIB® ROOFING	APRON FLASHING (CAVITY)
RI-RTR-120C	RESIDENTIAL TRIMRIB® ROOFING	APRON FLASHING (HORIZ RIBLINE ON CAVITY)
RI-RTR-130B	RESIDENTIAL TRIMRIB® ROOFING	APRON 2 PIECE FLASHING (CAVITY)
RI-RTR-140A	RESIDENTIAL TRIMRIB® ROOFING	PARALLEL HIDDEN GUTTER (NON CAVITY)
RI-RTR-140B	RESIDENTIAL TRIMRIB® ROOFING	PARALLEL HIDDEN GUTTER (CAVITY)
RI-RTR-140C	RESIDENTIAL TRIMRIB® ROOFING	PARALLEL HIDDEN 2 PIECE GUTTER (CAVITY)
RI-RTR-150	RESIDENTIAL TRIMRIB® ROOFING	MANSARD / EXTERNAL CHANGE IN PITCH FLASHING
RI-RTR-160	RESIDENTIAL TRIMRIB® ROOFING	BOOT FLASHING FOR UP TO 85mm DIA PIPE
RI-RTR-170A	RESIDENTIAL TRIMRIB® ROOFING	WATERSHED FLASHING FOR PIPE / CHIMNEY PENETRATION UP TO 500mm DIA.
RI-RTR-170B	RESIDENTIAL TRIMRIB® ROOFING	SOAKER FLASHING FOR PIPE / CHIMNEY PENETRATION (85-500mm DIA, MID ROOF)
RI-RTR-180A	RESIDENTIAL TRIMRIB® ROOFING	WATERSHED CHIMNEY FLASHING
RI-RTR-180B	RESIDENTIAL TRIMRIB® ROOFING	CHIMNEY FLASHING, MID ROOF
RI-RTR-190	RESIDENTIAL TRIMRIB® ROOFING	SKYLIGHT FLASHING
RI-RTR-200	RESIDENTIAL TRIMRIB® ROOFING	RIDGE / BARGE JUNCTION
RI-RTR-210A	RESIDENTIAL TRIMRIB® ROOFING	INTERNAL BARGE FLASHING
RI-RTR-210B	RESIDENTIAL TRIMRIB® ROOFING	INTERNAL WELDED ALUMINIUM BARGE TRANSITION FLASHING
RI-RTR-220	RESIDENTIAL TRIMRIB® ROOFING	PARALLEL APRON DIVERTER JUNCTION
RI-RTR-230	RESIDENTIAL TRIMRIB® ROOFING	RAKING INTERNAL GUTTER
RI-RTR-240	RESIDENTIAL TRIMRIB® ROOFING	ROOFING INDUSTRIES GUTTER OPTIONS 125 BOX GUTTER & OLD GOTHIC FOR TIMBER FASCIA
RI-RTR-250	RESIDENTIAL TRIMRIB® ROOFING	ROOFING INDUSTRIES GUTTER OPTIONS QUARTER & 1/2 ROUND FOR TIMBER FASCIA






# RESIDENTIAL TRIMRIB® ROOFING PROFILES & ACCESSORIES

Detail Number: RI-RTR-00B  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A3

ROOFING INDUSTRIES  
'TRIMRIB'

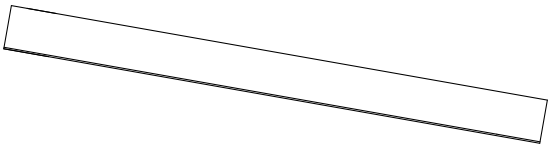


ROOFING INDUSTRIES  
BARGE FLASHING




ROOFING INDUSTRIES  
BARGE/PARAPET CAPPING


ROOFING INDUSTRIES  
CHANGE IN PITCH FLASHING

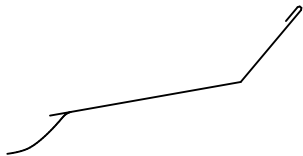


ROOFING INDUSTRIES  
GUTTER APRON FLASHING




ROOFING INDUSTRIES  
'RIBLINE'




ROOFING INDUSTRIES RIDGE  
FLASHING

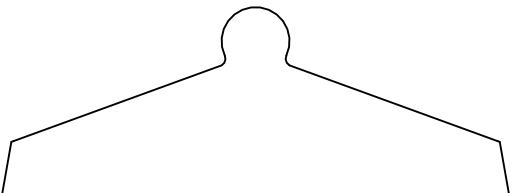

ROOFING INDUSTRIES  
APRON FLASHING




HEAD FLASHING




ROOFING INDUSTRIES  
COVER FLASHING



ROOFING INDUSTRIES  
SOFFIT FLASHING




FIXINGS

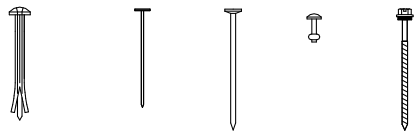


HEAD FLASHING




ALTERNATIVE HEAD  
FLASHING (OPTION 1)




ALTERNATIVE HEAD  
FLASHING (OPTION 2)



JAMB FLASHING



ALTERNATIVE JAMB  
FLASHING (OPTION 1)



ALTERNATIVE JAMB  
FLASHING (OPTION 2)



CAVITY CLOSER



METAL ANGLE




ROOFING INDUSTRIES  
METER BOX BASE FLASHING




ROOFING INDUSTRIES  
CLADDING CHANGE/JAMB  
FLASHING




SILL FLASHING




SILL FLASHING  
(OPTION 1)




ROOFING INDUSTRIES  
CORNER FLASHING




ROOFING INDUSTRIES  
INTERNAL CORNER




ROOFING INDUSTRIES  
EXTERNAL CORNER



ROOFING INDUSTRIES  
VERTICAL BUTT JOINT  
FLASHING



ROOFING INDUSTRIES  
CLADDING BASE FLASHING



Copyright detail © 2024




# RESIDENTIAL TRIMRIB® ROOFING


## PROFILE SUMMARY - TRIMRIB®

Detail Number: RI-RTR-00C  
Date drawn: 16/12/2024


### 'TRIMRIB' Lap

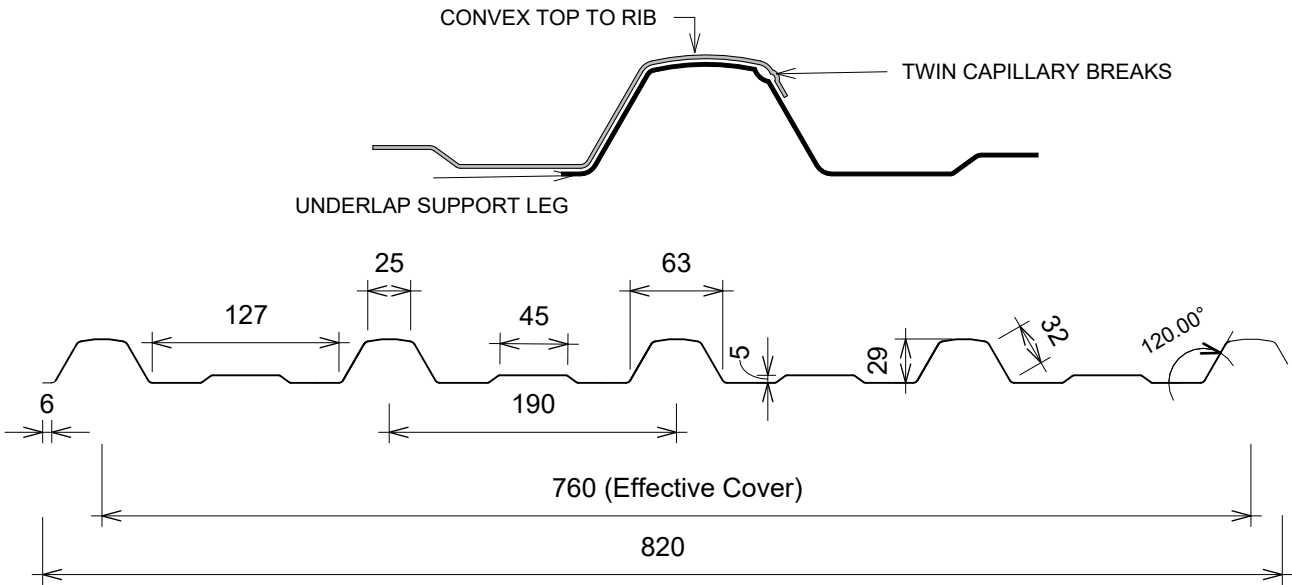

### 'TRIMRIB' S

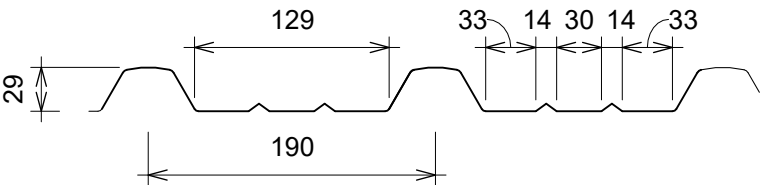

### 'TRIMRIB' V

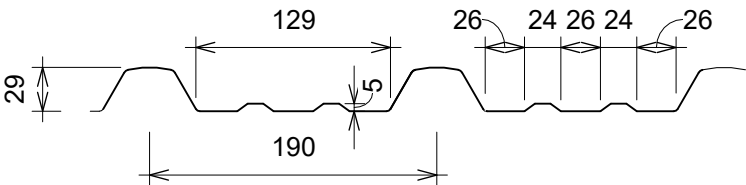

### 'TRIMRIB' TS

- GENERAL NOTES:
- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
  - The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
  - Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
  - Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
  - These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
  - This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
  - Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
  - Details are for steel-based materials, other substrates may require some changes.
  - All dimensions are nominal.
  - Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024




# RESIDENTIAL TRIMRIB® ROOFING

## TYPICAL TRUSS ROOF

Detail Number: RI-RTR-010

Date drawn: 16/12/2024

Scale: 1 : 5@ A4

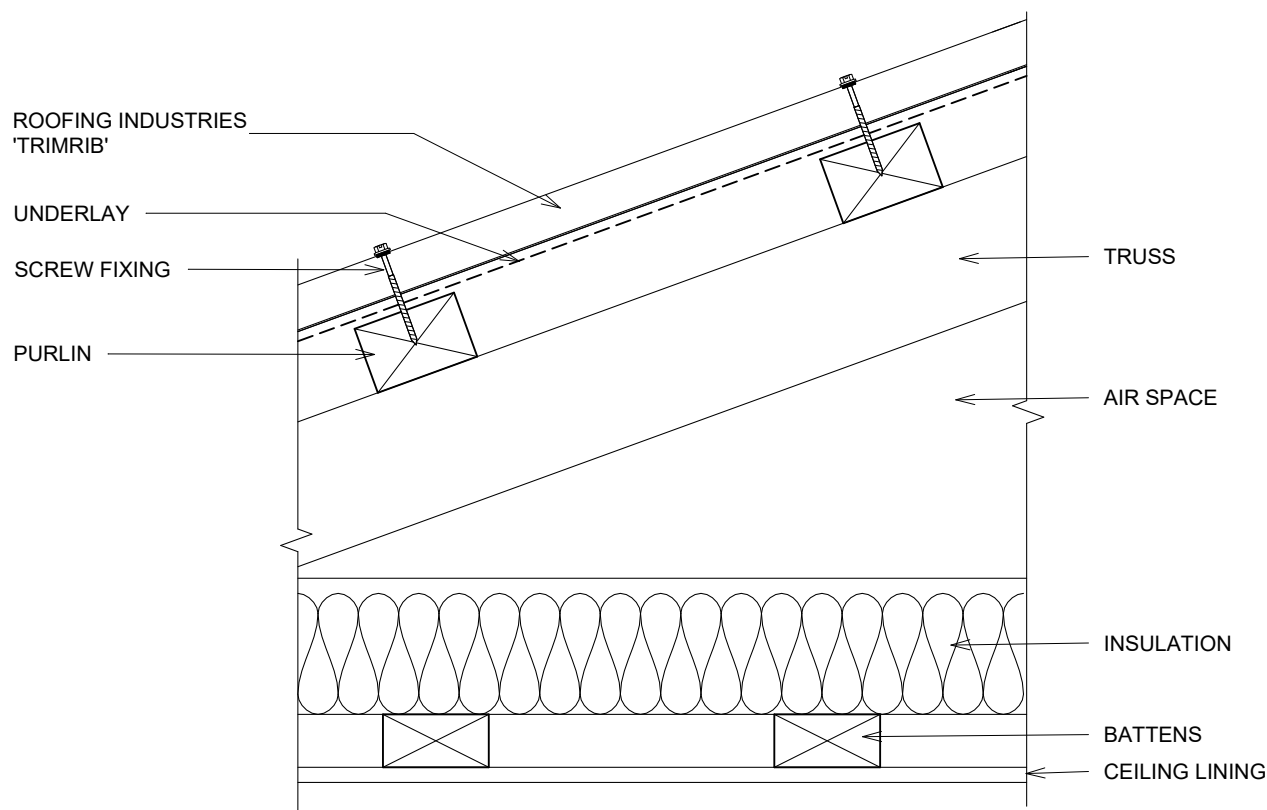

### DETAIL ANNOTATION:

1. VENTILATION OF ATTIC / ROOF SPACE MAY BE REQUIRED
2. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
3. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024




# TYPICAL RAFTER / SLOPING CEILING ROOF

Detail Number: RI-RTR-020A

Date drawn: 16/12/2024

Scale: 1 : 5@ A4

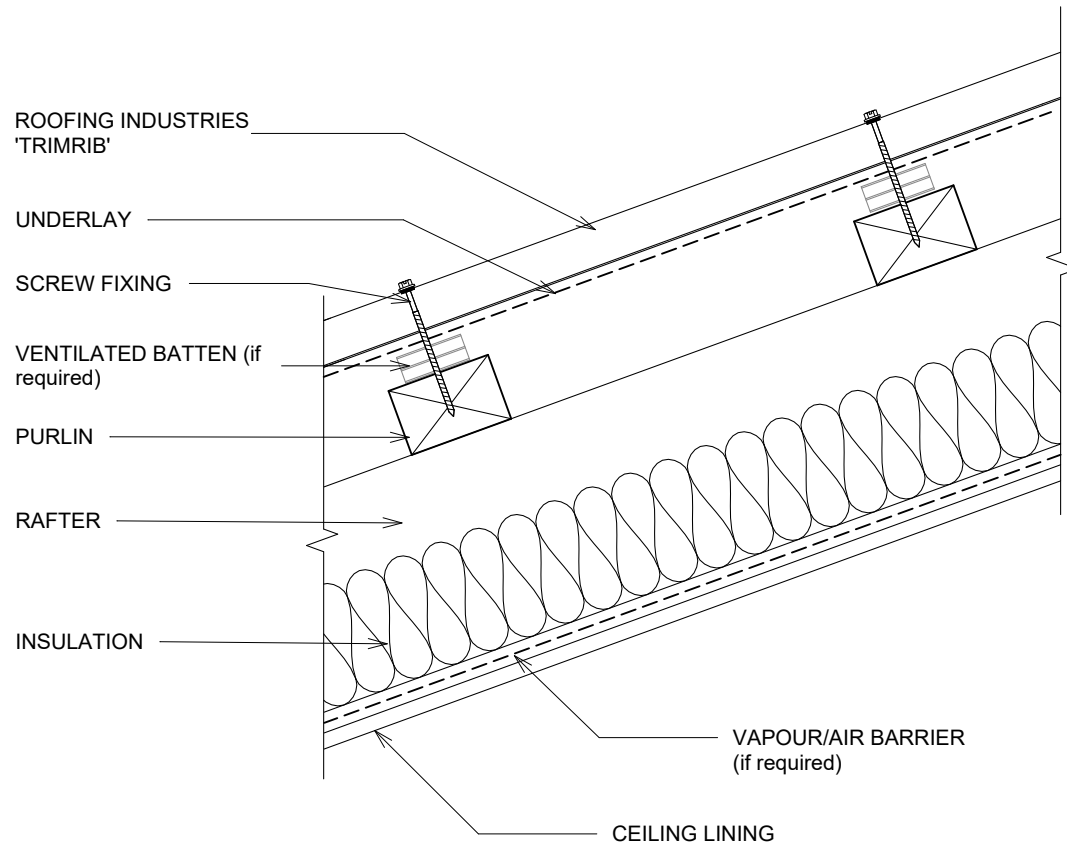

DETAIL ANNOTATION:

1. VENTILATION OF ATTIC / ROOF SPACE MAY BE REQUIRED
2. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
3. VENTILATED/CASTELLATED PURLIN MAY BE USED
4. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
5. 20mm MIN. AIR GAP BETWEEN UNDERLAY AND INSULATION

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024




# RESIDENTIAL TRIMRIB® ROOFING

## TYPICAL EXPOSED RAFTER ROOF

Detail Number: RI-RTR-020B

Date drawn: 16/12/2024

Scale: 1 : 5@ A4

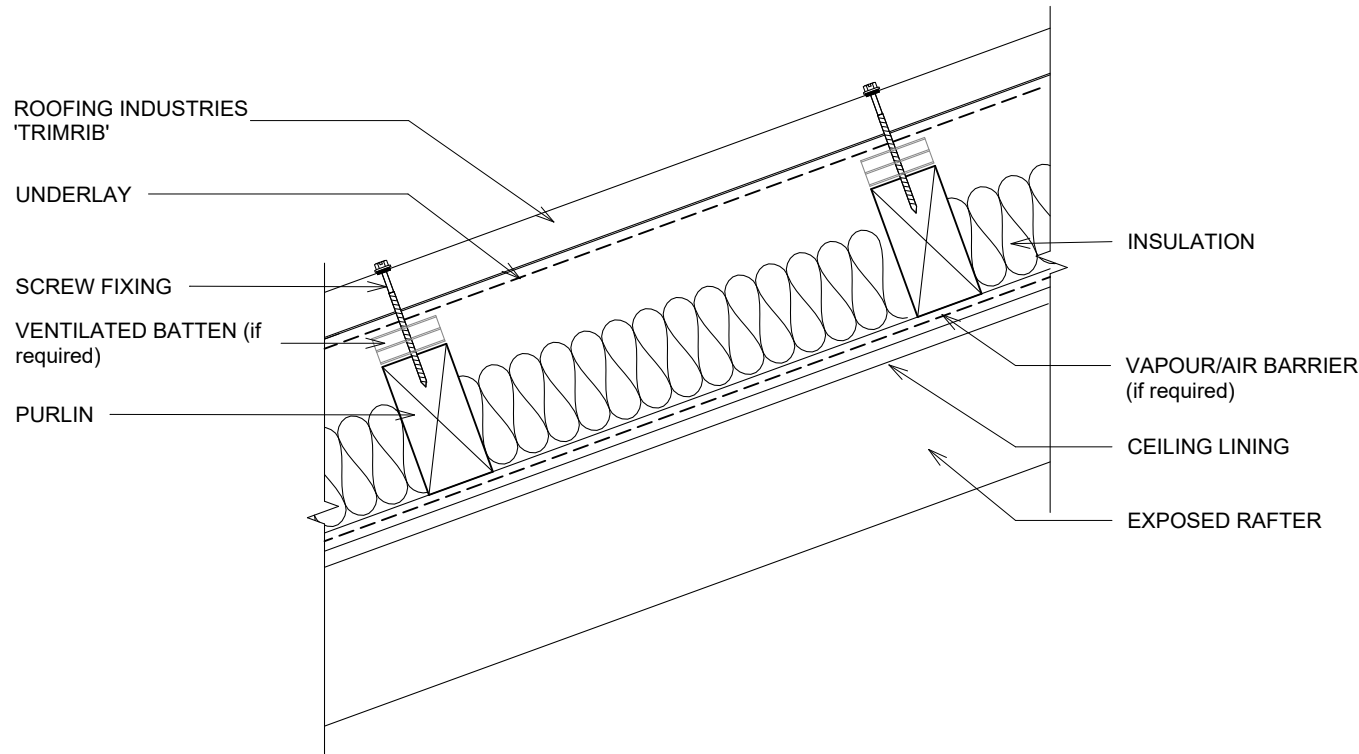

### DETAIL ANNOTATION:

1. VENTILATION OF ATTIC / ROOF SPACE MAY BE REQUIRED
2. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
3. VENTILATED/CASTELLATED PURLIN MAY BE USED
4. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
5. 20mm MIN. AIR GAP BETWEEN UNDERLAY AND INSULATION

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## BARGE DETAIL

Detail Number: RI-RTR-030  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

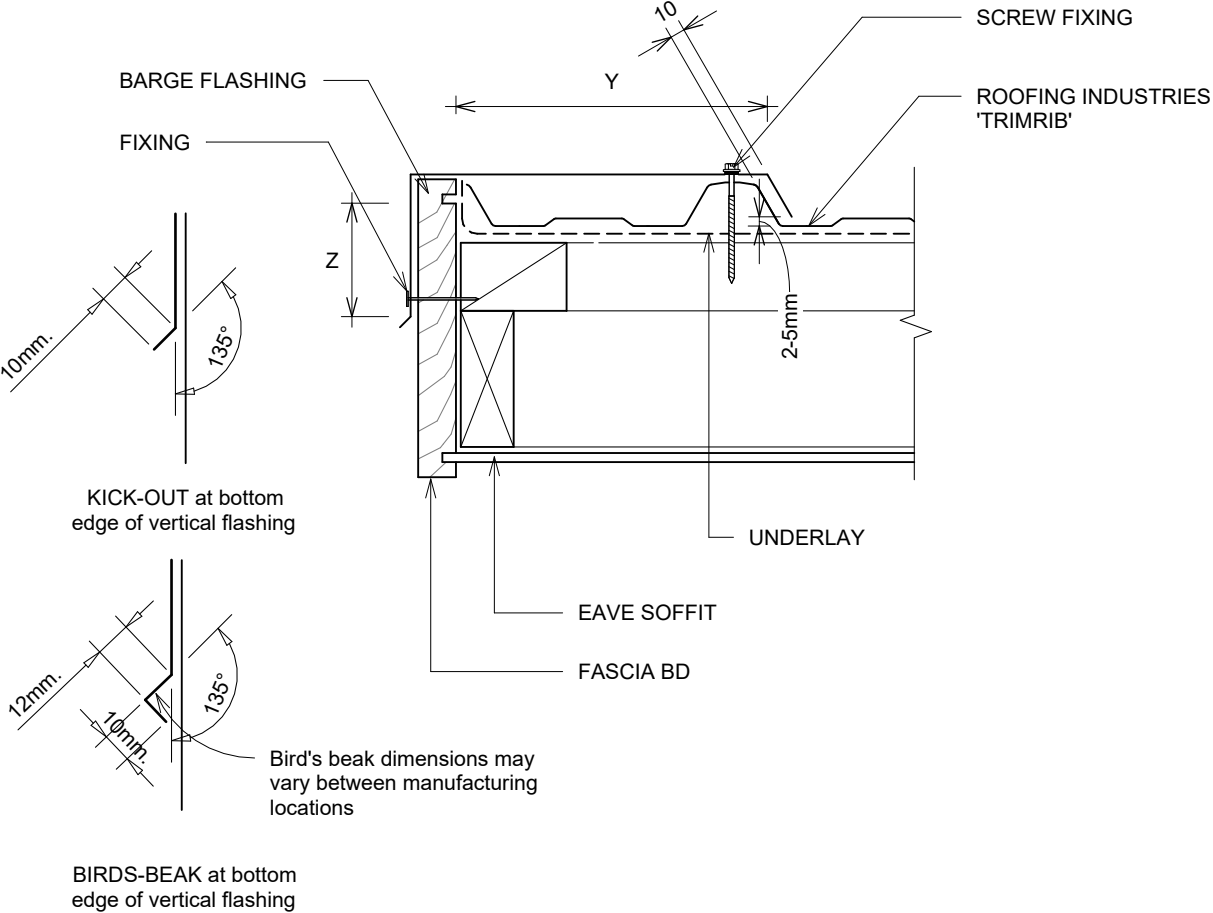

SITE WIND ZONE (As per NZS3604)	MINIMUM	
	Z <sup>(2)</sup>	Y
SITUATION 1 <sup>(1)</sup>	50mm	2 crests
SITUATION 2 <sup>(1)</sup>	70mm	2 crests
SITUATION 3 <sup>(1)</sup>	90mm	2 crests

DETAIL ANNOTATION:

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. EXCLUDING DRIP EDGE
3. INCREASE DISTANCE 'Z' BY 25mm WHEN AGAINST A PROFILED SURFACE OR TO 100mm WHICHEVER IS THE LESSER
4. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
5. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024







# RESIDENTIAL TRIMRIB® ROOFING

## HEAD BARGE DETAIL


Detail Number: RI-RTR-040  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

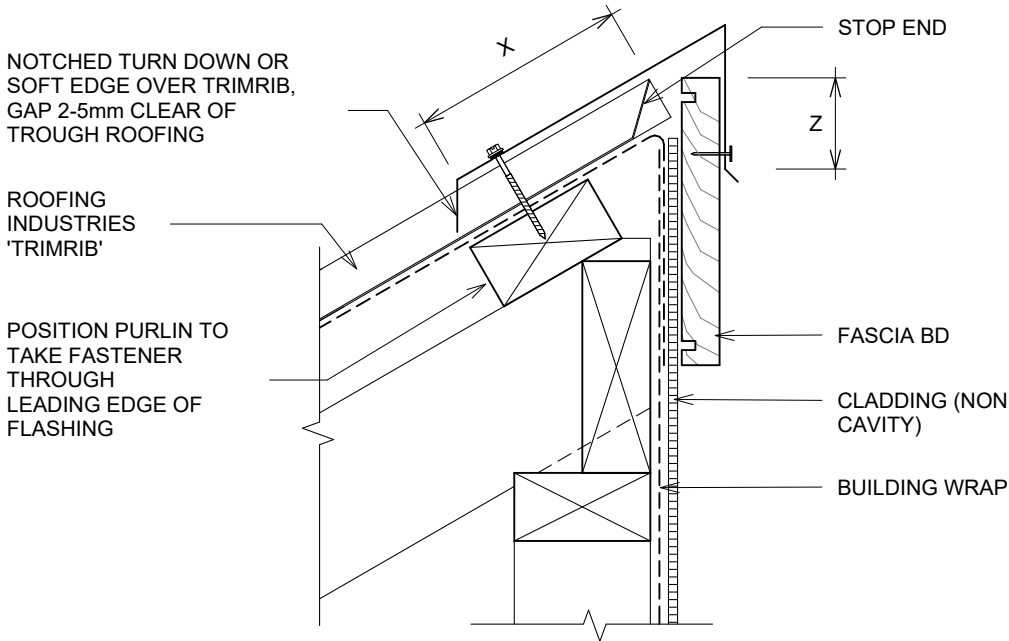

OPTION 01

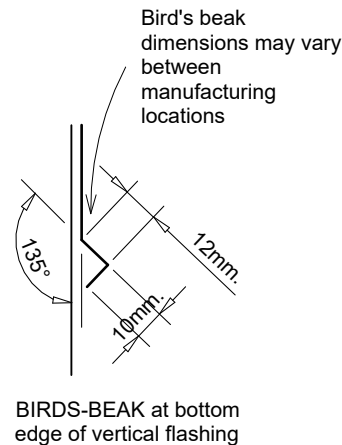

OPTION 02

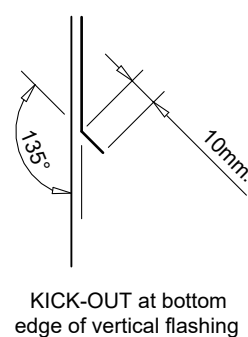

SITE WIND ZONE (As per NZS3604)	MINIMUM	
	Z <sup>(3)</sup>	X <sup>(5)</sup>
SITUATION 1 <sup>(1)</sup>	50mm	130mm
SITUATION 2 <sup>(1)</sup>	70mm	200mm
SITUATION 3 <sup>(1)</sup>	90mm	200mm

DETAIL ANNOTATION:

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. INCREASE DISTANCE 'Z' BY 25mm WHEN AGAINST A PROFILED SURFACE OR TO 100mm WHICHEVER IS THE LESSER
3. EXCLUDING DRIP EDGE
4. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
5. EXCLUDING ANY SOFT EDGE OR TURN DOWN
6. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024






# RESIDENTIAL TRIMRIB® ROOFING

## CHANGE IN PITCH

Detail Number: RI-RTR-050  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

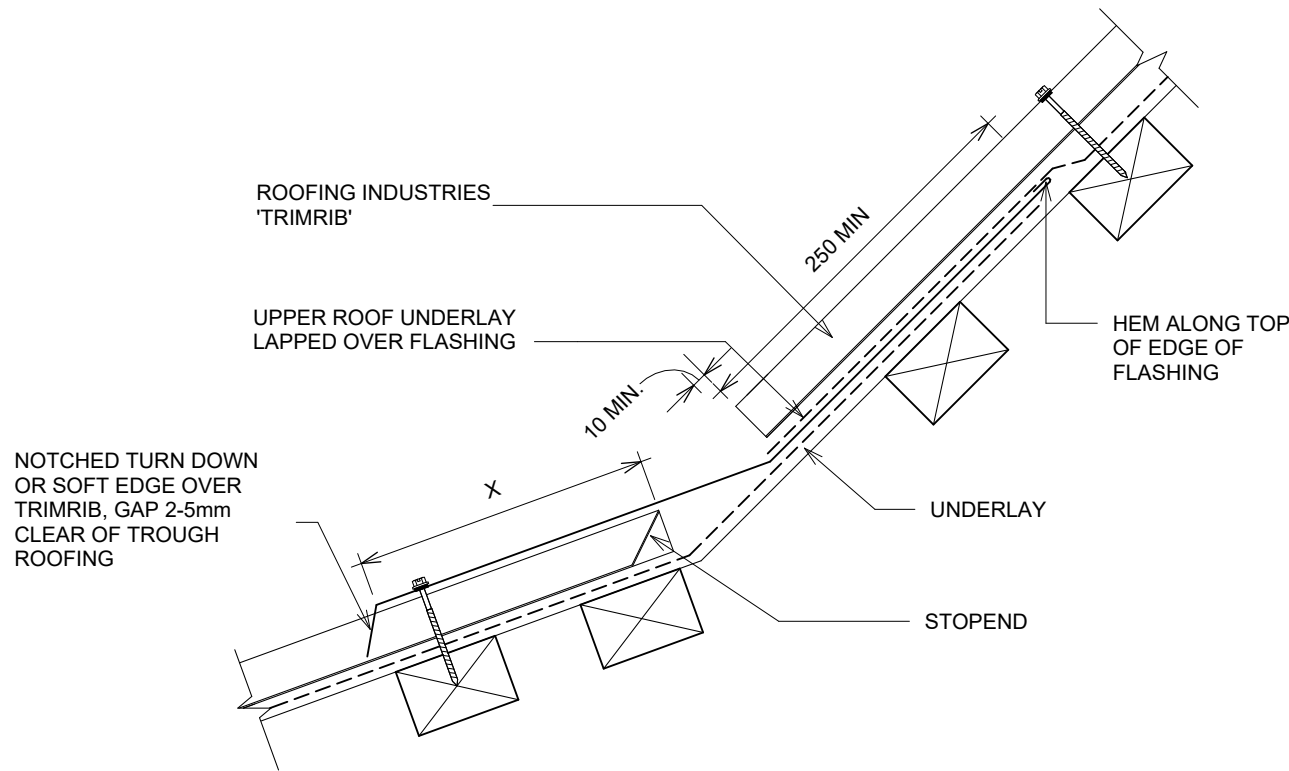

SITE WIND ZONE  (As per NZS3604)	MIN mm	X <sup>(2)</sup>
	UPPER LAP UNDER ROOFING	TRANSVERSE FLASHING OVER ROOFING
SITUATION 1 <sup>(1)</sup>	250mm	150mm
SITUATION 2 <sup>(1)</sup>	250mm	200mm
SITUATION 3 <sup>(1)</sup>	(4)	

DETAIL ANNOTATION:

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. EXCLUDING ANY SOFT EDGE OR TURN DOWN
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
4. NOT PERMITTED UNDER E2/AS1, REFER TO NZMRM METAL ROOF & WALL CLADDING CODE OF PRACTICE
5. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024




# RESIDENTIAL TRIMRIB® ROOFING

## EAVES FLASHING

Detail Number: RI-RTR-060

Date drawn: 16/12/2024

Scale: 1 : 5@ A4

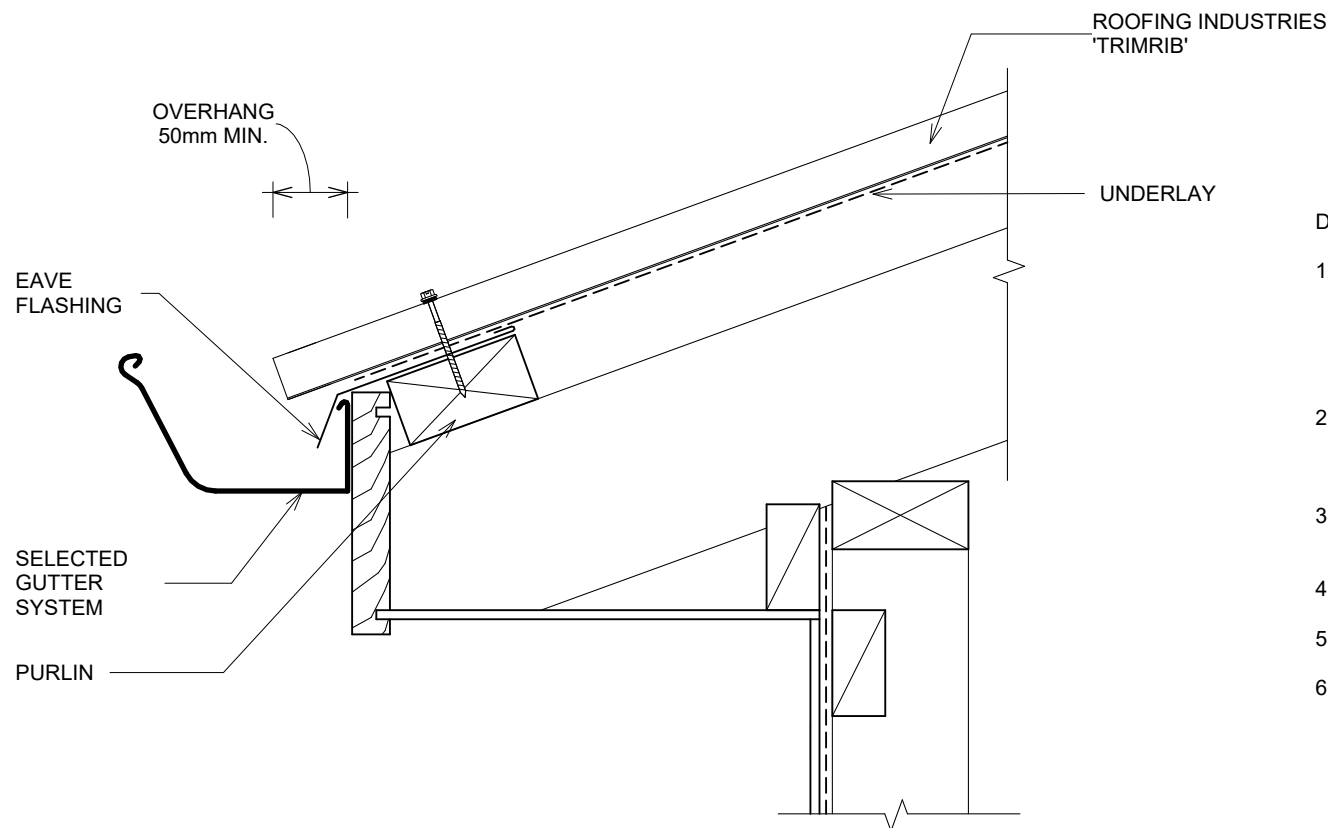

### DETAIL ANNOTATION:

1. REFER TO E2/AS1 FOR GUIDANCE AS TO WHERE THE EAVE FLASHING IS REQUIRED. DESIGNER MAY ALSO CHOOSE TO INCLUDE OPTIONALLY. ALSO RECOMMENDED IN VERY CORROSIVE ENVIRONMENTS AND WHEN SPOUTING IS LOW OR WHERE A GAP EXIST BETWEEN THE BACK OF GUTTER AND THE FASCIA BOARD
2. OVERHANG TO GUTTER WHERE THE PITCH IS BELOW 10° AND THE ENDS OF THE RIBS ARE NOT BAFFLED BY THE SPOUTING. SHALL BE INCREASED TO 70MM. REFER TO NZMRM COP
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
4. GUTTERS IN ACCORDANCE WITH NEW ZEALAND BUILDING CODE E2/AS1
5. REFER TO SECTION OF NZMRM CODE OF PRACTICE FOR CATCHMENT AREA LIMITATIONS
6. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## RIDGE AND HIP FLASHING (ROLL TOP)

Detail Number: RI-RTR-070A  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

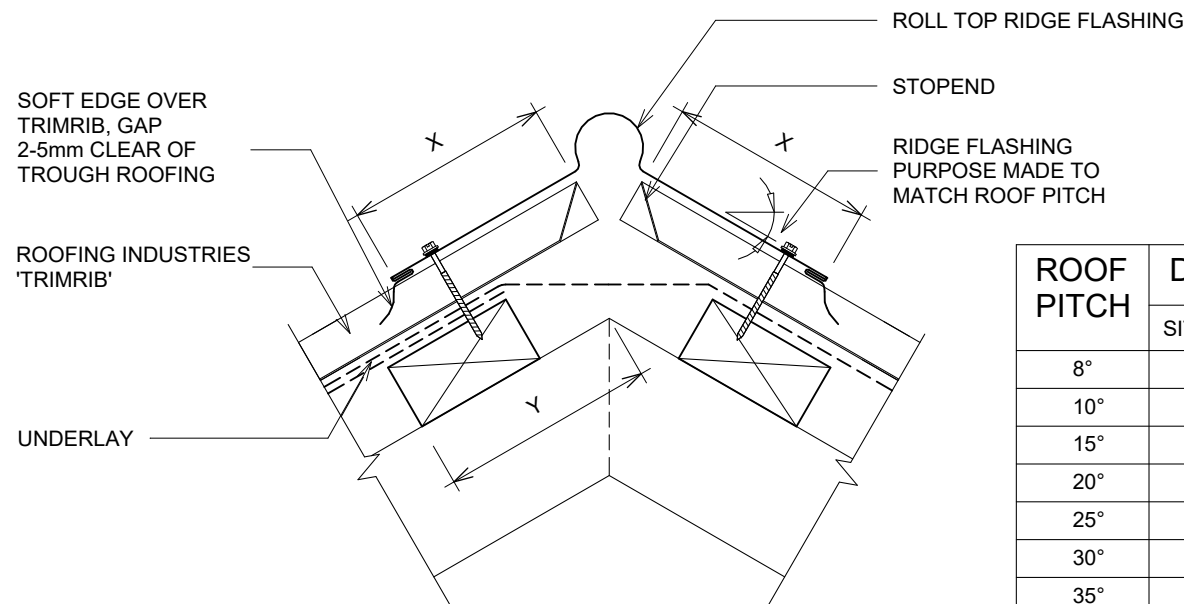

ROOF PITCH	DISTANCE Y mm	
	SITUATION 1	SITUATION 2
8°	N/A	218
10°	167	217
15°	162	212
20°	156	206
25°	150	200
30°	143	193
35°	134	184
40°	125	175
45°	115	165

FOR STANDARD 70x45mm PURLINS ON FLAT

SITE WIND ZONE (As per NZS3604)	MINIMUM mm X
	TRANSVERSE FLASHING OVER ROOFING
SITUATION 1 <sup>(1)</sup>	130 <sup>(2)</sup>
SITUATION 2 & 3 <sup>(1)</sup>	200 <sup>(2)</sup>

DETAIL ANNOTATION:

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. EXCLUDING ANY SOFT EDGE OR TURN DOWN
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
4. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
5. FOR OTHER RIDGE AND HIP FLASHINGS REFER TO NEW ZEALAND METAL ROOF & WALL CLADDING CODE OF PRACTICE OR E2/AS1
6. FOR MORE INFORMATION REGARDING VENTING AT APEX REFER TO NZMRM COP

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## RIDGE AND HIP FLASHING (SQUARE TOP)

Detail Number: RI-RTR-070B  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

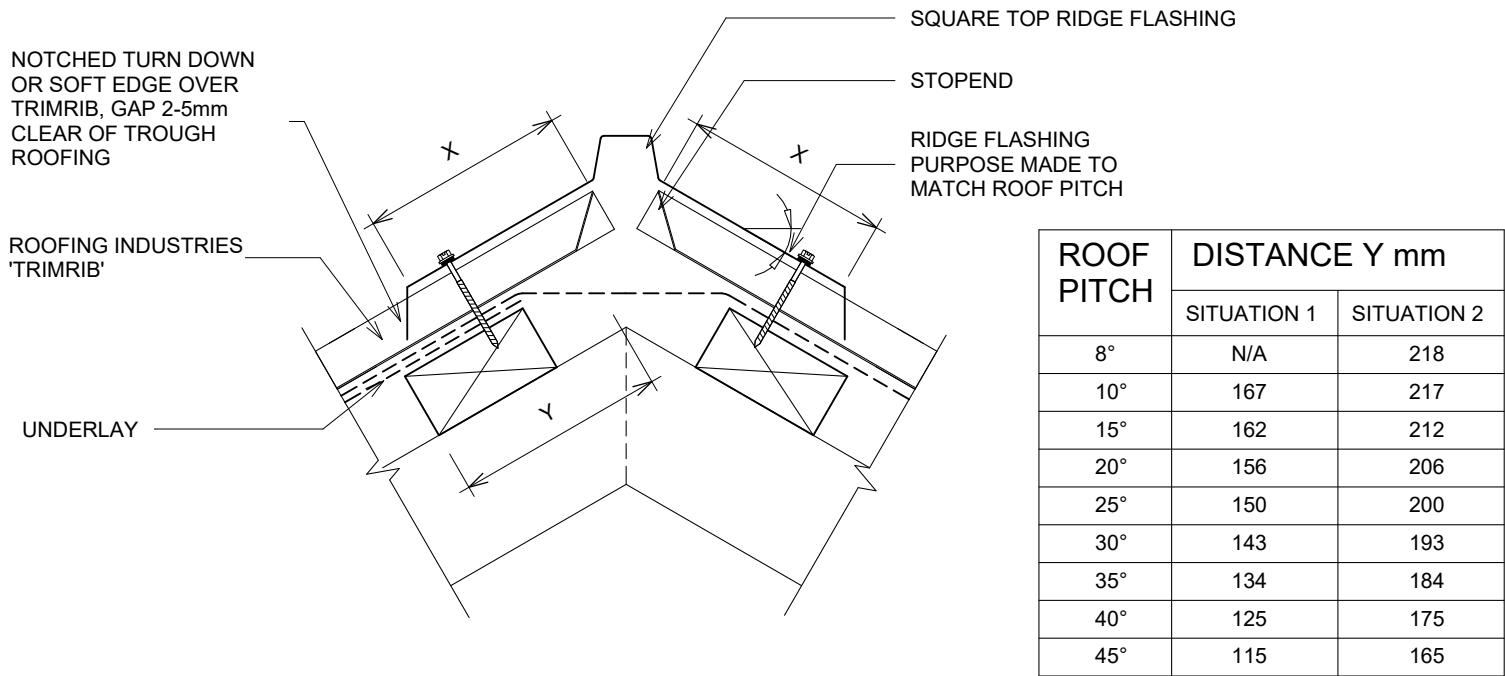

FOR STANDARD 70x45mm PURLINS ON FLAT

SITE WIND ZONE (As per NZS3604)	MINIMUM mm X
	TRANSVERSE FLASHING OVER ROOFING
SITUATION 1 <sup>(1)</sup>	130 <sup>(2)</sup>
SITUATION 2 & 3 <sup>(1)</sup>	200 <sup>(2)</sup>

DETAIL ANNOTATION:

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. EXCLUDING ANY SOFT EDGE OR TURN DOWN
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
4. FOR OTHER RIDGE AND HIP FLASHINGS REFER TO NEW ZEALAND METAL ROOF & WALL CLADDING CODE OF PRACTICE OR E2/AS1
5. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
6. FOR MORE INFORMATION REGARDING VENTING AT APEX REFER TO NZMRM COP

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## VALLEY DETAIL

Detail Number: RI-RTR-080  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

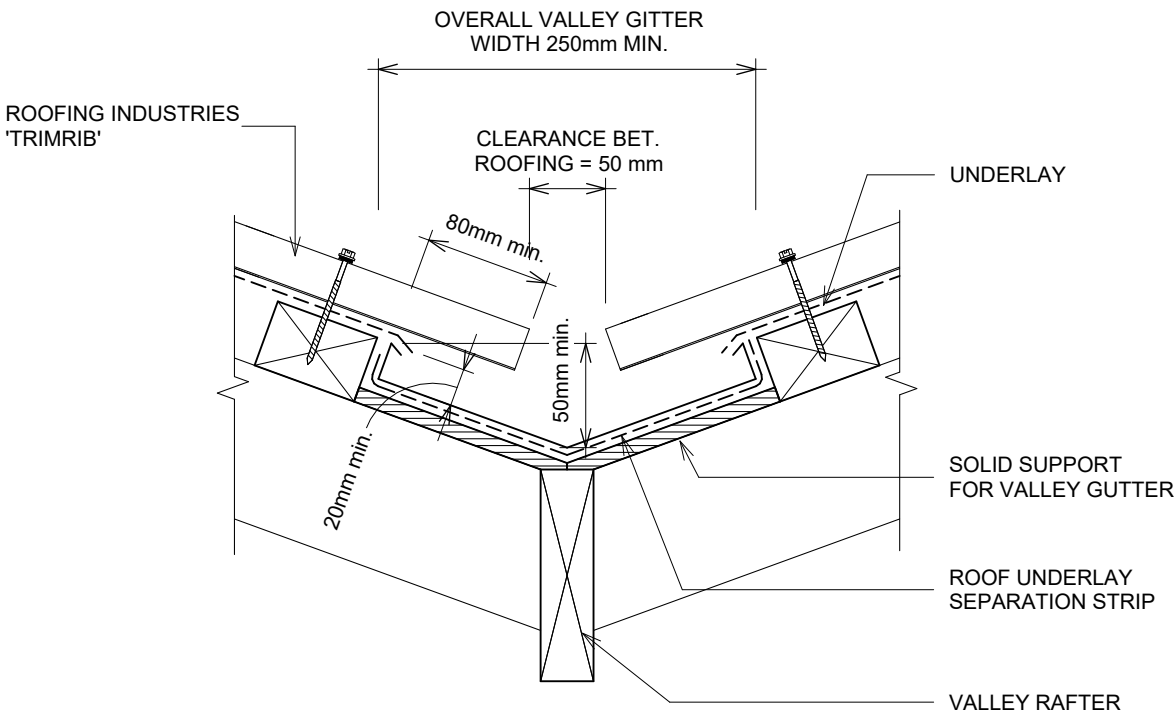

GUTTER WIDTH	MAXIMUM CATCHMENT AREA	MIN ROOF PITCH (5)
250mm	25m2	8°
160mm	16m2	12.5°

### DESIGN ANNOTATION:

1. GUTTERS IN ACCORDANCE WITH NEW ZEALAND BUILDING CODE E2/AS1
2. RAINFALL INTENSITY WITH AVERAGE RECURRENCE INTERVAL (ARI) NO GREATER THAN 200 mm PER HOUR
3. MINIMUM WIDTH OF VALLEY GUTTER MAY REDUCE TO 160mm, PROVIDING ROOF CATCHMENT AREA IS IN ACCORDANCE WITH THE TABLE ABOVE. IN THIS CASE, COVER OF ROOF CLADDING OVER GUTTER SHALL BE REDUCED TO 60 mm TO PROVIDE A CLEARANCE GAP OF 40mm. (REFER TO E2/AS1)
4. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
5. FOR ROOF PITCHES 8° OR GREATER. FOR LESSOR PITCHES USE INTERNAL GUTTER OR REFER TO MRM CODE OF PRACTICE
6. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024




# RESIDENTIAL TRIMRIB® ROOFING

## INTERNAL GUTTER

Detail Number: RI-RTR-090

Date drawn: 16/12/2024

Scale: 1 : 5@ A4

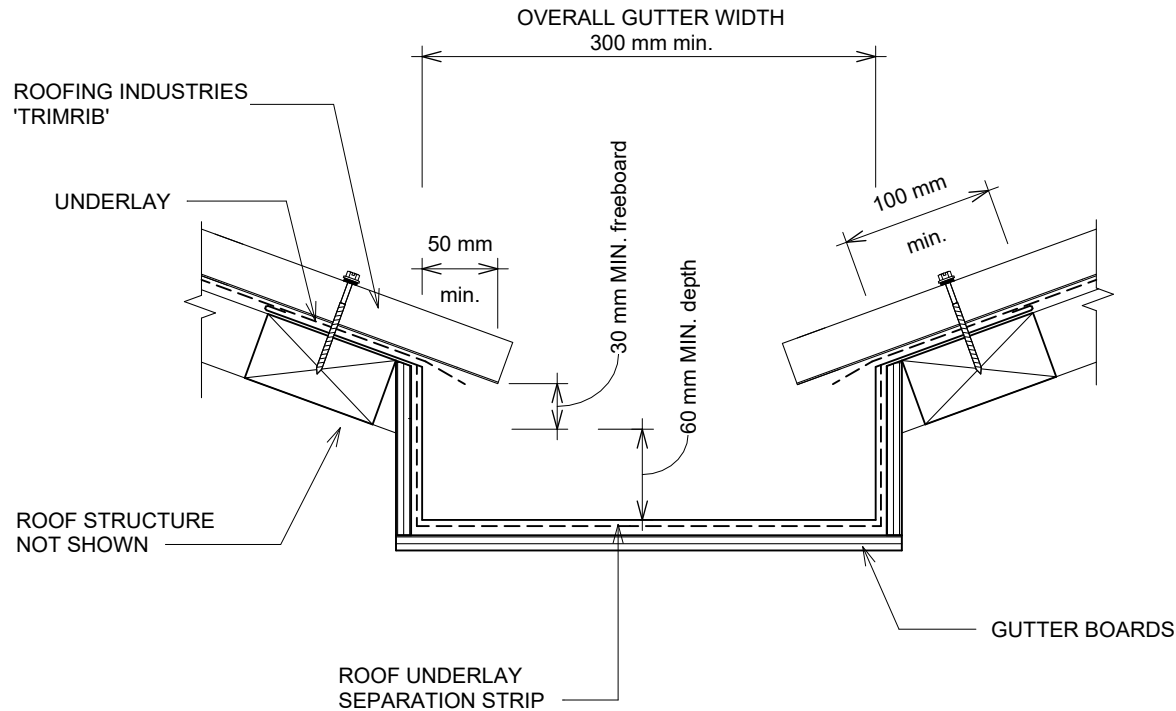

### DETAIL ANNOTATION:

1. INTERNAL GUTTER SHALL BE SIZED TO SUIT THE ROOF CATCHMENT AREA BUT SHALL BE NO LESS THAN SHOWN IN THIS FIGURE. REFER E2/AS1
2. INTERNAL GUTTER SHOULD BE MADE FROM NONFERROUS METAL'S COMPATIBLE WITH THE ROOFING MATERIAL.
3. GUTTER SIZES TO BE CALCULATED FROM E1/AS1
4. ALTERNATIVELY REFER TO MRM COP
5. ALLOW FOR SEPARATION FROM ANY CORROSIVE TIMBER TREATMENTS
6. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
7. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024






# RESIDENTIAL TRIMRIB® ROOFING

## RIDGE - HIP FLASHING DETAIL

Detail Number: RI-RTR-100  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

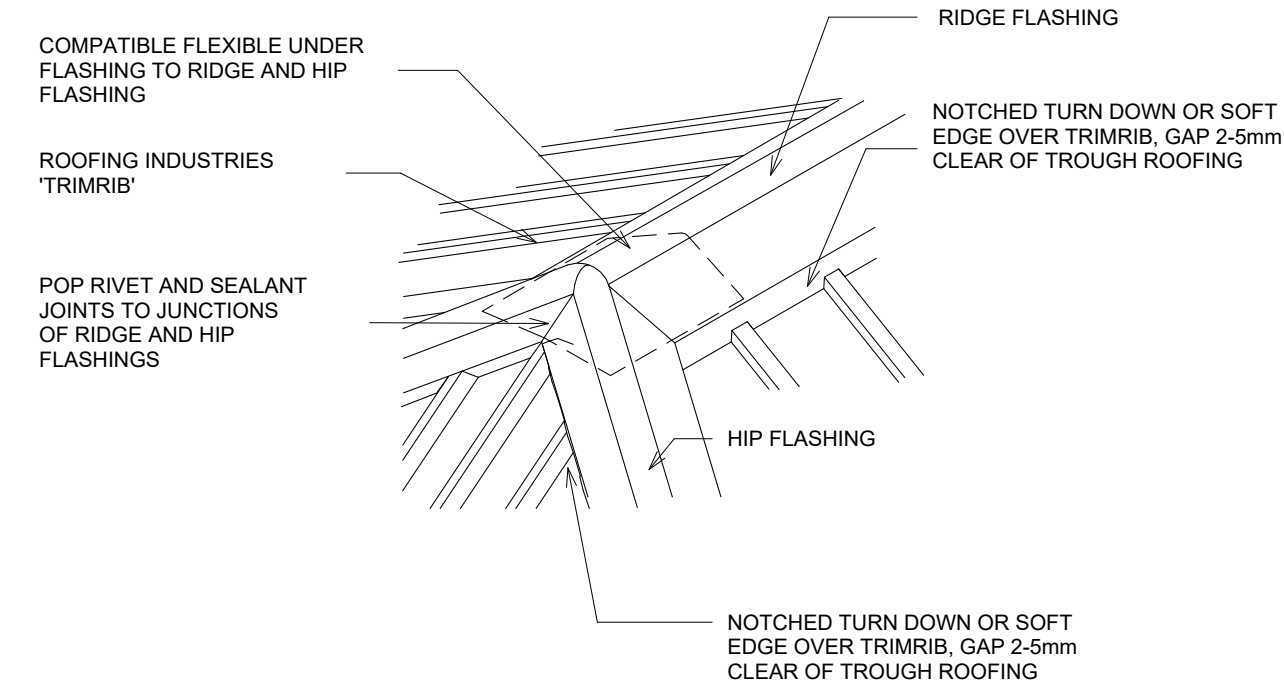

### DETAIL ANNOTATION:

FLASHING COVER VARIES (REFER TO TABLE FOR RIDGE/HIP - TRANSVERSE FLASHING OVER ROOFING)

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. FOR OTHER RIDGE TO HIP FLASHINGS REFER TO NEW ZEALAND METAL ROOF & WALL CLADDING CODE OF PRACTICE
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024






# RESIDENTIAL TRIMRIB® ROOFING

## PARALLEL APRON FLASHING (HORIZ RIBLINE ON CAVITY)

Detail Number: RI-RTR-110A  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

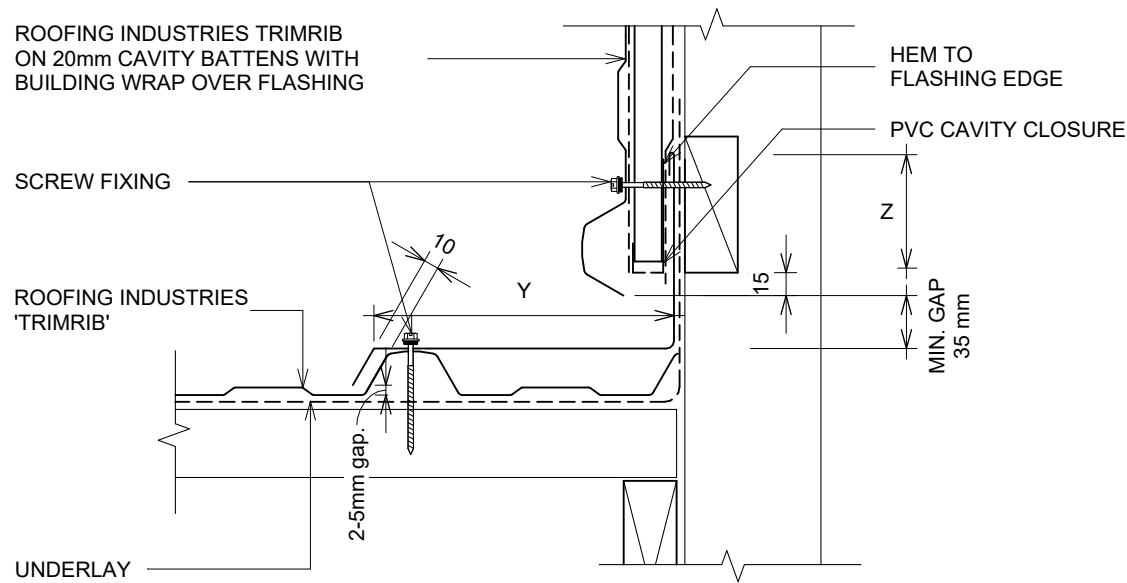

SITE WIND ZONE (As per NZS3604)	MINIMUM	
	Z	Y
SITUATION 1 & 2 <sup>(1)</sup>	75mm <sup>(1)</sup>	2 crests
SITUATION 3 <sup>(1)</sup>	90mm <sup>(1)</sup>	2 crests

### DETAIL ANNOTATION:

DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL;

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
3. ALTERNATIVELY REFER TO E2/AS1
4. CAVITY BATTENS CONTAINING CORROSIVE TREATMENTS MUST BE SEPARATED FROM METAL CLADDING BY DPC, WALL UNDERLAY, PVC OR PAINTING
5. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## PARALLEL APRON FLASHING (NON CAVITY)

Detail Number: RI-RTR-110B  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

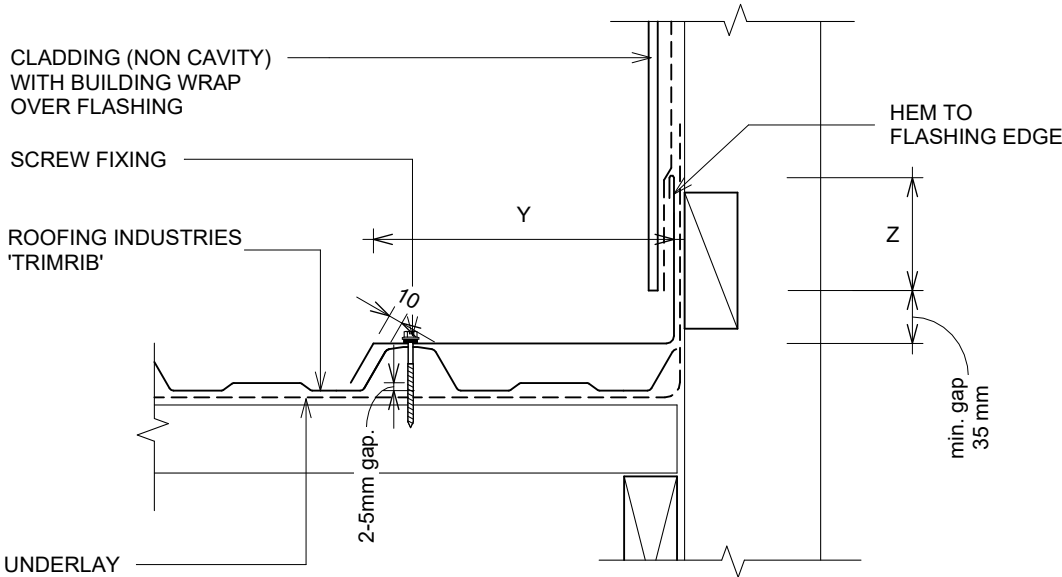

SITE WIND ZONE (As per NZS3604)	MINIMUM	
	Z	Y
SITUATION 1 & 2 <sup>(1)</sup>	75mm <sup>(1)</sup>	2 crests
SITUATION 3 <sup>(1)</sup>	90mm <sup>(1)</sup>	2 crests

DETAIL ANNOTATION:

DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL;

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
3. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## PARALLEL APRON 2 PIECE FLASHING (CAVITY)

Detail Number: RI-RTR-110C  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

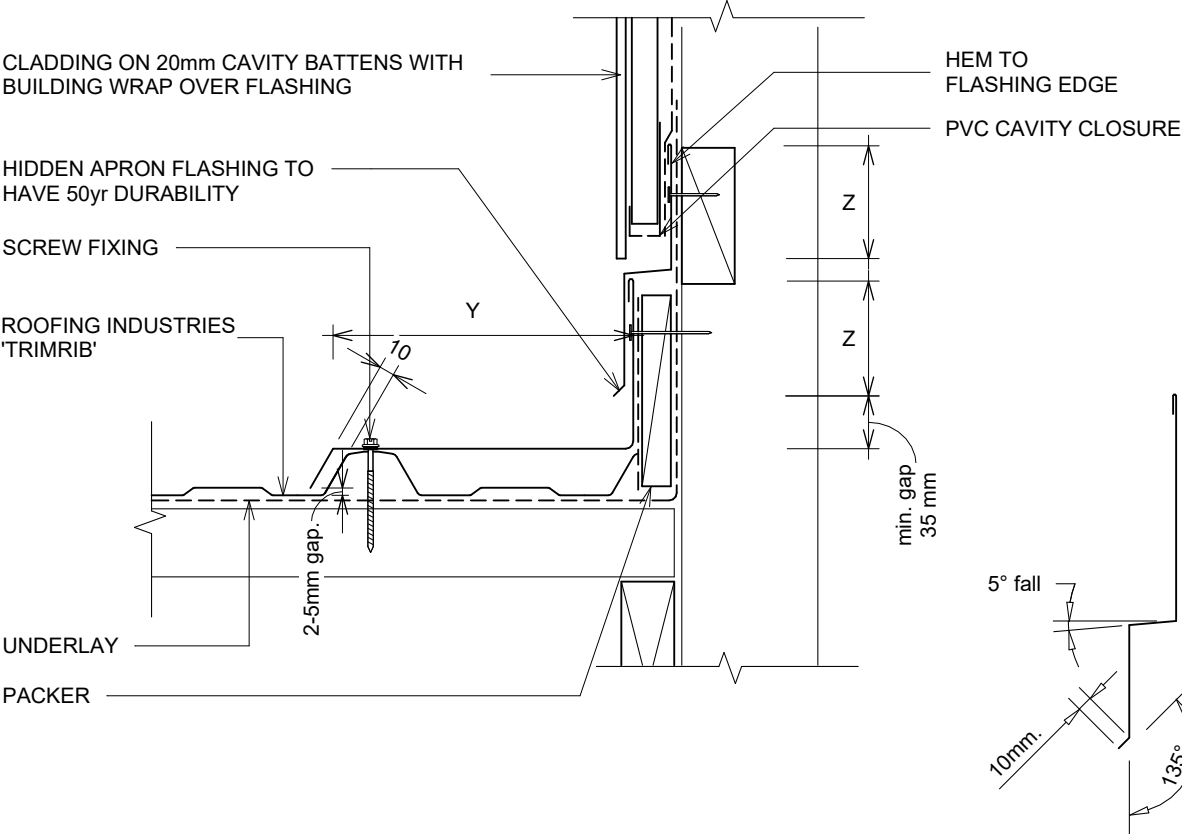

SITE WIND ZONE (As per NZS3604)	MINIMUM	
	Z	Y
SITUATION 1 & 2 <sup>(1)</sup>	75mm <sup>(1)</sup>	2 crests
SITUATION 3 <sup>(1)</sup>	90mm <sup>(1)</sup>	2 crests

DETAIL ANNOTATION:

DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL;

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. CAVITY BATTENS CONTAINING CORROSIVE TREATMENTS MUST BE SEPARATED FROM METAL CLADDING BY DPC, WALL UNDERLAY, PVC OR PAINTING
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
4. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## PARALLEL APRON FLASHING (CAVITY)

Detail Number: RI-RTR-110D  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

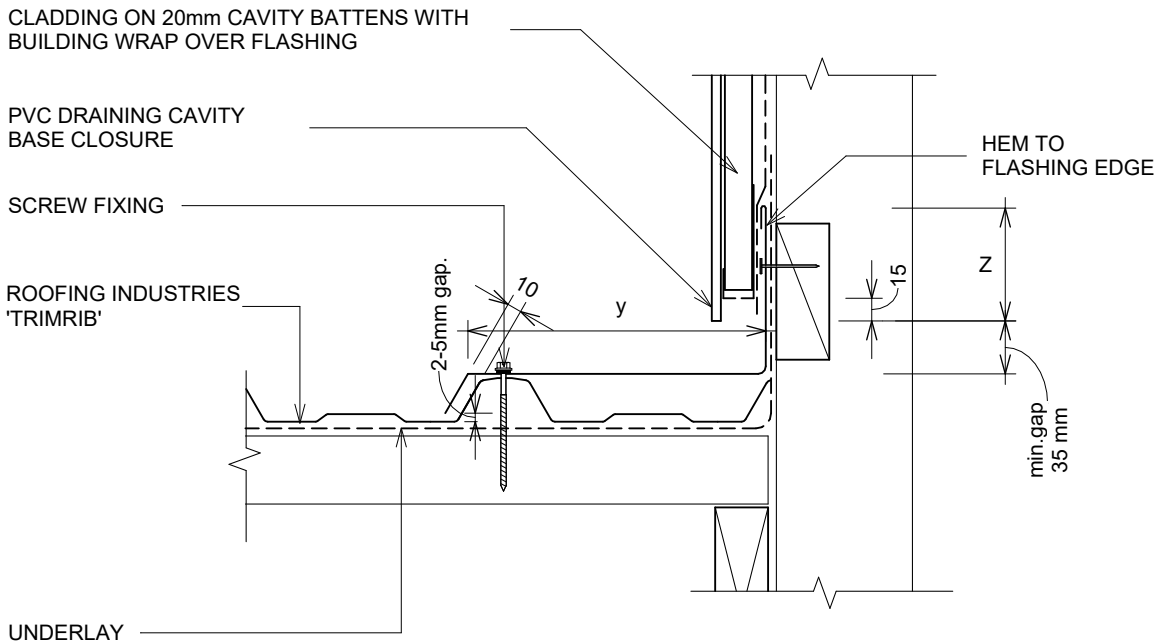

SITE WIND ZONE (As per NZS3604)	MINIMUM	
	Z	Y
SITUATION 1 & 2 <sup>(1)</sup>	75mm <sup>(1)</sup>	2 crests
SITUATION 3 <sup>(1)</sup>	90mm <sup>(1)</sup>	2 crests

### DETAIL ANNOTATION:

- DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL;
1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
  2. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
  3. CAVITY BATTENS CONTAINING CORROSIVE TREATMENTS MUST BE SEPARATED FROM METAL CLADDING BY DPC, WALL UNDERLAY, PVC OR PAINTING
  4. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## APRON FLASHING (NON CAVITY)

Detail Number: RI-RTR-120A  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

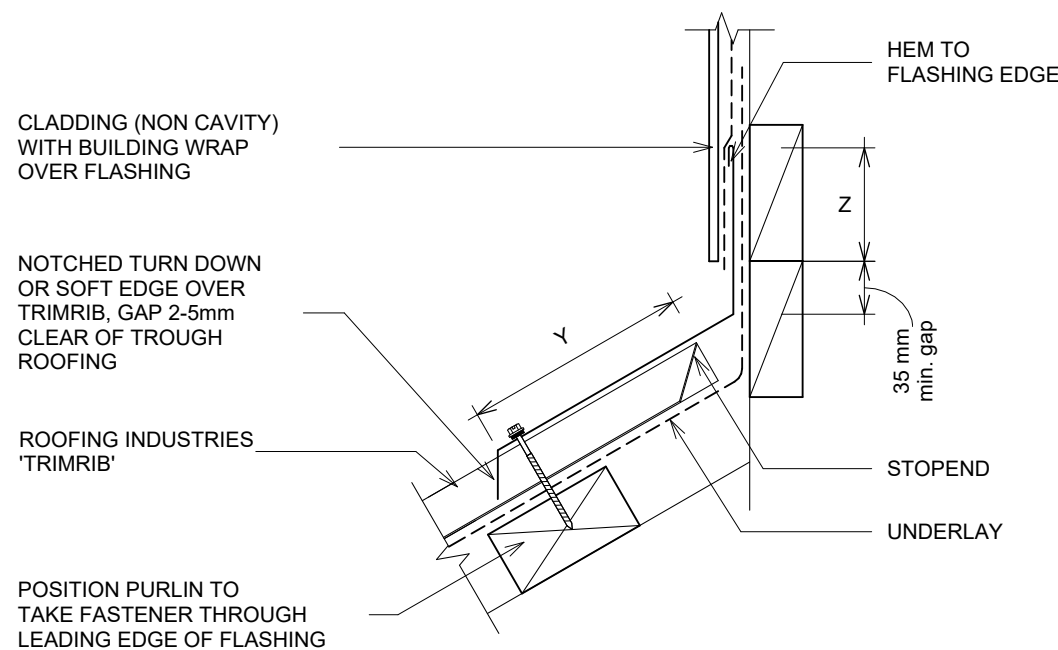

SITE WIND ZONE (As per NZS3604)	MINIMUM mm	
	Z	Y (2)
SITUATION 1	75mm	130mm
SITUATION 2	75mm	200mm
SITUATION 3	90mm	200mm

### DETAIL ANNOTATION:

- DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL;
1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
  2. EXCLUDE ANY SOFT EDGE OR TURN DOWN
  3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
  4. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
  5. FOR MORE INFORMATION ABOUT VENTING AT THE UPPER TERMINATION, REFER TO THE NZMRM COP

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## APRON FLASHING (CAVITY)

Detail Number: RI-RTR-120B  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

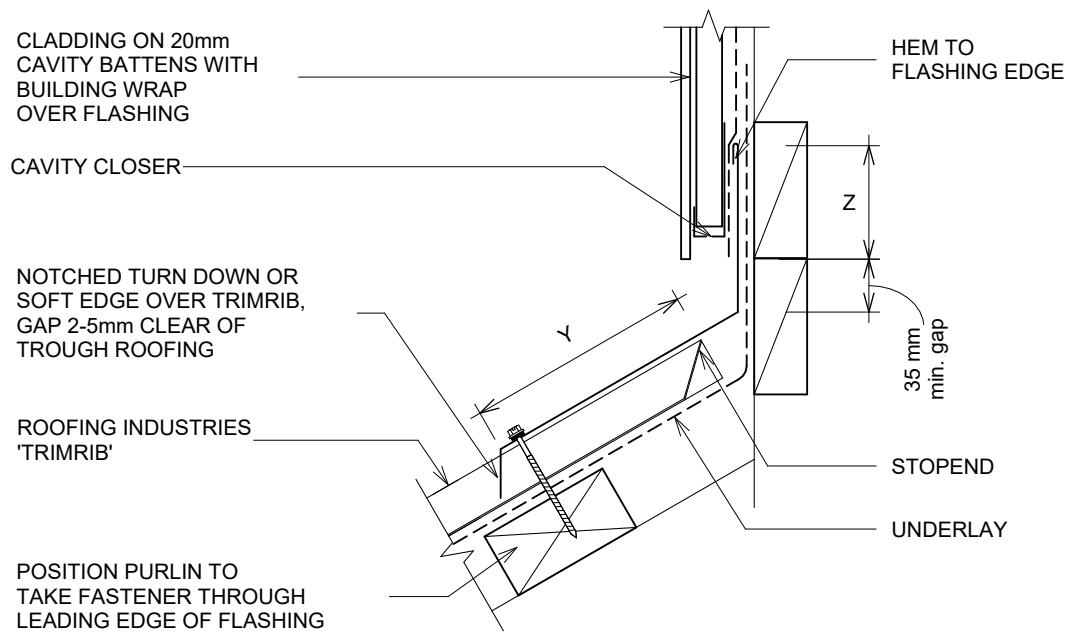

SITE WIND ZONE (As per NZS3604)	MINIMUM mm	
	Z (1)	Y (2)
SITUATION 1	75mm	130mm
SITUATION 2	75mm	200mm
SITUATION 3	90mm	200mm

DETAIL ANNOTATION:

- DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL;
1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
  2. EXCLUDES DOWNTURN
  3. CAVITY BATTENS CONTAINING CORROSIVE TREATMENTS MUST BE SEPARATED FROM METAL CLADDING BY DPC, WALL UNDERLAY, PVC OR PAINTING
  4. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
  5. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
  6. FOR MORE INFORMATION ABOUT VENTING AT THE UPPER TERMINATION, REFER TO THE NZMRM COP

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024






# RESIDENTIAL TRIMRIB® ROOFING

## APRON FLASHING (HORIZ RIBLINE ON CAVITY)

Detail Number: RI-RTR-120C  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

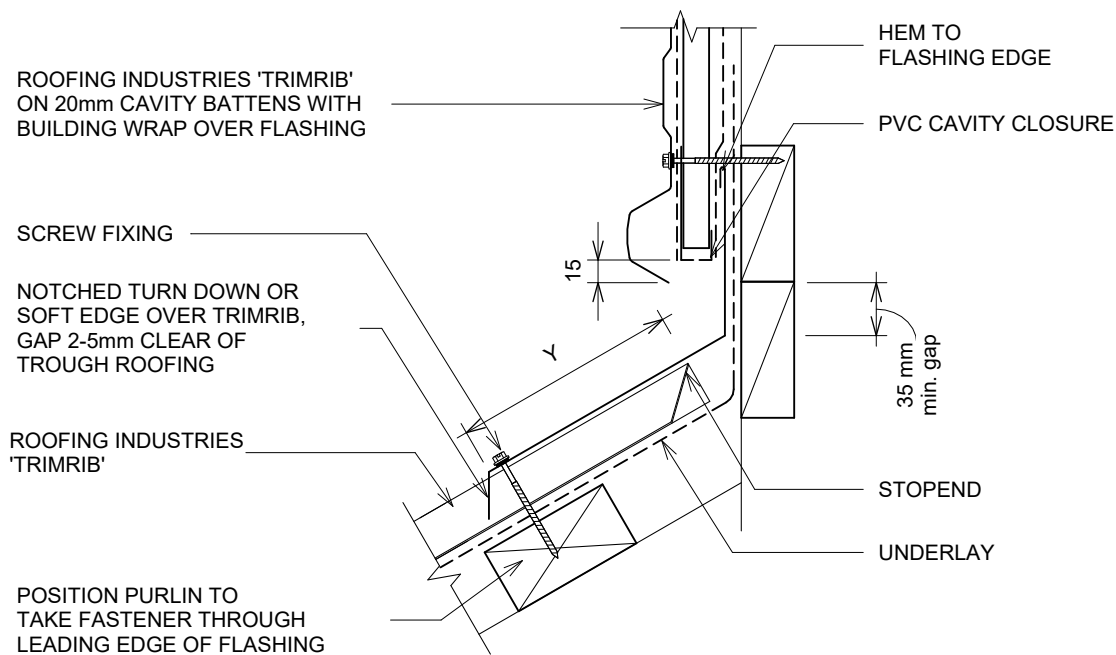

SITE WIND ZONE (As per NZS3604)	MINIMUM mm	
	Z (1)	Y (2)
SITUATION 1	75mm	130mm
SITUATION 2	75mm	200mm
SITUATION 3	90mm	200mm

### DETAIL ANNOTATION:

- DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL;
1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
  2. EXCLUDES DOWNTURN
  3. CAVITY BATTENS CONTAINING CORROSIVE TREATMENTS MUST BE SEPARATED FROM METAL CLADDING BY DPC, WALL UNDERLAY, PVC OR PAINTING
  4. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
  5. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
  6. FOR MORE INFORMATION ABOUT VENTING AT THE UPPER TERMINATION, REFER TO THE NZMRM COP

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024






# RESIDENTIAL TRIMRIB® ROOFING

## APRON 2 PIECE FLASHING (CAVITY)

Detail Number: RI-RTR-130B  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

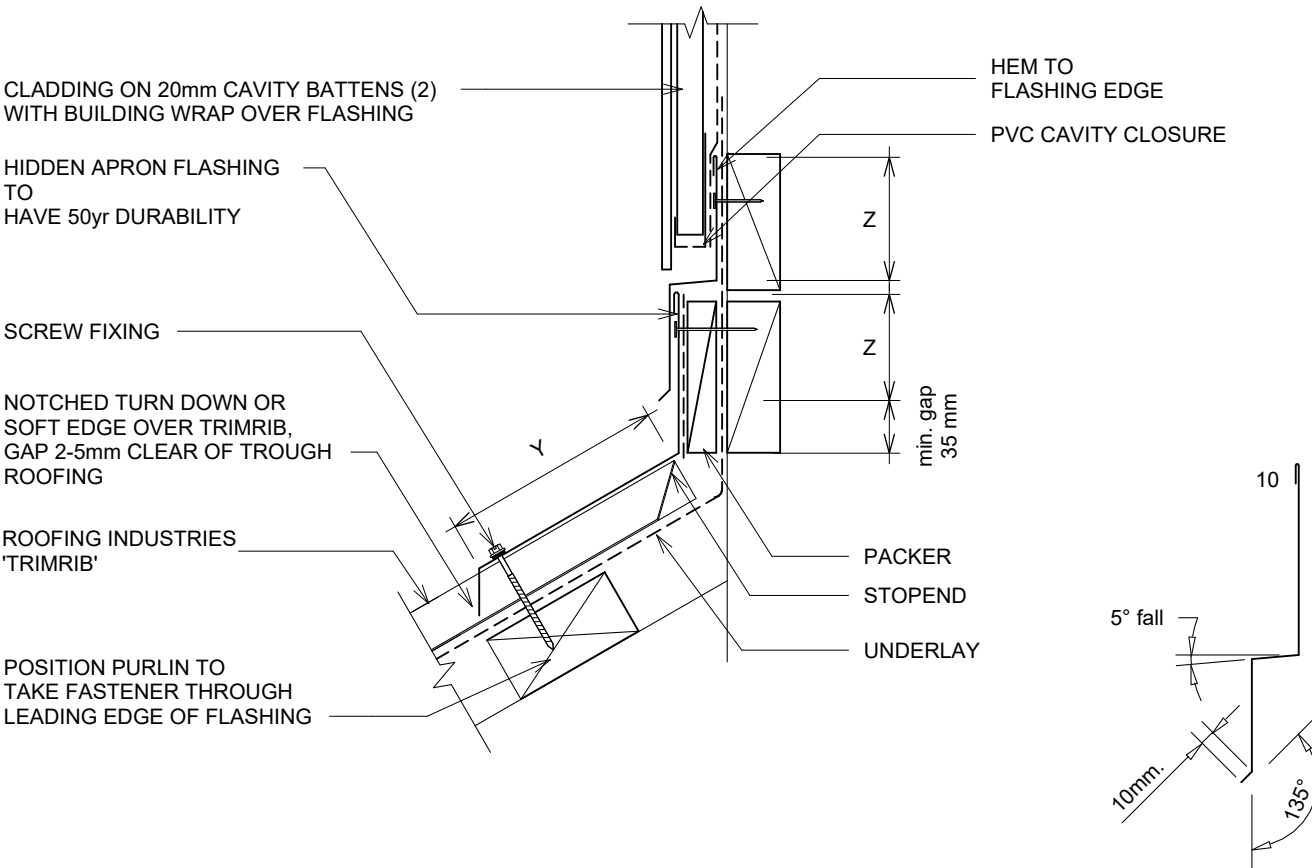

SITE WIND ZONE (As per NZS3604)	MINIMUM mm	
	Z (1)	Y (3)
SITUATION 1	75mm	130mm
SITUATION 2	75mm	200mm
SITUATION 3	90mm	200mm

DETAIL ANNOTATION:

- DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL;
1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
  2. CAVITY BATTENS CONTAINING CORROSIVE TREATMENTS MUST BE SEPARATED FROM METAL CLADDING BY DPC, WALL UNDERLAY, PVC OR PAINTING EXCLUDING ANY SOFT EDGE OR TURN DOWN
  3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
  4. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION
  5. RECOMMENDATIONS
  6. FOR MORE INFORMATION ABOUT VENTING AT THE UPPER TERMINATION, REFER TO THE NZMRM COP

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## PARALLEL HIDDEN GUTTER (NON CAVITY)

Detail Number: RI-RTR-140A  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

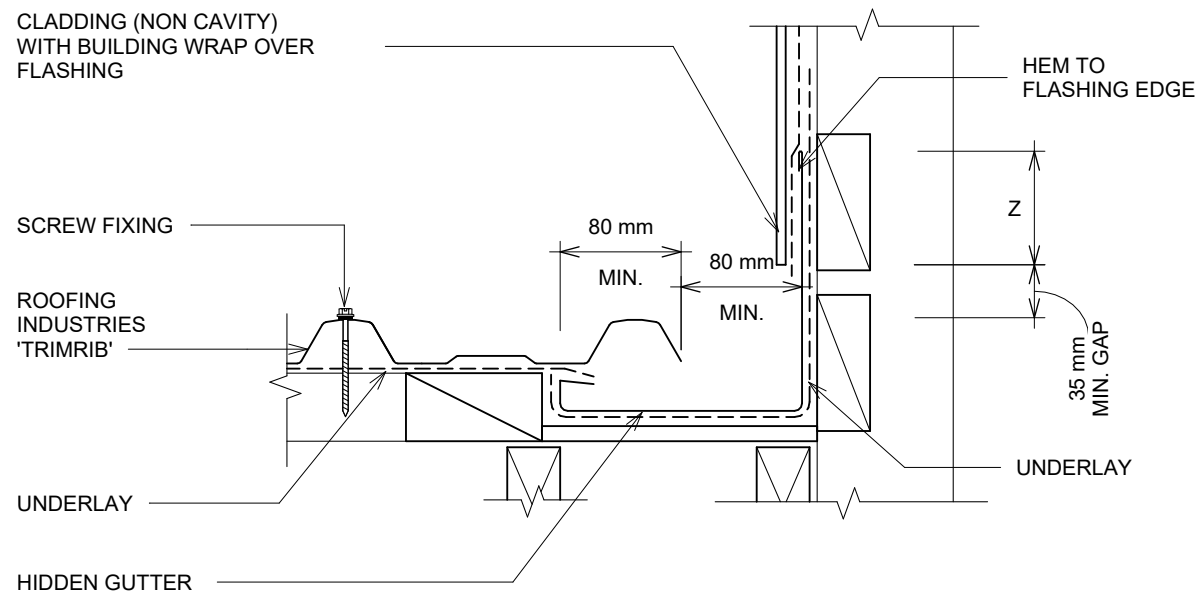

SITE WIND ZONE (As per NZS3604)	MINIMUM
	Z
SITUATION 1 & 2 <sup>(1)</sup>	75mm
SITUATION 3 <sup>(1)</sup>	90mm

### DETAIL ANNOTATION:

DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL;

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. WHERE GUTTER FINISHES WITHIN THE LENGTH OF THE WALL, STEP LOWER PART OF GUTTER OUT TO 10mm PAST THE CLADDING LINE, WHILE MAINTAINING REQUIRED CLEARANCES, TO ALLOW THE GUTTER TO FEED INTO LOWER EAVES GUTTER
3. INTERNAL GUTTER SHOULD BE MADE FROM NONFERROUS METAL'S COMPATIBLE WITH THE ROOFING MATERIAL
4. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
5. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
6. GUTTER SHALL BE SIZED TO SUIT THE ROOF CATCHMENT AREA BUT SHALL BE NO LESS THAN SHOWN IN THIS FIGURE AND DESIGNED IN ACCORDANCE WITH THE NZMRM COP
7. ALLOW FOR SEPARATION FROM ANY CORROSIVE TIMBER TREATMENTS

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## PARALLEL HIDDEN GUTTER (CAVITY)

Detail Number: RI-RTR-140B  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

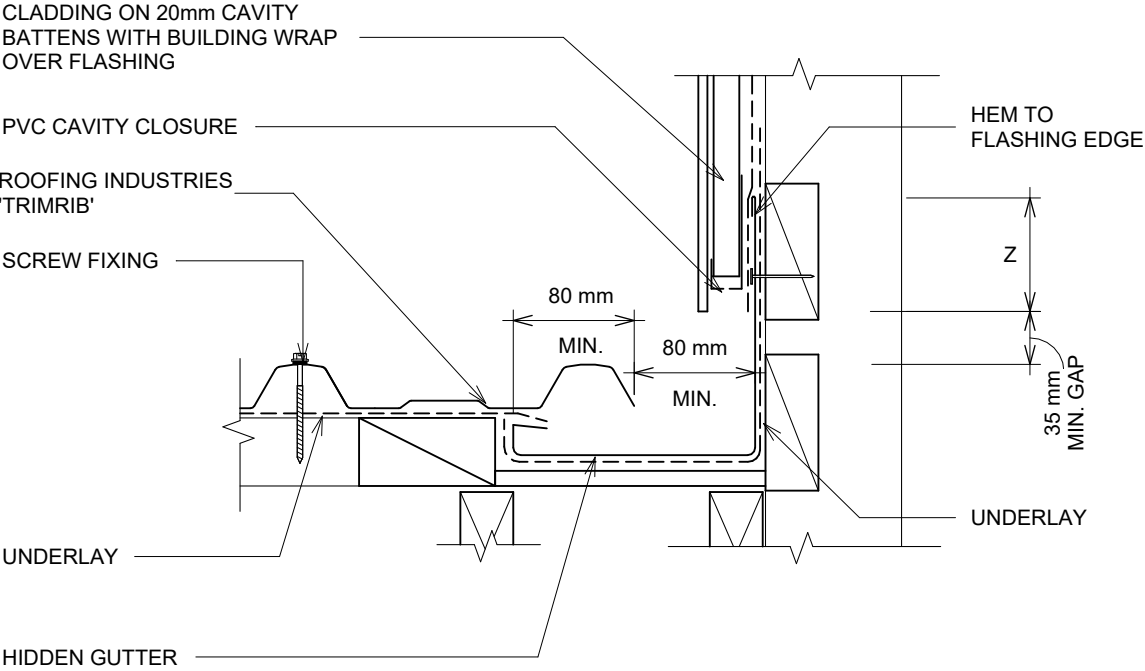

SITE WIND ZONE (As per NZS3604)	MINIMUM
	Z
SITUATION 1 & 2 <sup>(1)</sup>	75mm
SITUATION 3 <sup>(1)</sup>	90mm

### DETAIL ANNOTATION:

- DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL;
1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
  2. WHERE GUTTER FINISHES WITHIN THE LENGTH OF THE WALL, STEP LOWER PART OF GUTTEROUT TO 10mm PAST THE CLADDING LINE, WHILE MAINTAINING REQUIRED CLEARANCES, TO ALLOW THE GUTTER TO FEED INTO LOWER EAVES GUTTER
  3. INTERNAL GUTTER SHOULD BE MADE FROM NONFERROUS METAL'S COMPATIBLE WITH THE ROOFING MATERIAL
  4. FOR GUTTER SIZING REFER TO E1/AS1 AND/OR E2/AS1
  5. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
  6. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
  7. GUTTER SHALL BE SIZED TO SUIT THE ROOF CATCHMENT AREA BUT SHALL BE NO LESS THAN SHOWN IN THIS FIGURE AND DESIGNED IN ACCORDANCE WITH THE NZMRM COP
  8. ALLOW FOR SEPARATION FROM ANY CORROSIVE TIMBER TREATMENT

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## PARALLEL HIDDEN 2 PIECE GUTTER (CAVITY)

Detail Number: RI-RTR-140C  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

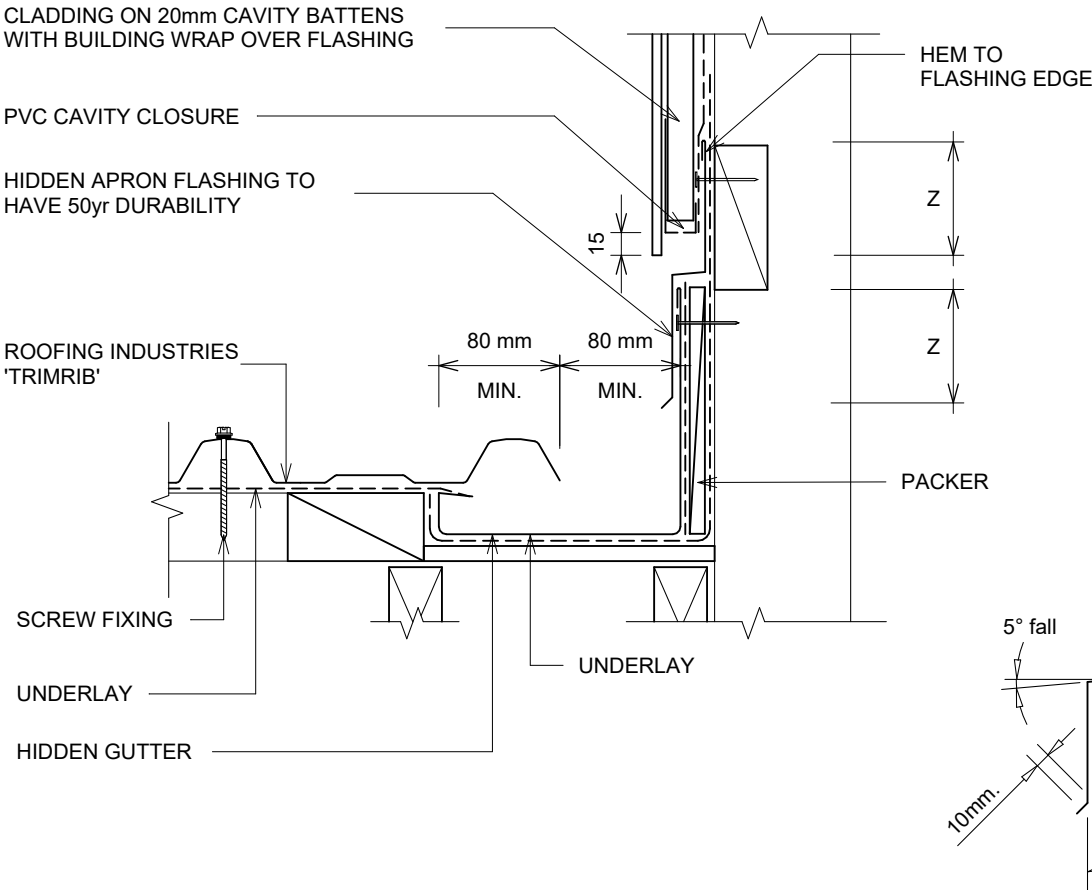

SITE WIND ZONE (As per NZS3604)	MINIMUM
	Z
SITUATION 1 & 2 <sup>(1)</sup>	75mm
SITUATION 3 <sup>(1)</sup>	90mm

DETAIL ANNOTATION:

DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL;

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. ALTERNATIVELY REFER TO E2/AS1
3. WHERE GUTTER FINISHES WITHIN THE LENGTH OF THE WALL, STEP LOWER PART OF GUTTEROUT TO 10mm PAST THE CLADDING LINE, WHILE MAINTAINING REQUIRED CLEARANCES, TO ALLOW THE GUTTER TO FEED INTO LOWER EAVES GUTTER
4. INTERNAL GUTTER SHOULD BE MADE FROM NONFERROUS METAL'S COMPATIBLE WITH THE ROOFING MATERIAL
5. GUTTER SIZES TO BE CALCULATED FROM E1/AS1
6. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
7. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
8. GUTTER SHALL BE SIZED TO SUIT THE ROOF CATCHMENT AREA BUT SHALL BE NO LESS THAN SHOWN IN THIS FIGURE AND DESIGNED IN ACCORDANCE WITH THE NZMRM COP
9. ALLOW FOR SEPARATION FROM ANY CORROSIVE TIMBER TREATMENT

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## MANSARD / EXTERNAL CHANGE IN PITCH FLASHING

Detail Number: RI-RTR-150  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

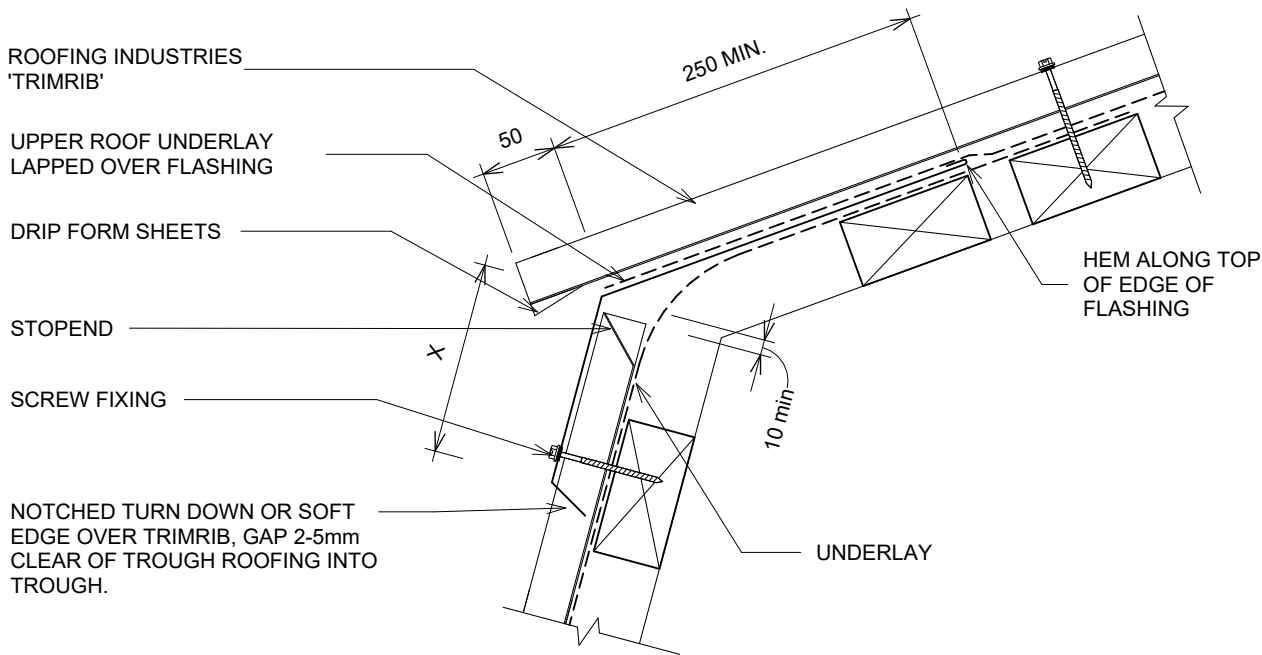

SITE WIND ZONE  (As per NZS3604)	MIN mm	(X) <sup>(2)</sup>
	UPPER LAP UNDER ROOFING	TRANSVERSE FLASHING OVER ROOFING
SITUATION 1 <sup>(1)</sup>	250mm	150mm
SITUATION 2 <sup>(1)</sup>	250mm	200mm
SITUATION 3 <sup>(1)</sup>	<sup>(3)</sup>	

DETAIL ANNOTATION:

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. EXCLUDING ANY SOFT EDGE OR TURN DOWN TO ROOFING
3. NOT PERMITTED UNDER E2/AS1, REFER TO NZMRM METAL ROOF & WALL CLADDING CODE OF PRACTICE
4. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
5. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING


## BOOT FLASHING FOR UP TO 85mm DIA PIPE

Detail Number: RI-RTR-160

Date drawn: 16/12/2024

### DETAIL ANNOTATION:

1. FOR PIPES UP TO 85mm DIAMETER
2. MAX ROOF PITCH FOR THIS FLASHING 45°, MIN PITCH 10°
3. ALTERNATIVELY REFER TO MRM COP
4. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED

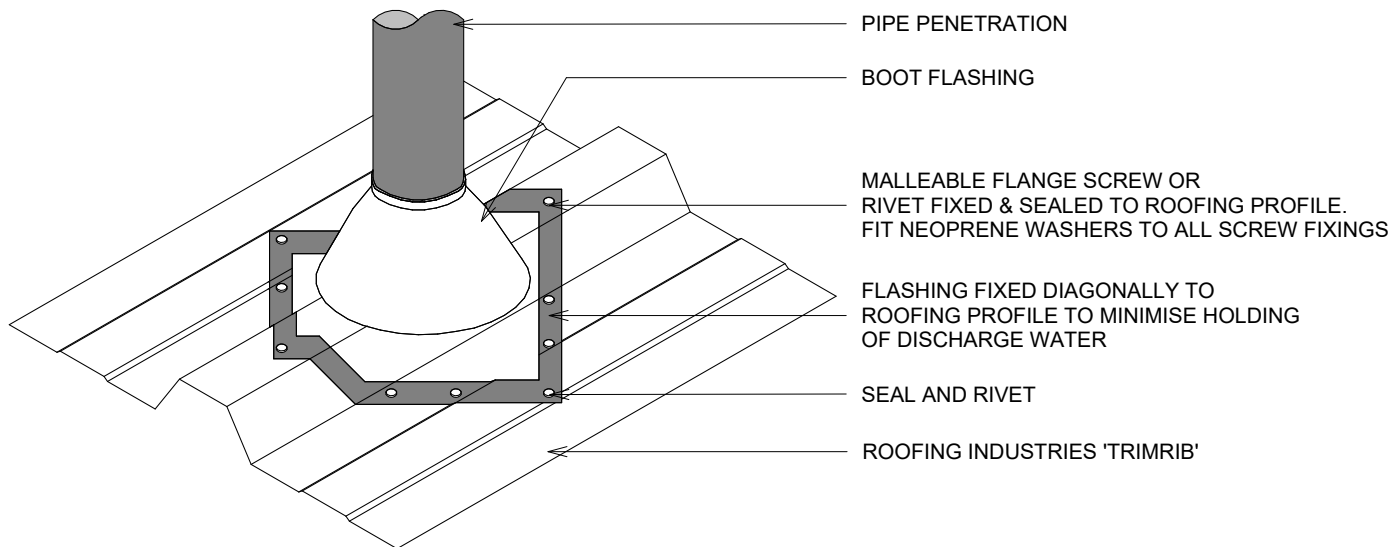

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024





WATERSHED FLASHING FOR PIPE / CHIMNEY PENETRATION  
UP TO 500mm DIA.

Date drawn: 16/12/2024

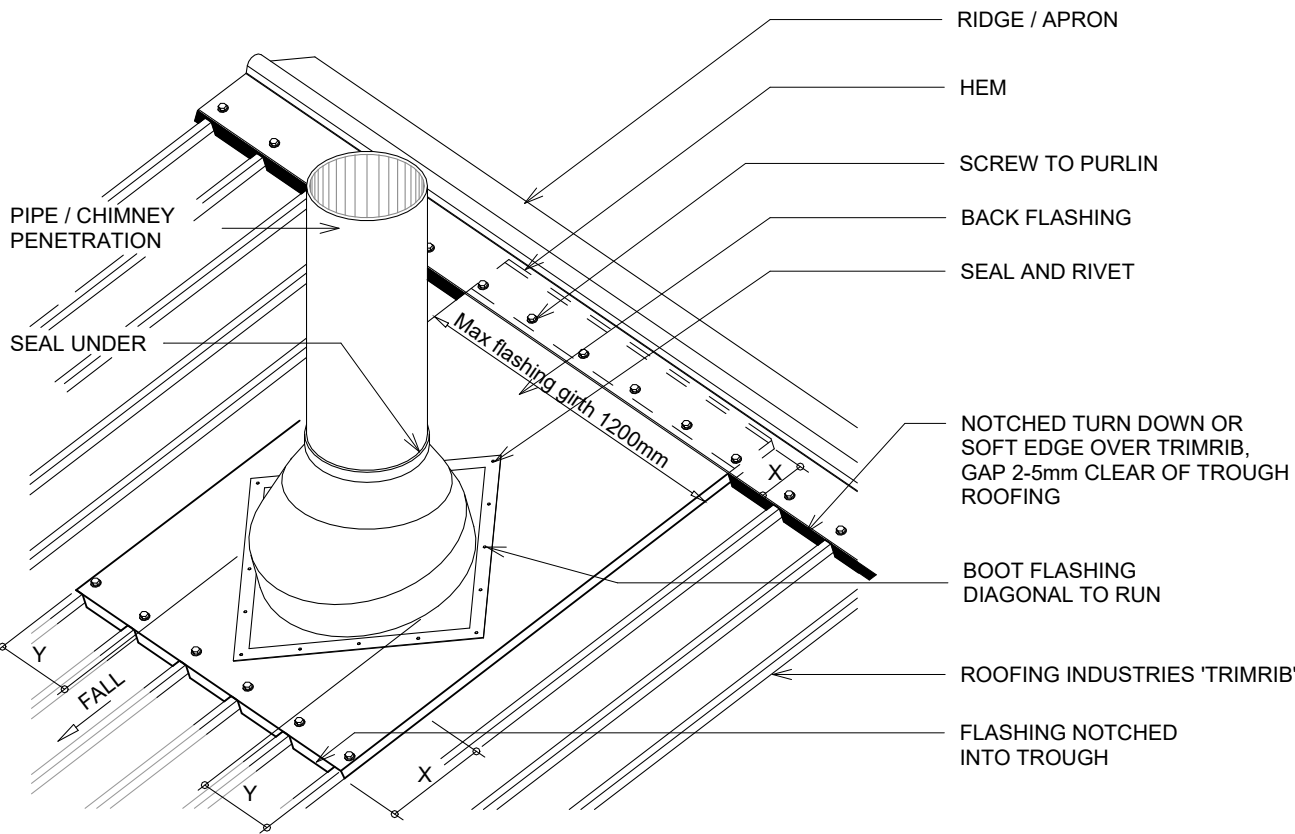

SITE WIND ZONE (As per NZS3604)	MIN mm (cover)	
	X	Y
SITUATION 1 <sup>(1)</sup>	150	2 CRESTS
SITUATION 2 & 3 <sup>(1)</sup>	200	2 CRESTS

DETAIL ANNOTATION:

1. SUITABLE FOR PIPES UP TO 500mm DIAMETER
2. ALTERNATIVELY REFER TO MRM COP
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
4. ALTERNATIVELY REFER TO MRM COP
5. ADDITION SUPPORT FRAMING REQUIRED WHEN PENETARTION EXCEEDS 200mm THROUGH ROOF

GENERAL NOTES:


- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024





SOAKER FLASHING FOR PIPE / CHIMNEY PENETRATION  
(85-500mm DIA, MID ROOF)

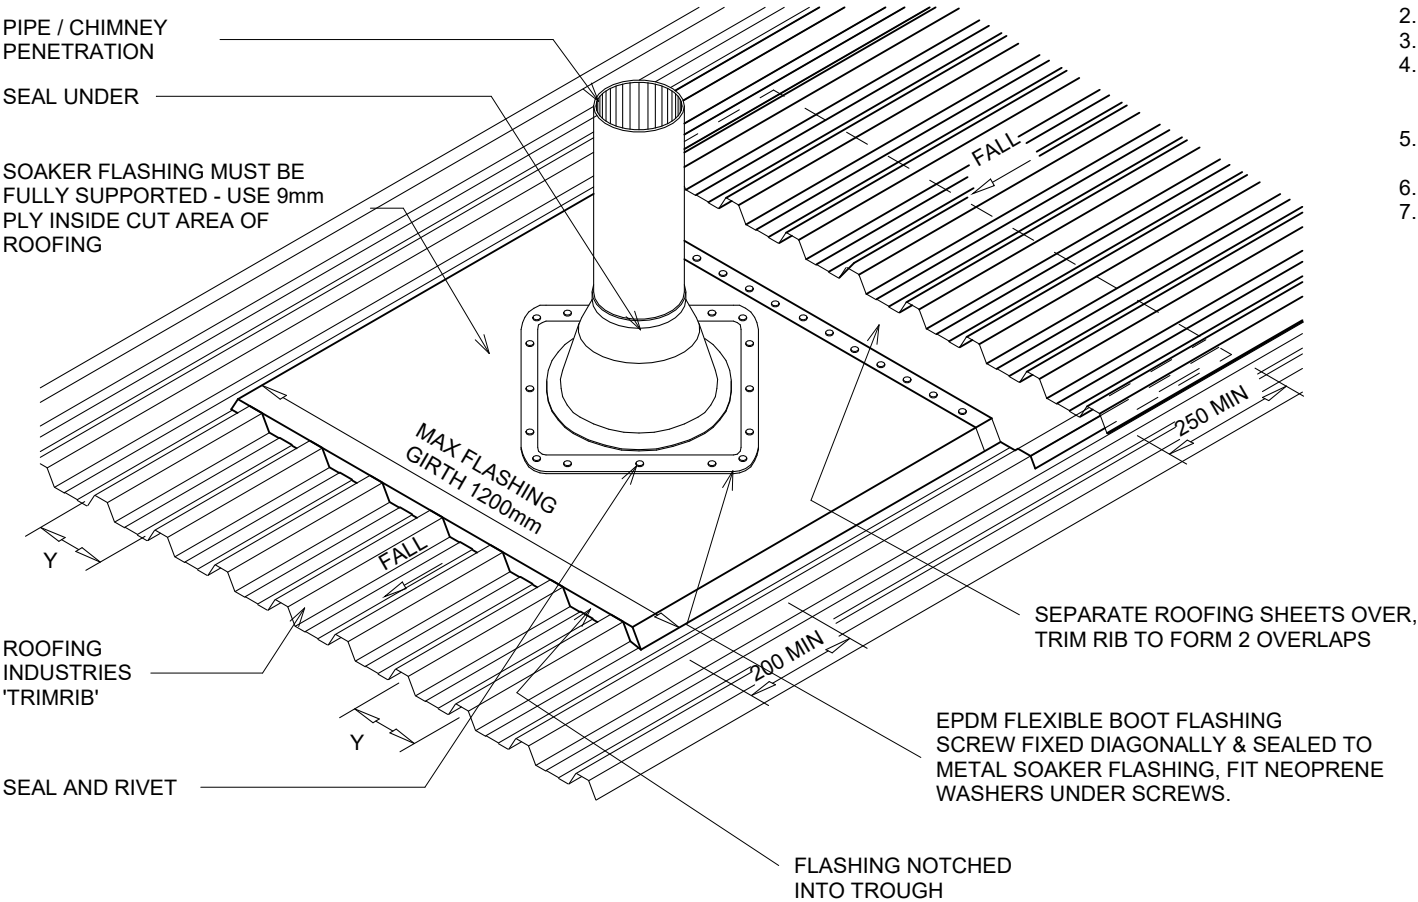

- DETAIL ANNOTATION:
1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
  2. SUITABLE FOR PIPES UP TO 500mm DIAMETER
  3. ALTERNATIVELY REFER TO MRM COP
  4. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
  5. ADDITION SUPPORT FRAMING REQUIRED WHEN PENETRATION EXCEEDS 200mm THROUGH ROOF
  6. MINIMUM ROOF PITCH FOR THIS FLASHING 10°
  7. FOR MORE INFORMATION REFER TO THE RANZ/MRM ROOFING APP: WWW.ROOFGUIDE.CO.NZ

SITE WIND ZONE (As per NZS3604)	MIN mm (cover)	
	X	Y
SITUATION 1 <sup>(1)</sup>	150	2 CRESTS
SITUATION 2 & 3 <sup>(1)</sup>	200	2 CRESTS

- GENERAL NOTES:
- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
  - The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
  - Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
  - Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
  - These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
  - This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
  - Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
  - Details are for steel-based materials, other substrates may require some changes.
  - All dimensions are nominal.
  - Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024




# RESIDENTIAL TRIMRIB® ROOFING

## WATERSHED CHIMNEY FLASHING

Detail Number: RI-RTR-180A

Date drawn: 16/12/2024

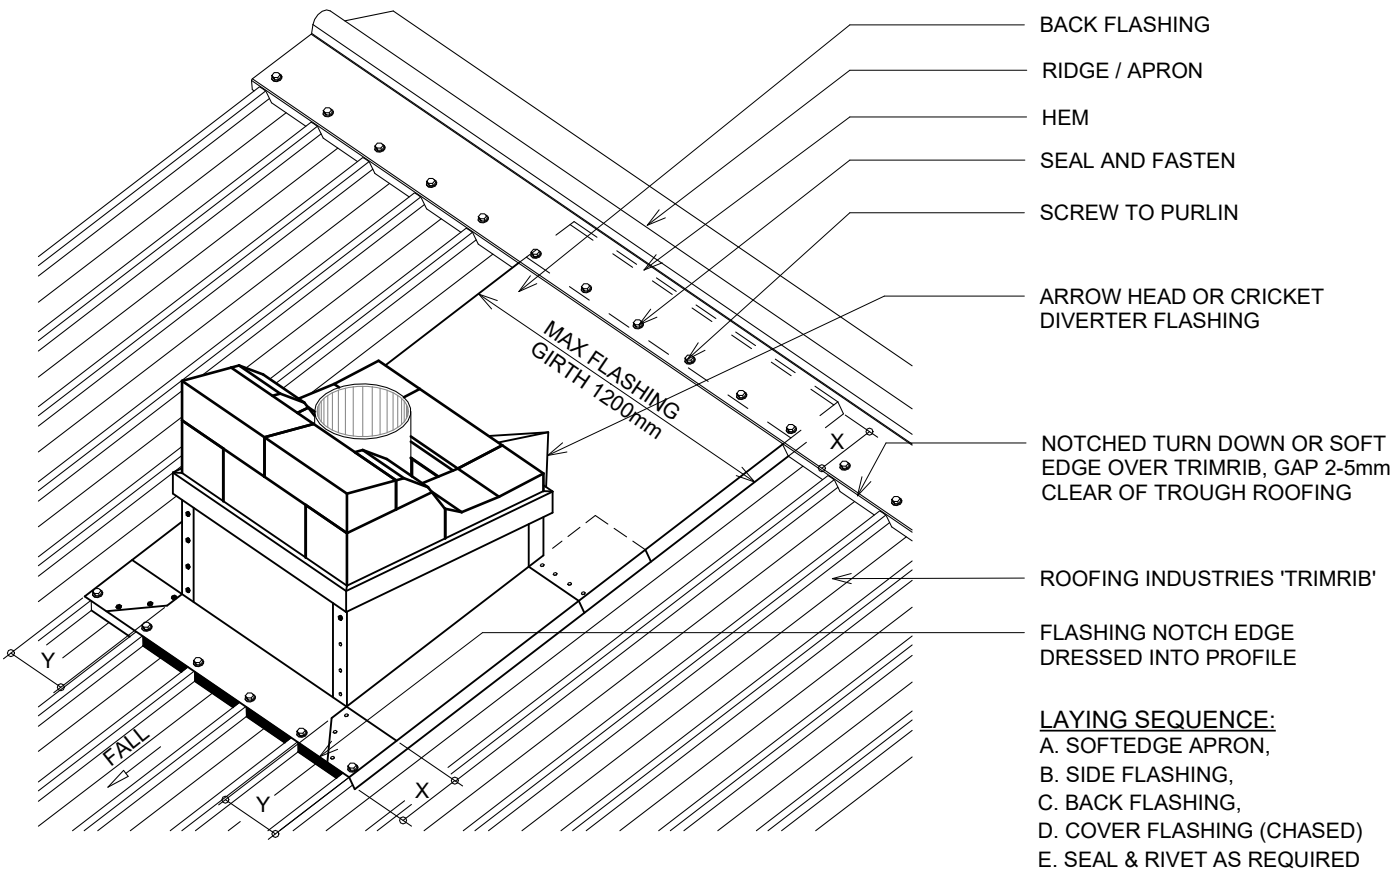

### DETAIL ANNOTATION:

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. ALTERNATIVELY REFER TO MRM COP
3. ADDITION SUPPORT FRAMING REQUIRED WHEN PENETRATION EXCEEDS 200mm THROUGH ROOF FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
- 4.

CATCHMENT WIDTH	MAX ROOF LENGTH ABOVE PENETRATION
0-400	18 METRES
400-600	16 METRES
600-800	12 METRES
800-1200	8 METRES

SITE WIND ZONE (As per NZS3604)	MIN mm (cover)	
	X	Y
SITUATION 1 <sup>(1)</sup>	150	2 CRESTS
SITUATION 2 & 3 <sup>(1)</sup>	200	2 CRESTS

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024




# RESIDENTIAL TRIMRIB® ROOFING

## CHIMNEY FLASHING, MID ROOF

Detail Number: RI-RTR-180B  
Date drawn: 16/12/2024

NOTE:  
USE BACK FLASHING TO RIDGE WHERE POSSIBLE.

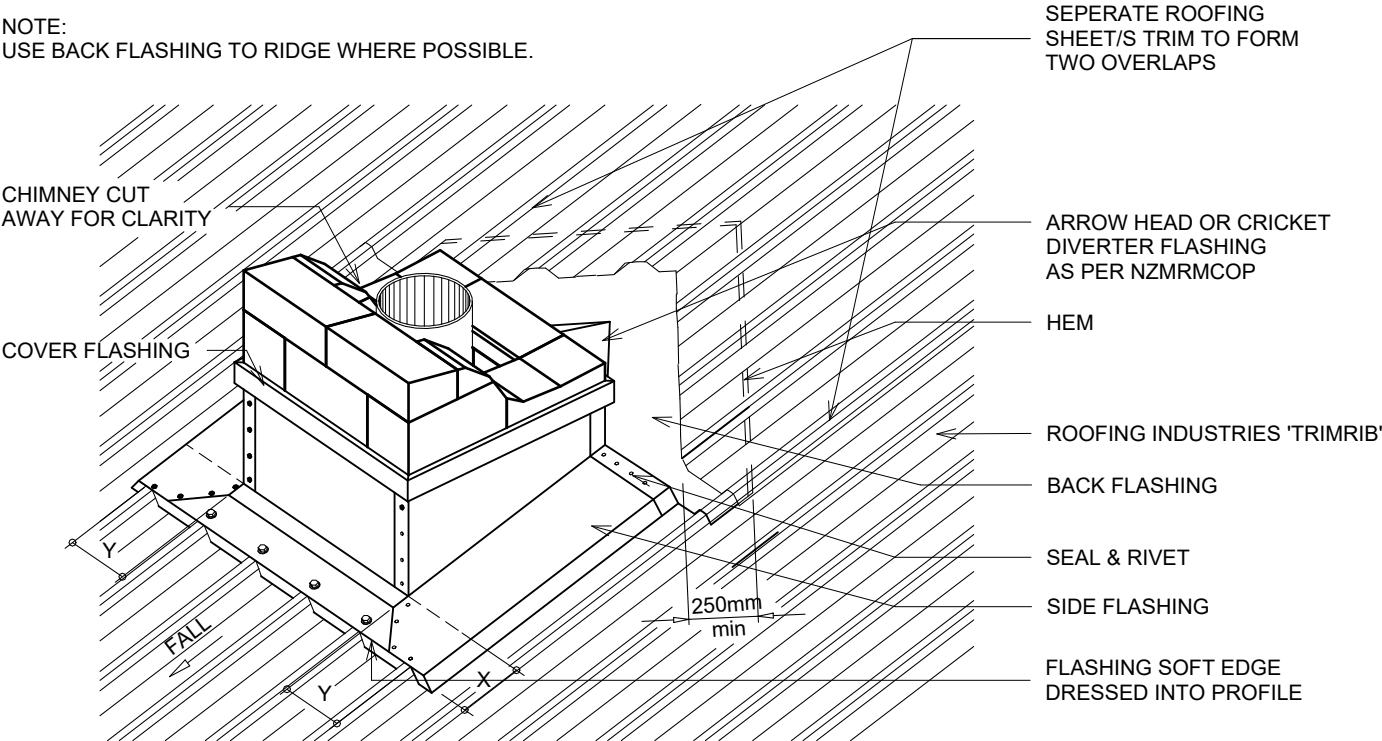

**LAYING SEQUENCE:**  
A. SOFTEDGE APRON,  
B. SIDE FLASHING,  
C. BACK FLASHING,  
D. COVER FLASHING (CHASED)  
E. SEAL & RIVET AS REQUIRED

DETAIL ANNOTATION:

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. ADDITION SUPPORT FRAMING REQUIRED WHEN PENETARTION EXCEEDS 200mm THROUGH ROOF
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
4. ALTERNATIVELY REFER TO E2/AS1

SUITABLE FOR ROOF PITCHES OF 10° OR HIGHER UNDER E2/AS1

CATCHMENT WIDTH	MAX ROOF LENGTH ABOVE PENETRATION
0-400	18 METRES
400-600	16 METRES
600-800	12 METRES
800-1200	8 METRES

SITE WIND ZONE (As per NZS3604)	MIN mm (cover)	
	X	Y
SITUATION 1 <sup>(1)</sup>	150	2 CRESTS
SITUATION 2 & 3 <sup>(1)</sup>	200	2 CRESTS

GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024




# RESIDENTIAL TRIMRIB® ROOFING

## SKYLIGHT FLASHING

Detail Number: RI-RTR-190

Date drawn: 16/12/2024

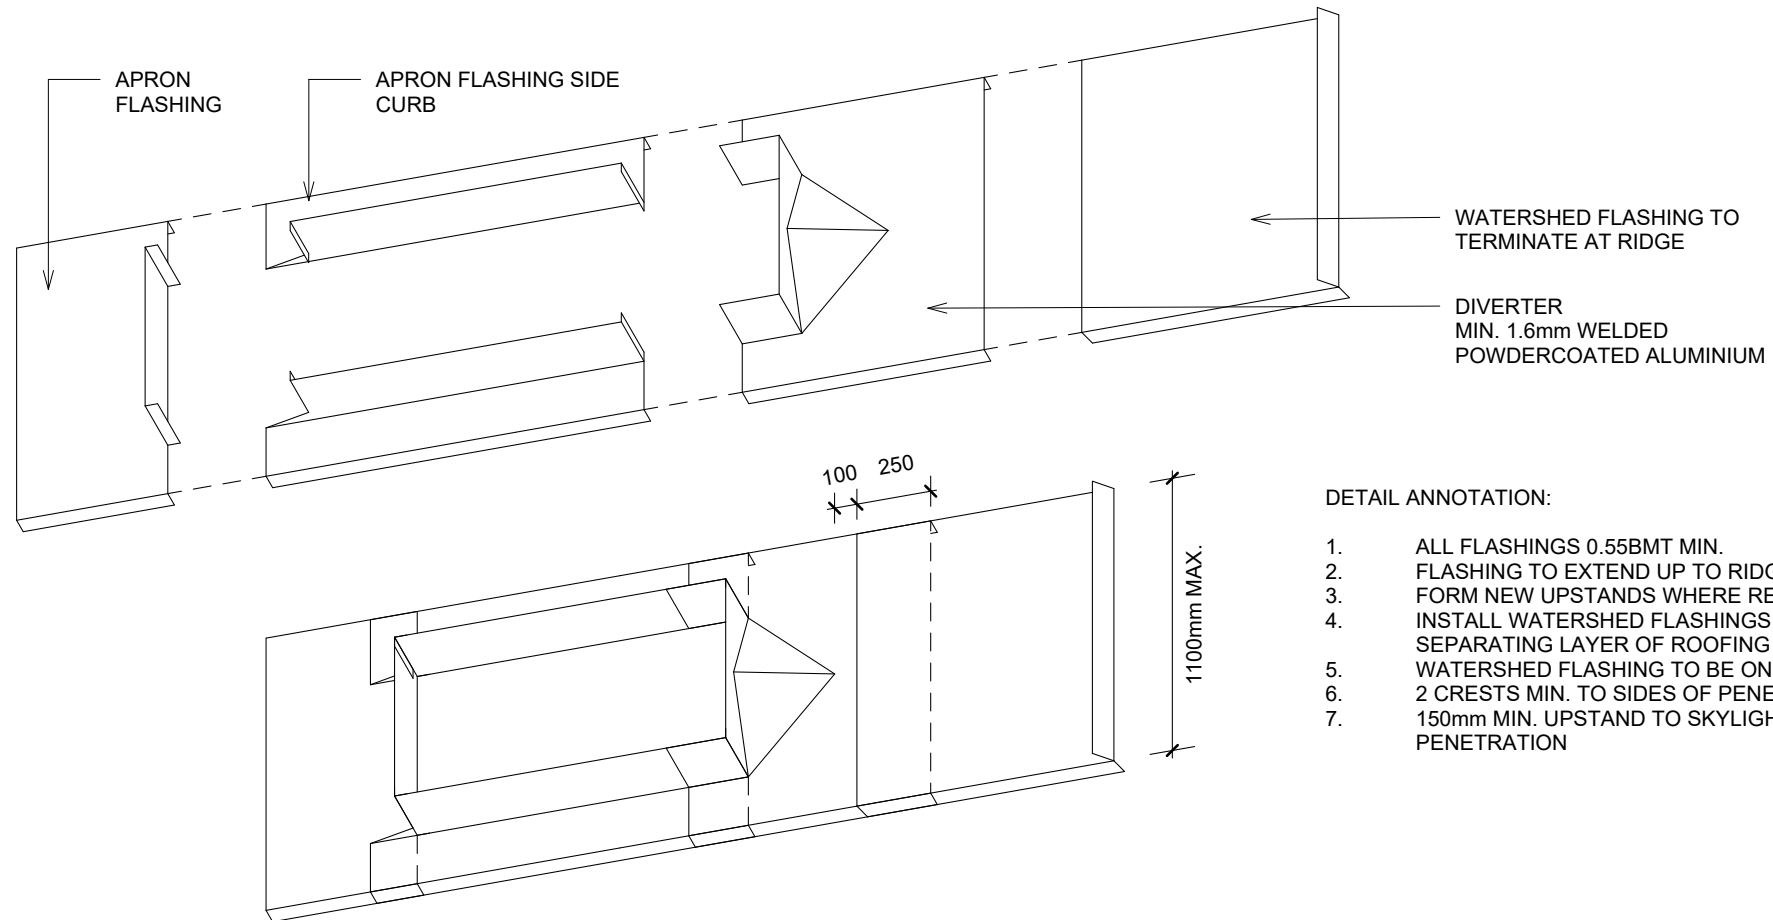

### DETAIL ANNOTATION:


1. ALL FLASHINGS 0.55BMT MIN.
2. FLASHING TO EXTEND UP TO RIDGE FLASHING FORM NEW UPSTANDS WHERE REQUIRED
3. INSTALL WATERSHED FLASHINGS WITH SEPARATING LAYER OF ROOFING UNDERLAY
4. WATERSHED FLASHING TO BE ONE PIECE 2 CRESTS MIN. TO SIDES OF PENETRATION
5. 150mm MIN. UPSTAND TO SKYLIGHT PENETRATION

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024



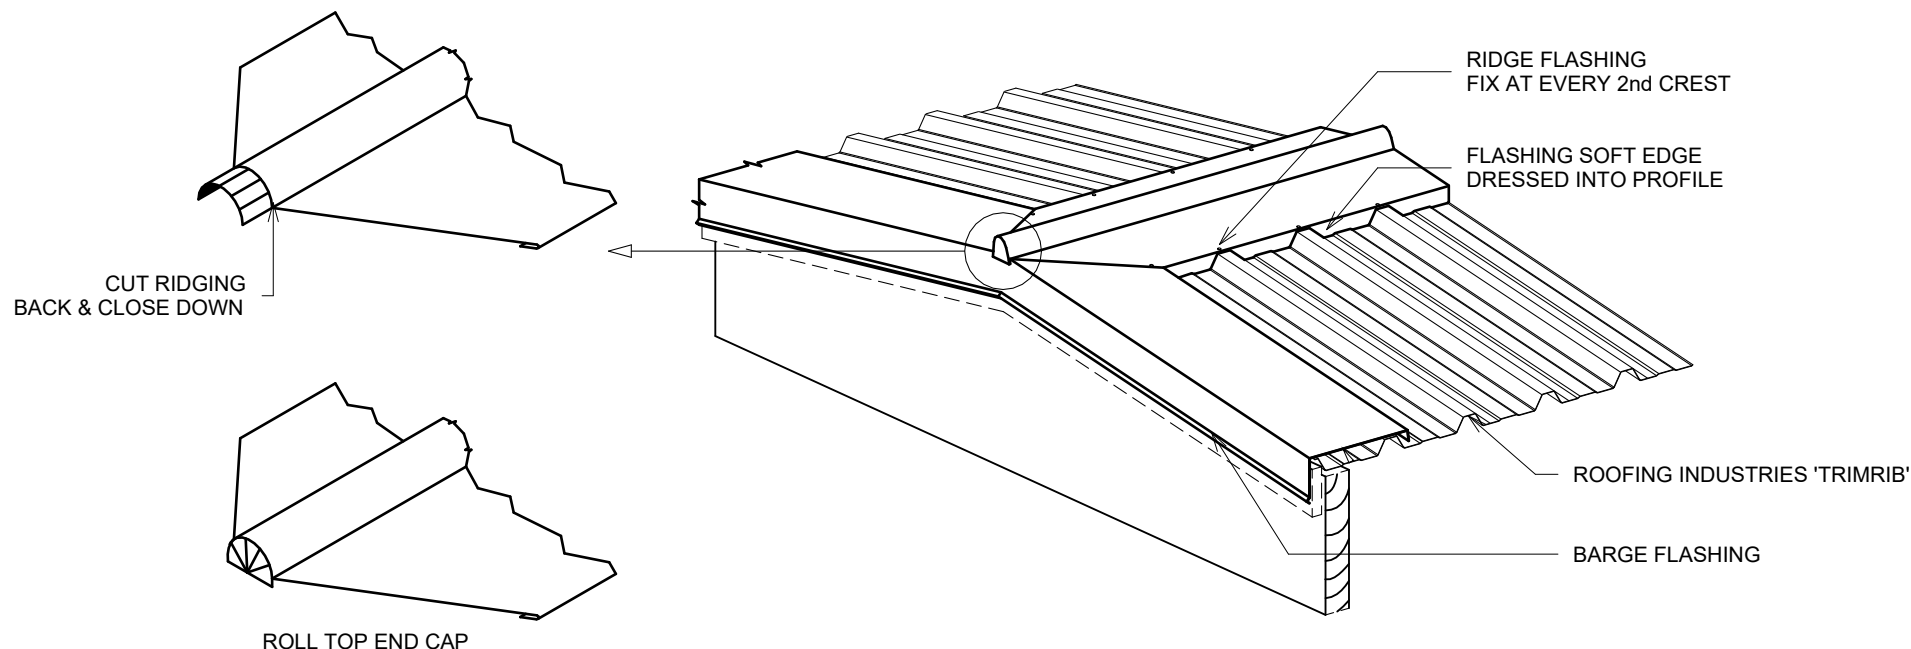

### DETAIL ANNOTATION:

1. FOR RIDGE & BARGE COVERS REFER TO SEPARATE DRAWINGS
2. REFER TO MRM CODE OF PRACTICE

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024






# RESIDENTIAL TRIMRIB® ROOFING

## INTERNAL BARGE FLASHING

Detail Number: RI-RTR-210A

Date drawn: 16/12/2024

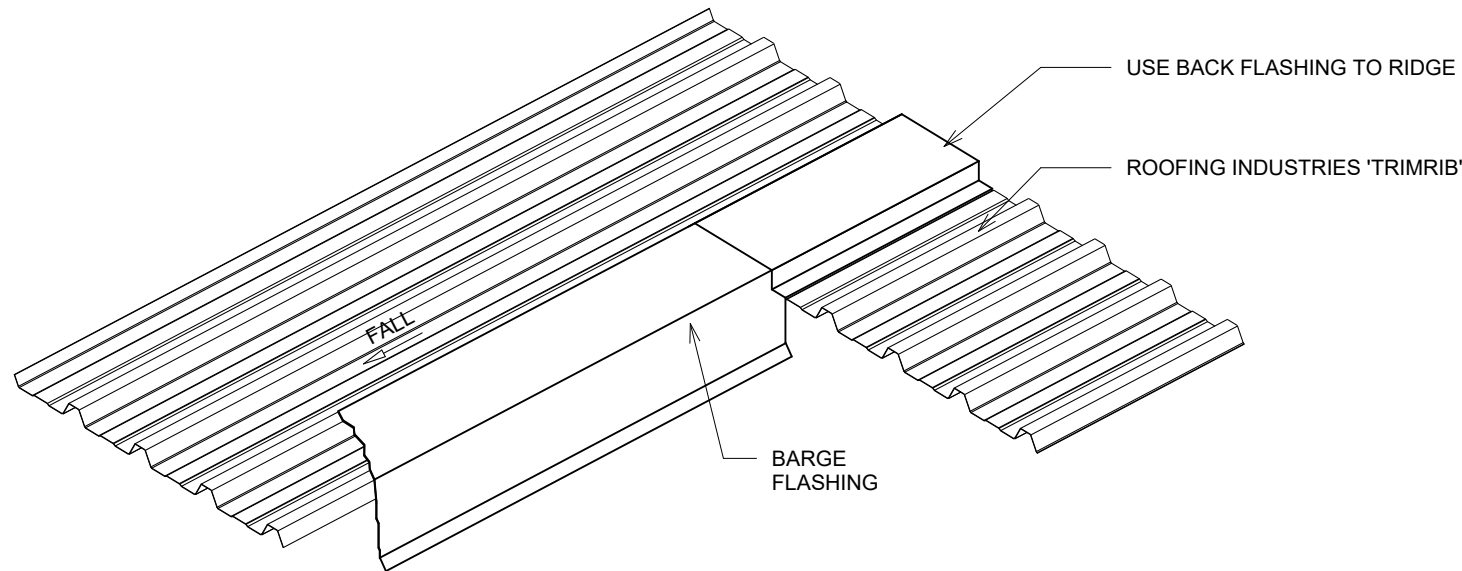

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024




# RESIDENTIAL TRIMRIB® ROOFING

## INTERNAL WELDED ALUMINIUM BARGE TRANSITION FLASHING

Detail Number: RI-RTR-210B

Date drawn: 16/12/2024

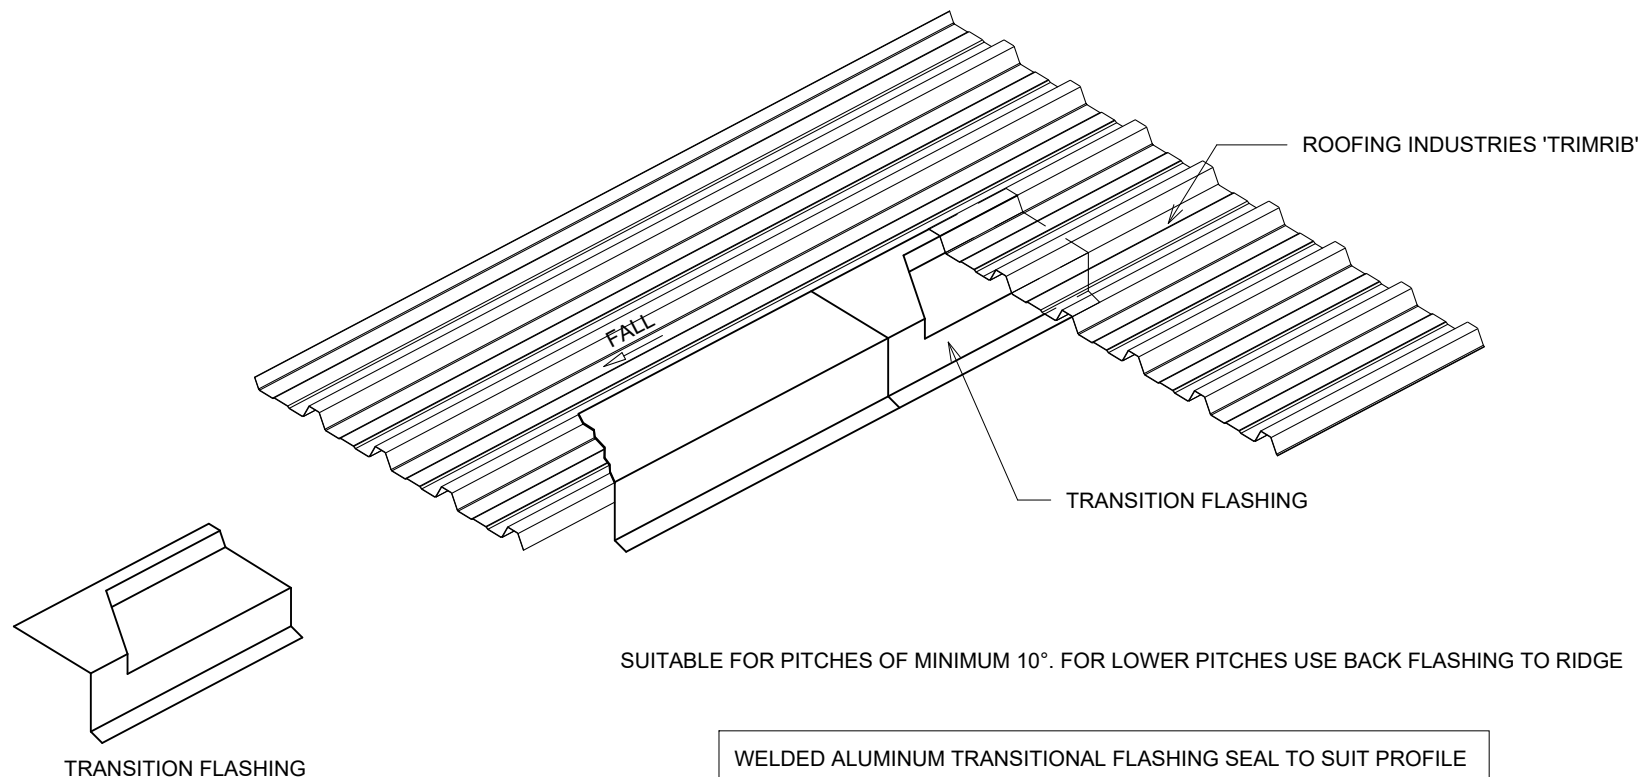

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024






# RESIDENTIAL TRIMRIB® ROOFING

## PARALLEL APRON DIVERTER JUNCTION

Detail Number: RI-RTR-220

Date drawn: 16/12/2024

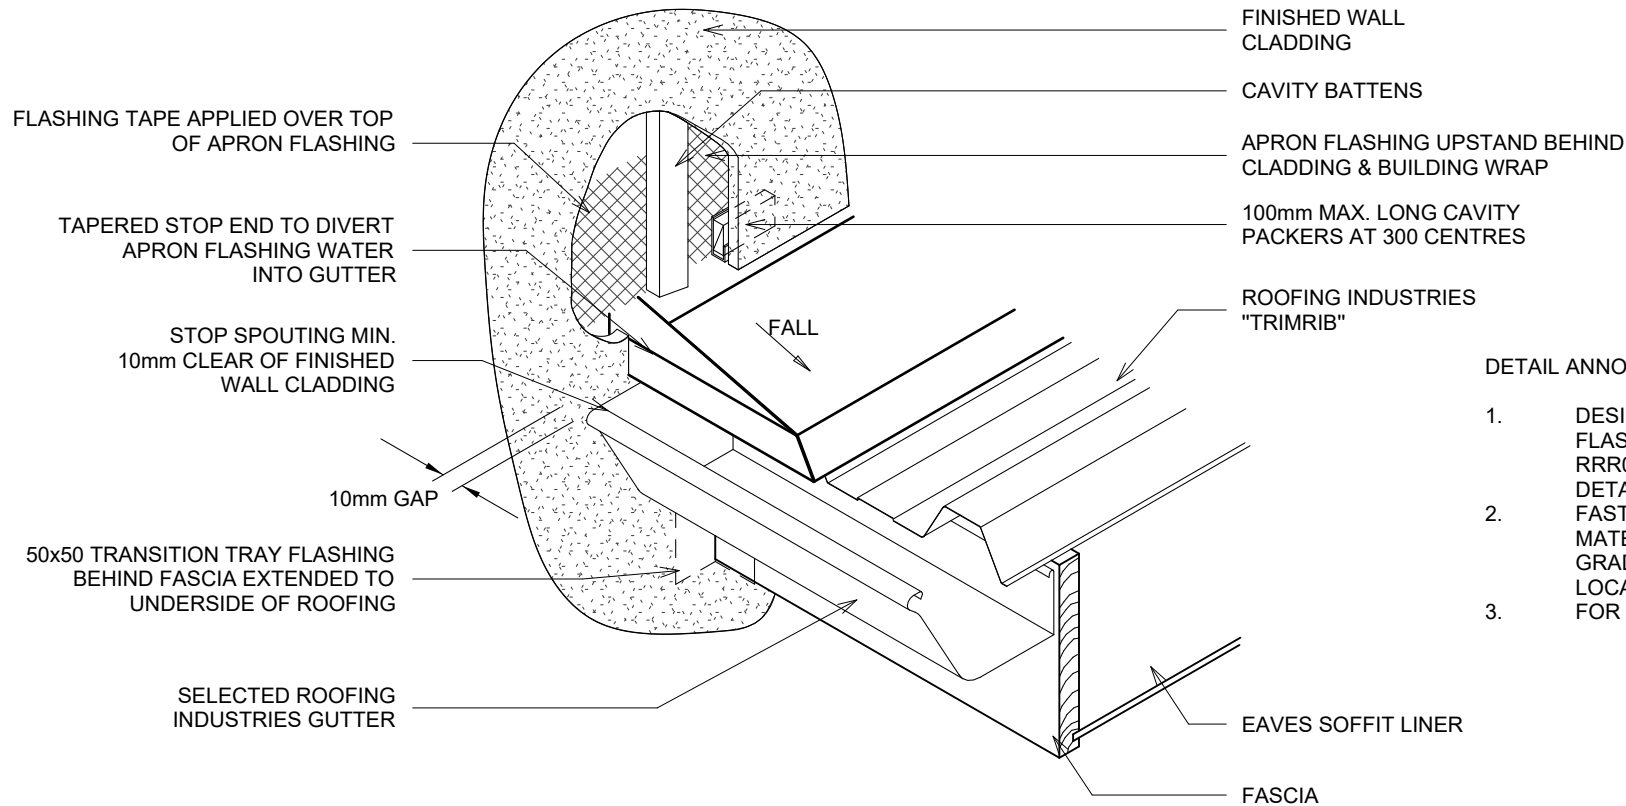

### DETAIL ANNOTATION:

1. DESIGNER TO ENSURE DURABILITY OF FLASHING MATERIAL; REFER TO DETAILS RRR010A, B, C & D FOR APRON FLASHING DETAILS
2. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
3. FOR MORE INFORMATION REFER TO E2/AS1

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2024



# RESIDENTIAL TRIMRIB® ROOFING

## RAKING INTERNAL GUTTER

Detail Number: RI-RTR-230  
Date drawn: 16/12/2024  
Scale: 1 : 5@ A4

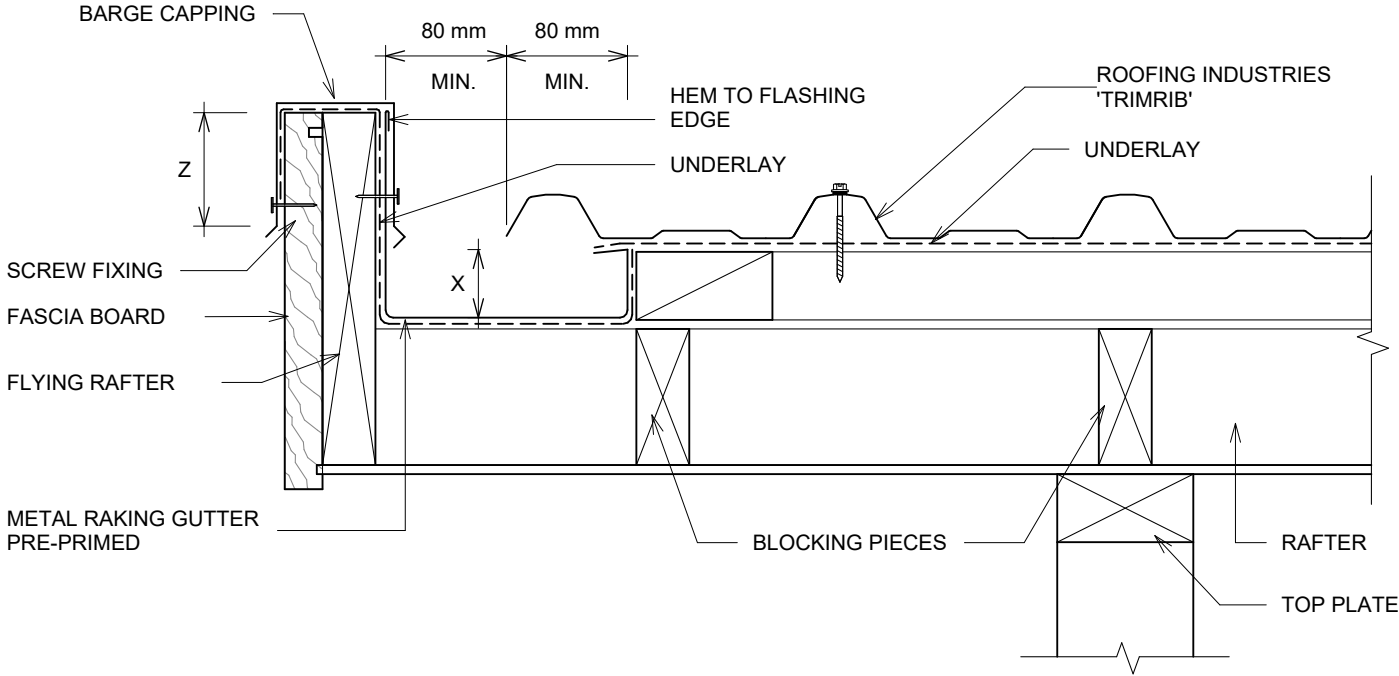

### DETAIL ANNOTATION:

1. SITUATION 1, 2 & 3 AS PER E2/AS1 TABLE 7
2. INCREASE DISTANCE 'Z' BY 25mm WHEN AGAINST A PROFILED SURFACE OR TO 100mm WHICHEVER IS THE LESSER
3. INTERNAL GUTTER SHOULD BE MADE FROM NONFERROUS METAL'S COMPATIBLE WITH THE ROOFING MATERIAL
4. ALTERNATIVELY REFER TO MRM COP
5. ALTERNATIVELY REFER TO E2/AS1
6. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
7. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS
8. GUTTERS SHALL BE SIZED TO SUIT THE ROOF CATCHMENT AREA IN ACCORDANCE WITH E1/AS1 AND/OR E2/AS1
9. ALLOW FOR SEPARATION FROM ANY CORROSIVE TIMBER TREATMENT

SITE WIND ZONE (As per NZS3604)	MINIMUM	
	Z	X
SITUATION 1 <sup>(1)</sup>	50mm	20mm
SITUATION 2 <sup>(1)</sup>	70mm	20mm
SITUATION 3 <sup>(1)</sup>	90mm	20mm

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2024





# RESIDENTIAL TRIMRIB® ROOFING

## ROOFING INDUSTRIES GUTTER OPTIONS 125 BOX GUTTER & OLD GOTHIC FOR TIMBER FASCIA

Detail Number: RI-RTR-240

Date drawn: 16/12/2024

Scale: 1 : 5@ A4

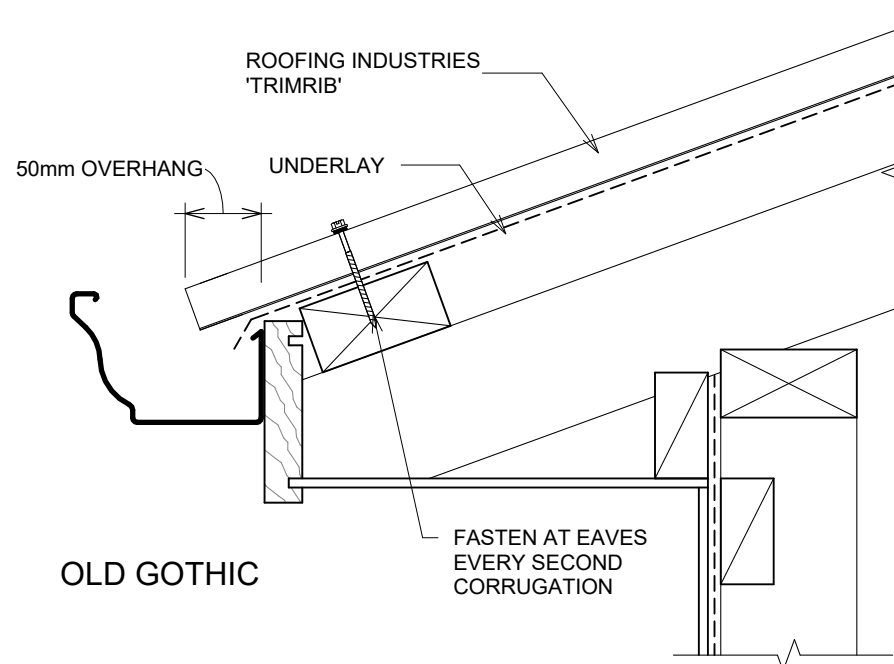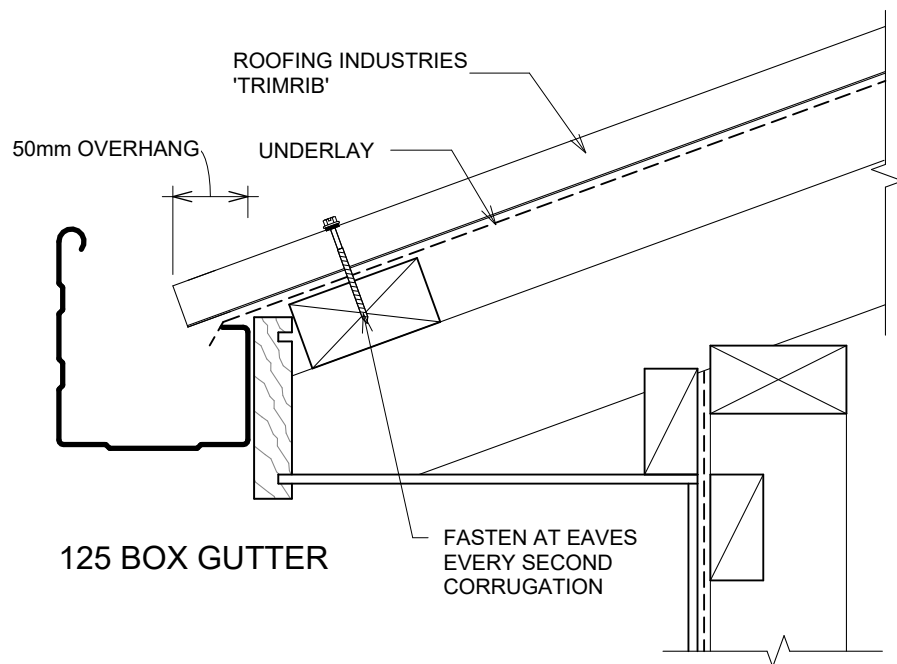

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

### DETAIL ANNOTATION:

1. GUTTER SIZES TO BE CALCULATED FROM E1/AS1
2. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
3. OVERHANG TO GUTTER WHERE THE PITCH IS BELOW 10° AND THE ENDS OF THE RIBS ARE NOT BAFFLED BY THE SPOUTING. SHALL BE INCREASED TO 70MM. REFER TO NZMRM COP
4. ALTERNATIVELY REFER TO MRM COP
5. ALTERNATIVELY REFER TO E2/AS1
6. REFER TO E2/AS1 REGARDING EAVES FLASHING REQUIREMENTS

Copyright detail © 2024





# RESIDENTIAL TRIMRIB® ROOFING

## ROOFING INDUSTRIES GUTTER OPTIONS QUARTER & 1/2 ROUND FOR TIMBER FASCIA

Detail Number: RI-RTR-250

Date drawn: 16/12/2024

Scale: 1 : 5@ A4

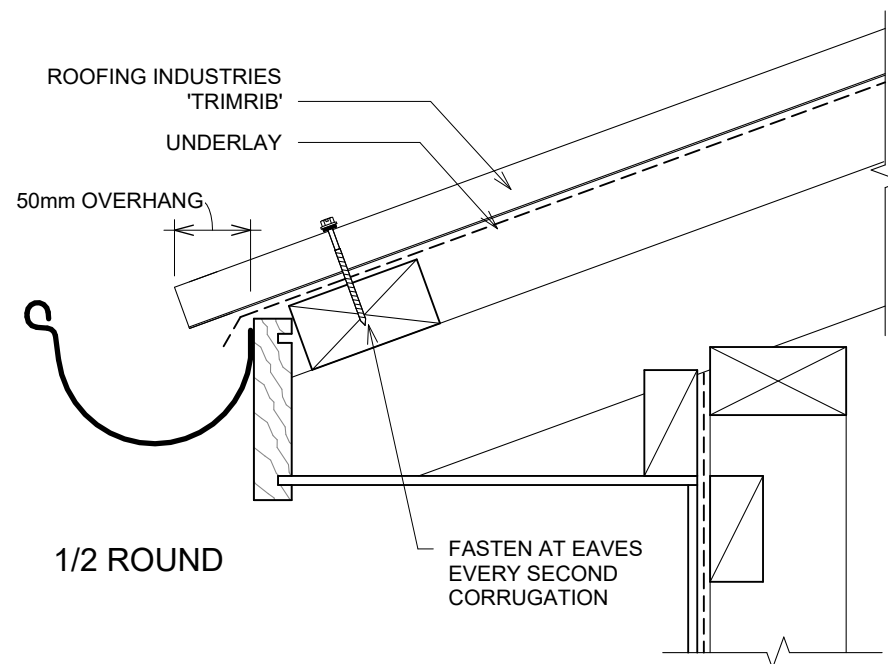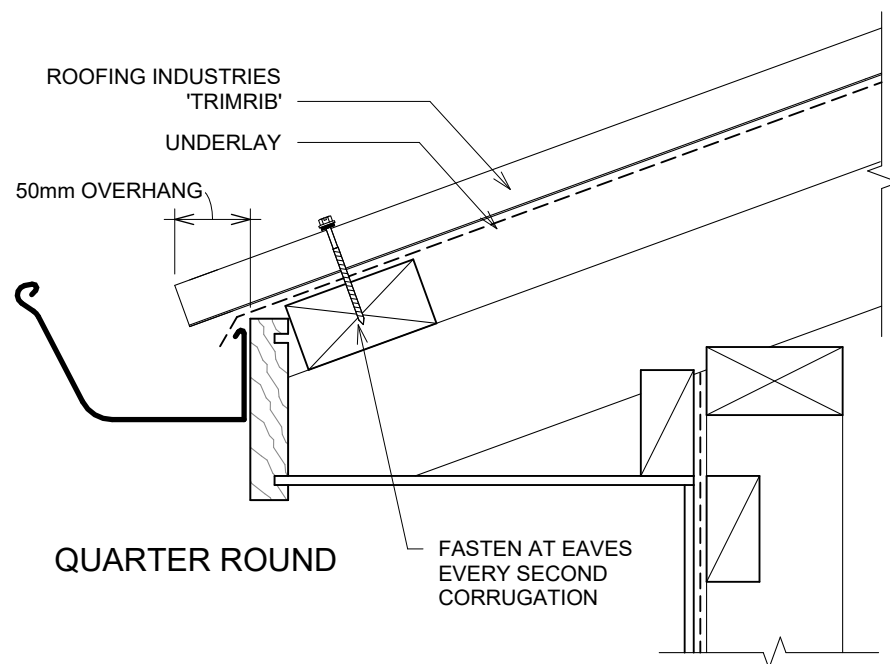

### GENERAL NOTES:

- These details are to be read with Roofing Industries Trimrib Product Technical Statement.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: [www.metalroofing.org.nz](http://www.metalroofing.org.nz) or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixings: The designer needs to check the screw manufacturer's technical data of the selected screw type for the design wind load and the material being fastened to.

### DETAIL ANNOTATION:

1. GUTTER SIZES TO BE CALCULATED FROM E1/AS1
2. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
3. OVERHANG TO GUTTER WHERE THE PITCH IS BELOW 10° AND THE ENDS OF THE RIBS ARE NOT BAFFLED BY THE SPOUTING. SHALL BE INCREASED TO 70MM. REFER TO NZMRM COP
4. ALTERNATIVELY REFER TO MRM COP
5. ALTERNATIVELY REFER TO E2/AS1
6. REFER TO E2/AS1 REGARDING EAVES FLASHING REQUIREMENTS

Copyright detail © 2024

