RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING SHEET LIST

Detail Number: RI-C925HW-00A
Date drawn: 14/10/2026
Scale: @ A3

RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING SHEET LIST		
Sheet Number	Type	Sheet Name
RI-C925HW-00A	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	SHEET LIST
RI-C925HW-00B	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	PROFILES & ACCESSORIES
RI-C925HW-00C	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	PROFILE SUMMARY
RI-C925HW-010A	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	EXTERNAL CORNER
RI-C925HW-020A	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	INTERNAL CORNER
RI-C925HW-025A	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	BASE
RI-C925HW-026A	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	SOFFIT
RI-C925HW-028A	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	BUTT JOINT
RI-C925HW-029A	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	TILT PANEL JUNCTION
RI-C925HW-030A	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	TILT PANEL JUNCTION OPTION 1
RI-C925HW-032A	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	WINDOW / DOOR HEAD FLASHING (RECESSED)
RI-C925HW-032B	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	WINDOW / DOOR JAMB FLASHING (RECESSED)
RI-C925HW-032C	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	WINDOW / DOOR SILL FLASHING (RECESSED)
RI-C925HW-090B	RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING	ROLLER DOOR JAMB


Copyright detail © 2026

Roofing Industries
roof.co.nz

RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING
PROFILES & ACCESSORIES

Detail Number: RI-C925HW-00B
Date drawn: 14/10/2026
Scale: 1 : 5@ A3


ROOFING INDUSTRIES RI925




ROOFING INDUSTRIES
BARGE FLASHING




ROOFING INDUSTRIES
BARGE/PARAPET
CAPPING

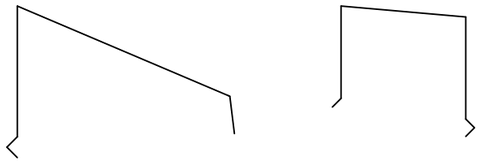


ROOFING INDUSTRIES
CHANGE IN PITCH
FLASHING




ROOFING INDUSTRIES
GUTTER APRON
FLASHING




ROOFING INDUSTRIES RI925



ROOFING INDUSTRIES
RIDGE FLASHING

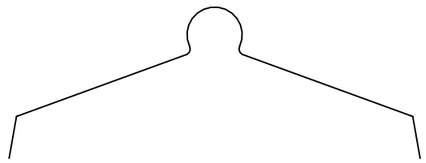

ROOFING INDUSTRIES
APRON FLASHING



HEAD FLASHING




ROOFING INDUSTRIES
COVER FLASHING



ROOFING INDUSTRIES
SOFFIT FLASHING



FIXINGS

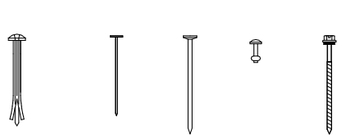

CAVITY CLOSER




METAL ANGLE



HEAD FLASHING




JAMB FLASHING



ALTERNATE JAMB
FLASHING



SILL FLASHING




ROOFING INDUSTRIES
METER BOX BASE
FLASHING




ROOFING INDUSTRIES
CLADDING CHANGE/JAMB
FLASHING




ROOFING INDUSTRIES
CORNER FLASHING




ROOFING INDUSTRIES
INTERNAL CORNER




ROOFING INDUSTRIES
EXTERNAL CORNER



ROOFING INDUSTRIES
VERTICAL BUTT JOINT
FLASHING



ROOFING INDUSTRIES
CLADDING BASE
FLASHING




Copyright detail © 2026

Roofing Industries
roof.co.nz

RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING
PROFILE SUMMARY

Detail Number: RI-C925HW-00C
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

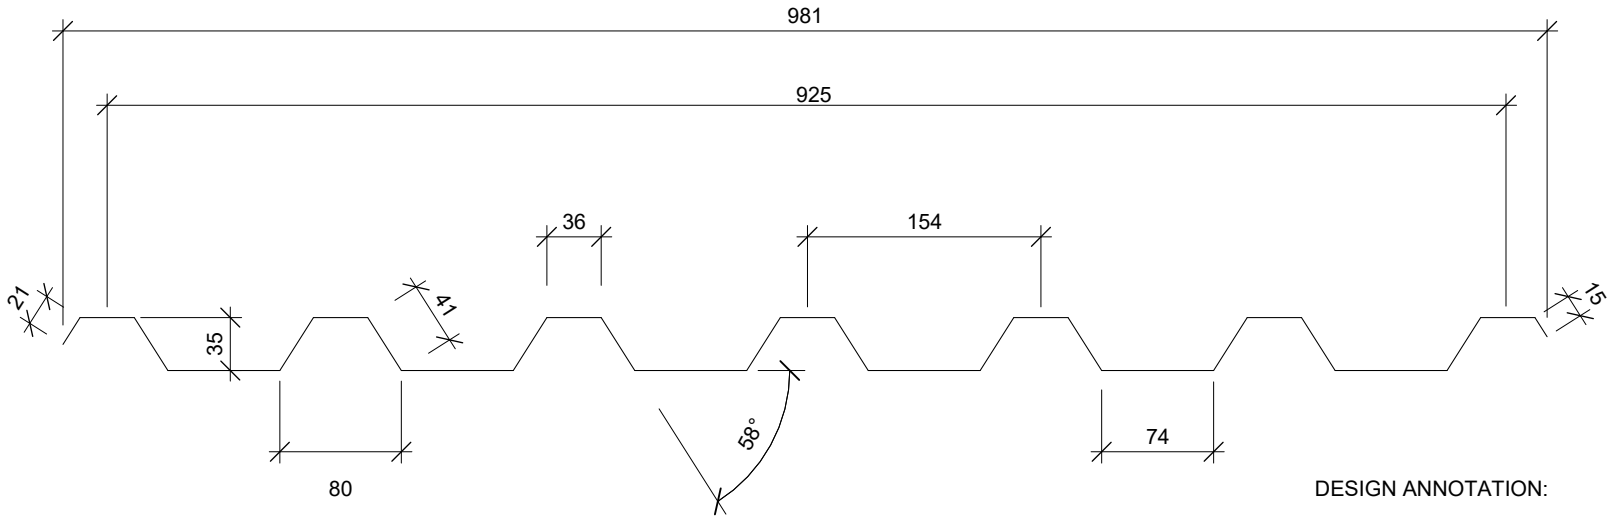

DESIGN ANNOTATION:

1. MINIMUM PITCH 3°

GENERAL NOTES:


- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2026

Roofing Industries
roof.co.nz

RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING EXTERNAL CORNER

Detail Number: RI-C925HW-010A
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

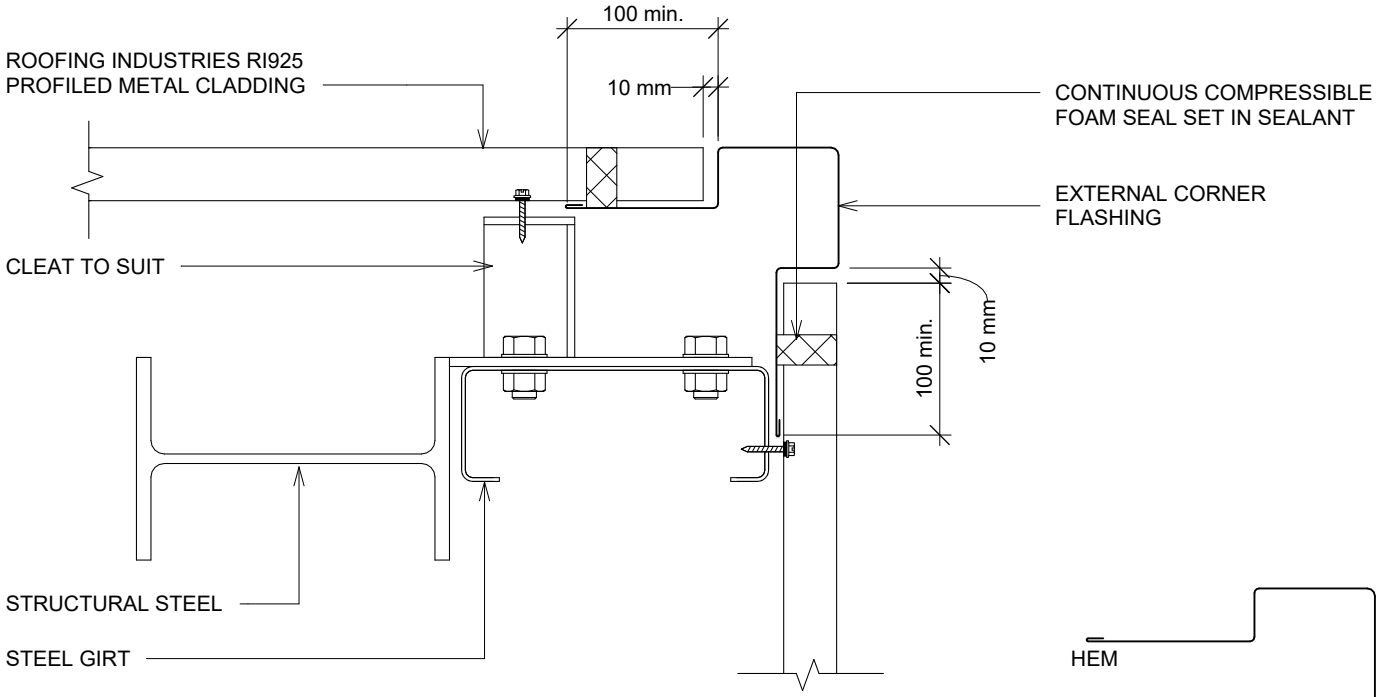

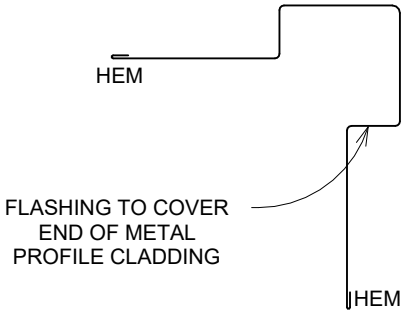

DESIGN ANNOTATION:

1. IF UNDERLAY USED AS A VAPOUR BARRIER IT MAY REQUIRE A 20MM min. GAP BETWEEN THE UNDERSIDE OF THE ROOFING & UNDERLAY.
2. REFER TO NZMRM CODE OF PRACTICE FOR FLASHING COVER.
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED.
4. FIXINGS: “THE DESIGNER NEEDS TO CHECK THE SCREW MANUFACTURERS TECHNICAL DATA OF THE SELECTED SCREW TYPE FOR THE DESIGN LOAD AND THE MATERIAL BEING FASTENED TO ”.
5. REFER TO MRM COP.

GENERAL NOTES:


- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2026

Roofing Industries
roof.co.nz


RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING
INTERNAL CORNER

Detail Number: RI-C925HW-020A
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

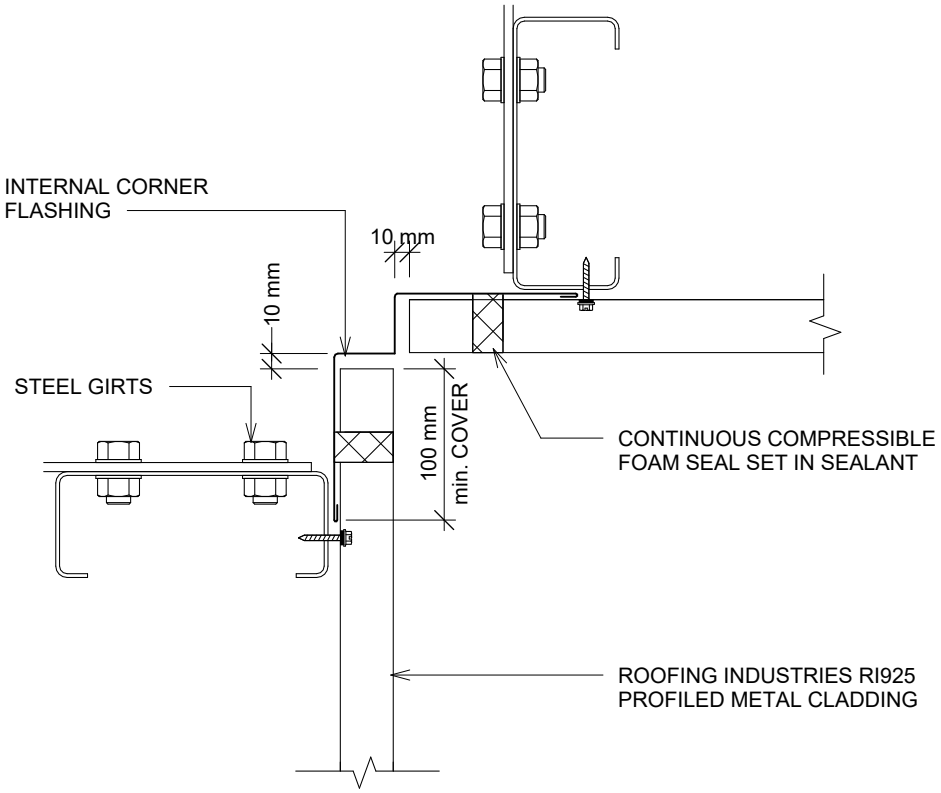

DESIGN ANNOTATION:

1. IF UNDERLAY USED AS A VAPOUR BARRIER IT MAY REQUIRE A 20MM min. GAP BETWEEN THE UNDERSIDE OF THE ROOFING & UNDERLAY.
2. REFER TO NZMRM CODE OF PRACTICE FOR FLASHING COVER.
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED.
4. FIXINGS: “THE DESIGNER NEEDS TO CHECK THE SCREW MANUFACTURERS TECHNICAL DATA OF THE SELECTED SCREW TYPE FOR THE DESIGN LOAD AND THE MATERIAL BEING FASTENED TO”.
5. REFER TO MRM COP.

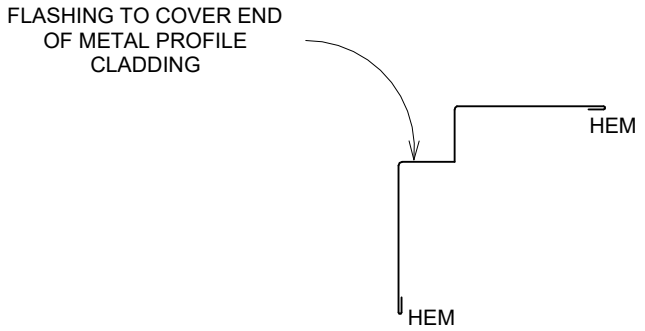

GENERAL NOTES:


- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2026

Roofing Industries
roof.co.nz

RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING BASE

Detail Number: RI-C925HW-025A
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

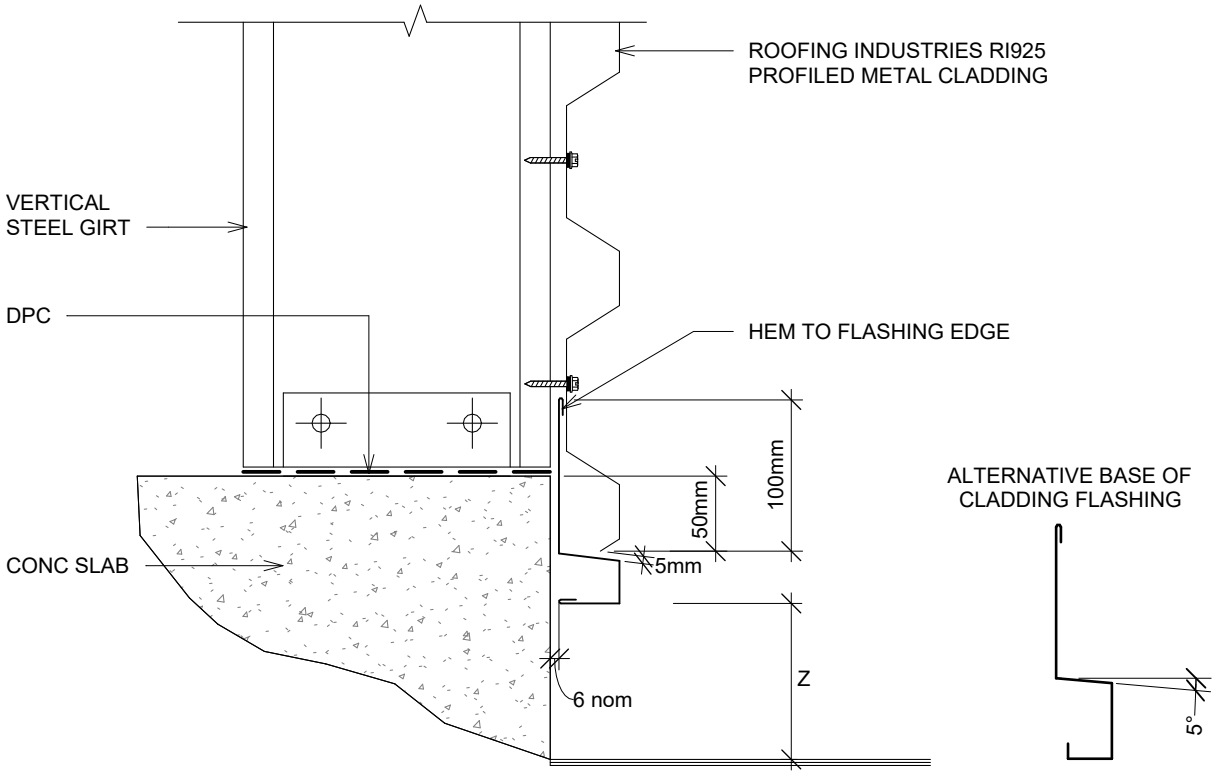

SET DOWN	MINIMUM Z
PAVED SURFACE	100mm
UNPAVED SURFACE	175mm

DESIGN ANNOTATION:

1. THE BOTTOM EDGE OF THE CLADDING SHALL OVERLAP THE FOUNDATION WALL.
2. DPC MUST BE INSTALLED UNDER ALL SURFACES IN CONTACT WITH A CONCRETE SUBSTRATE.
3. IF UNDERLAY USED AS A VAPOUR BARRIER IT MAY REQUIRE A 20MM min. GAP BETWEEN THE UNDERSIDE OF THE ROOFING & UNDERLAY.
4. REFER TO NZMRM CODE OF PRACTICE FOR FLASHING COVER.
5. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED.
6. FIXINGS: “THE DESIGNER NEEDS TO CHECK THE SCREW MANUFACTURERS TECHNICAL DATA OF THE SELECTED SCREW TYPE FOR THE DESIGN LOAD AND THE MATERIAL BEING FASTENED TO”.
7. REFER TO MRM COP.

GENERAL NOTES:


- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2026

Roofing Industries
roof.co.nz

RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING SOFFIT

Detail Number: RI-C925HW-026A
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

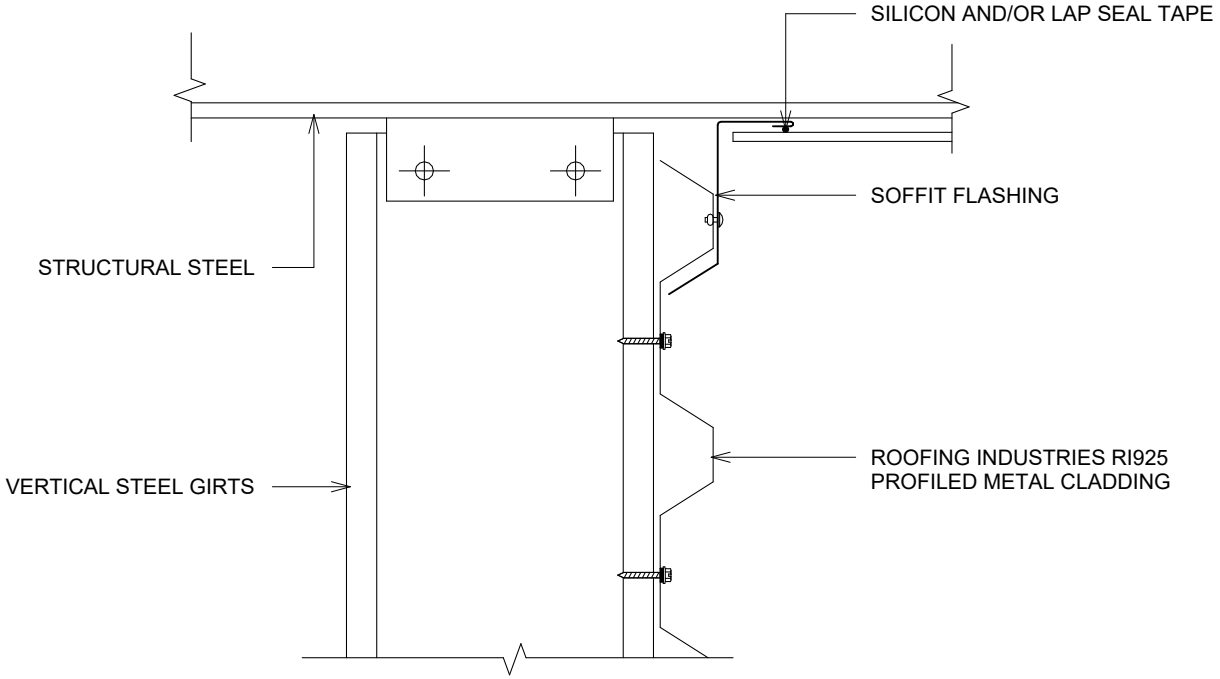

DESIGN ANNOTATION:

1. IF UNDERLAY USED AS A VAPOUR BARRIER IT MAY REQUIRE A 20MM min. GAP BETWEEN THE UNDERSIDE OF THE ROOFING & UNDERLAY.
2. REFER TO NZMRM CODE OF PRACTICE FOR FLASHING COVER.
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED.
4. FIXINGS: “THE DESIGNER NEEDS TO CHECK THE SCREW MANUFACTURERS TECHNICAL DATA OF THE SELECTED SCREW TYPE FOR THE DESIGN LOAD AND THE MATERIAL BEING FASTENED TO”.
5. REFER TO MRM COP.
6. TIMBER OR PACKERS CONTAINING CORROSIVE MATERIAL MUST BE SEPARATED FROM METAL CLADDING BY DPC, BUILDING WRAP PVC OR PAINTING.

GENERAL NOTES:


- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2026

Roofing Industries
roof.co.nz


RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING
BUTT JOINT

Detail Number: RI-C925HW-028A
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

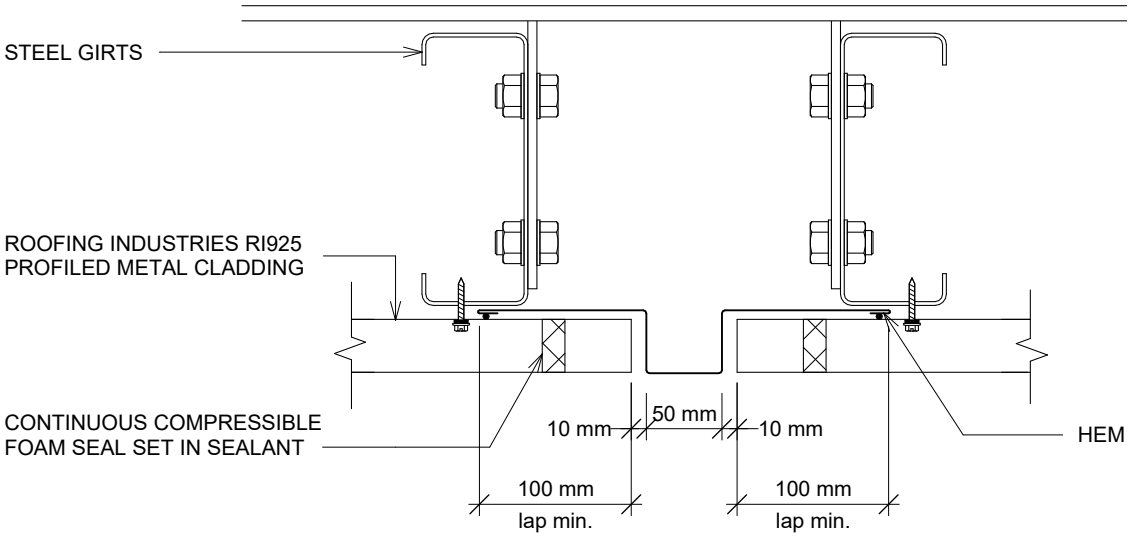

DESIGN ANNOTATION:

1. IF UNDERLAY USED AS A VAPOUR BARRIER IT MAY REQUIRE A 20MM min. GAP BETWEEN THE UNDERSIDE OF THE ROOFING & UNDERLAY.
2. REFER TO NZMRM CODE OF PRACTICE FOR FLASHING COVER.
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED.
4. FIXINGS: “THE DESIGNER NEEDS TO CHECK THE SCREW MANUFACTURERS TECHNICAL DATA OF THE SELECTED SCREW TYPE FOR THE DESIGN LOAD AND THE MATERIAL BEING FASTENED TO”.
5. REFER TO MRM COP.

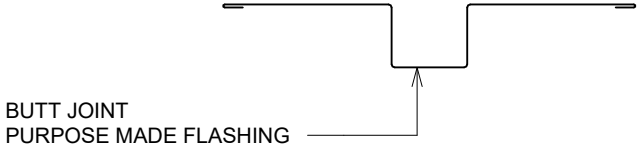

GENERAL NOTES:


- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2026

Roofing Industries
roof.co.nz


RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING
TILT PANEL JUNCTION

Detail Number: RI-C925HW-029A
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

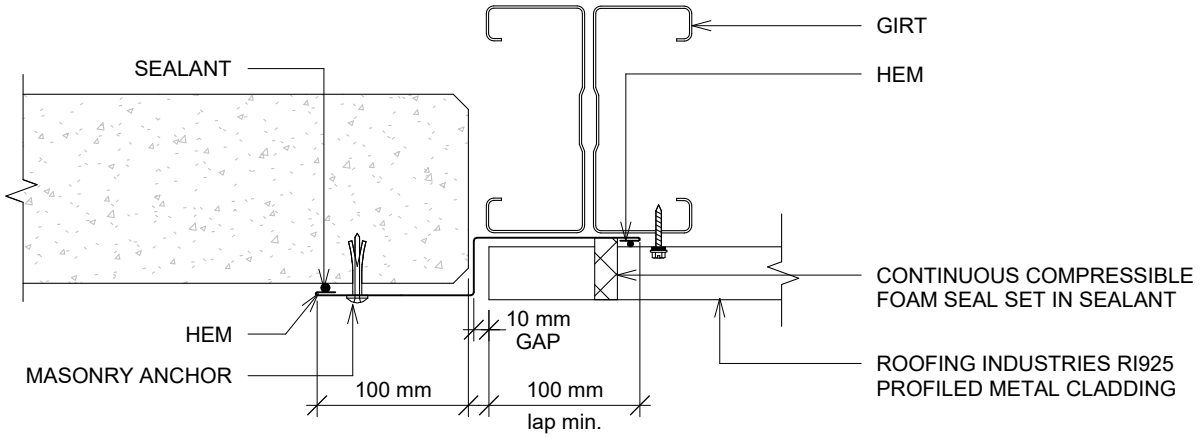

DESIGN ANNOTATION:


1. IF UNDERLAY USED AS A VAPOUR BARRIER IT MAY REQUIRE A 20MM min. GAP BETWEEN THE UNDERSIDE OF THE ROOFING & UNDERLAY.
2. REFER TO NZMRM CODE OF PRACTICE FOR FLASHING COVER.
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED.
4. FIXINGS: “THE DESIGNER NEEDS TO CHECK THE SCREW MANUFACTURERS TECHNICAL DATA OF THE SELECTED SCREW TYPE FOR THE DESIGN LOAD AND THE MATERIAL BEING FASTENED TO”.
5. REFER TO MRM COP.

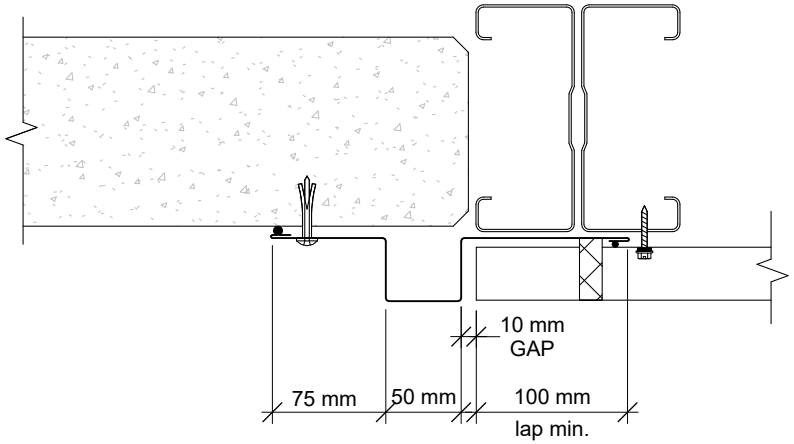

PURPOSE MADE FLASHING



OPTION 2



GENERAL NOTES:


- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2026

Roofing Industries
roof.co.nz


RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING
TILT PANEL JUNCTION OPTION 1

Detail Number: RI-C925HW-030A
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

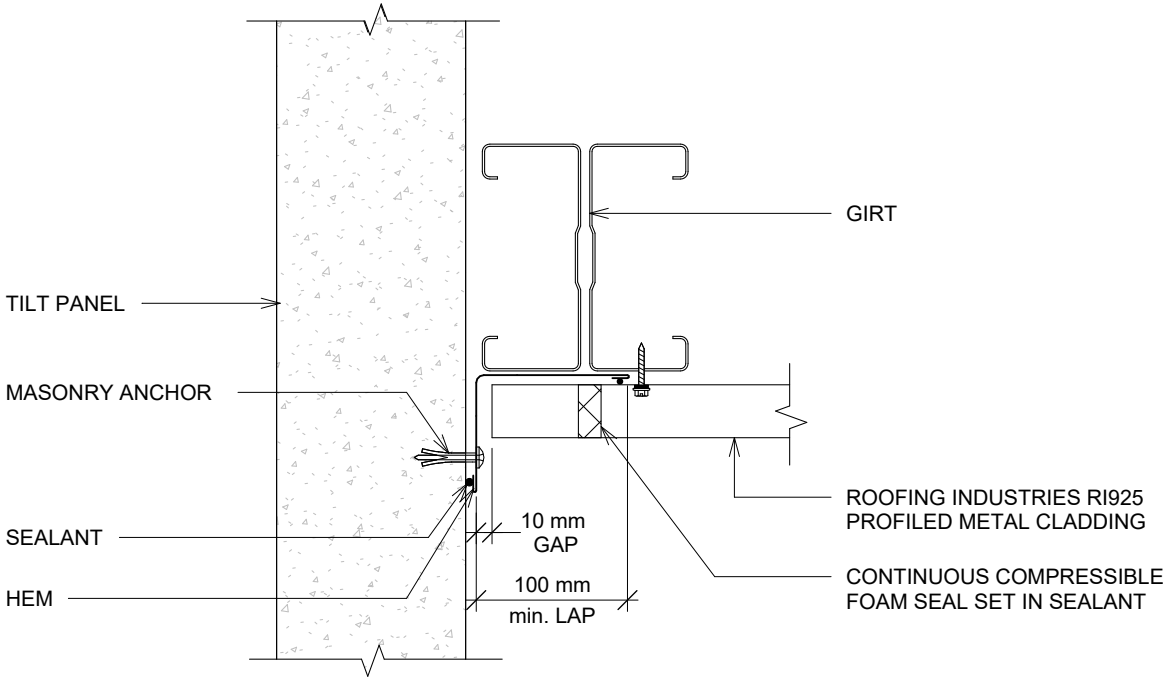

DESIGN ANNOTATION:

1. FOR FLASHING COVER REFER TO NZMRM CODE OF PRACTICE.
2. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED.
3. IF UNDERLAY USED AS A VAPOUR BARRIER IT MAY REQUIRE A 20MM min. GAP BETWEEN THE UNDERSIDE OF THE ROOFING & UNDERLAY.
4. REFER TO UNDERLAY MANUFACTURERS REQUIREMENTS FOR INSTALLATION RECOMMENDATIONS.
5. REFER TO MRM COP.



GENERAL NOTES:


- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.


Copyright detail © 2026

Roofing Industries
roof.co.nz

RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING
WINDOW / DOOR HEAD FLASHING (RECESSED)

Detail Number: RI-C925HW-032A
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

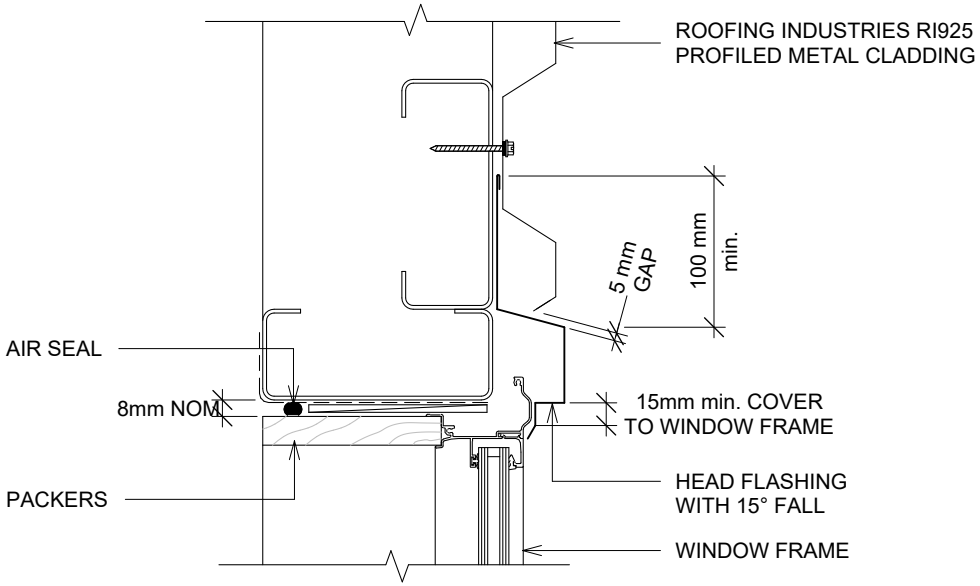



HEAD FLASHING ON CAVITY
Turn down end of head flashing.
At end of head flashing under sheet may need flattening or carefully slit and seal.

DESIGN ANNOTATION:

1. REFER TO E2/AS1 FOR GENERAL WINDOW OPENING FOR WRAPPING OF FRAMED OPENING PRIOR TO WINDOW INSTALLATION.
2. A min.. OF 8mm EFFECTIVE COVER AT SILLS SHALL BE PERMITTED WHERE NECESSARY TO ALLOW FOR TOLERANCES.
3. WINDOW PROFILE TO BE SELECTED TO ACHIEVE COVER SHOWN IN DETAIL. * Back tray size may require to increase to ensure coverage at ends of head flashings. Back Tray to run from top of head flashing to ground or exit point. * (Dimensions are indicative only) * Turn down end of head flashing
4. WHERE SUPPORT BRACKETS ARE REQUIRED BY THE WINDOW MANUFACTURER TO CARRY THE FRAME AND GLAZING LOADS THEY MUST BE SUPPLIED AS AN INTEGRAL PART OF THE WINDOW MANUFACTURER'S RECOMMENDATIONS.
5. LIAISE WITH WINDOW MANUFACTURER PRIOR TO INSTALLATION.
6. SEAL HEAD FLASHING TO WINDOW IN VERY HIGH & EXTRA HIGH WIND ZONES.
7. REFER TO E2/AS1 FOR ALTERNATIVE.
8. IF UNDERLAY USED AS A VAPOUR BARRIER IT MAY REQUIRE A 20MM min. GAP BETWEEN THE UNDERSIDE OF THE ROOFING & UNDERLAY.
9. ARCHITRAVE'S ARE SHOWN FOR CONSISTENCY ONLY, DETAIL MAY BE USED WITH REBATED LINER.
10. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED.
11. REFER TO MRM COP.

GENERAL NOTES:


- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2026


Roofing Industries
roof.co.nz

RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING
WINDOW / DOOR JAMB FLASHING (RECESSED)

Detail Number: RI-C925HW-032B
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

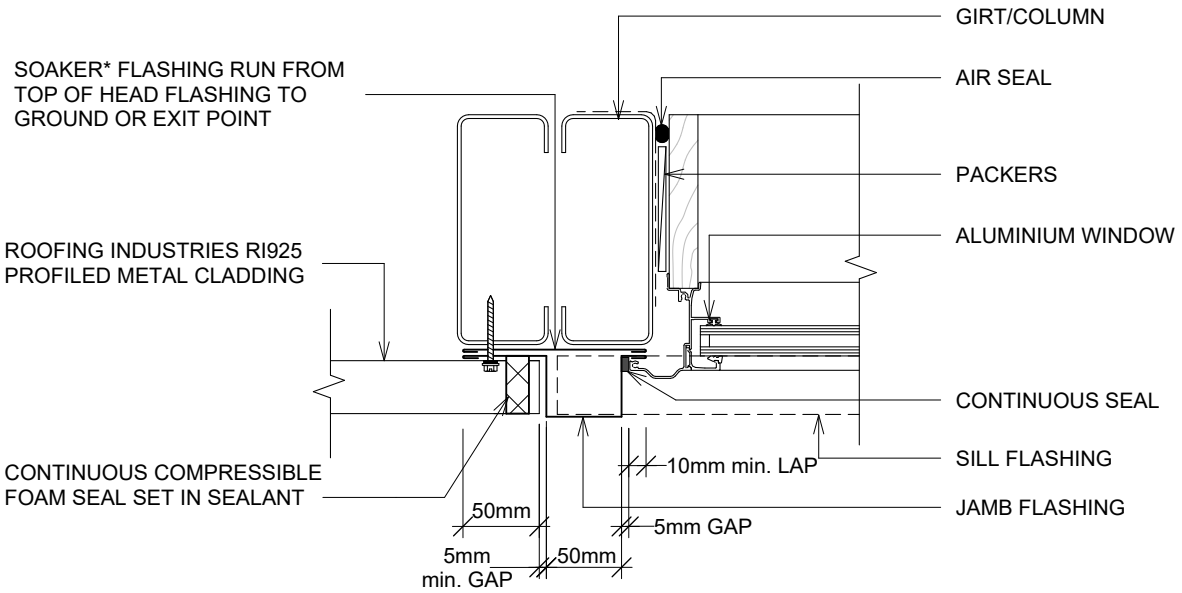

HEAD FLASHING ON CAVITY
*Soaker size may require to increase to ensure coverage at ends of head flashings. Turn down end of head flashing



DESIGN ANNOTATION:

1. REFER TO E2/AS1 FOR GENERAL WINDOW OPENING FOR WRAPPING OF FRAMED OPENING PRIOR TO WINDOW INSTALLATION
2. A min.. OF 8mm EFFECTIVE COVER AT SILLS SHALL BE PERMITTED WHERE NECESSARY TO ALLOW FOR TOLERANCES.
3. WINDOW PROFILE TO BE SELECTED TO ACHIEVE COVER SHOWN IN DETAILS.
4. LIAISE WITH WINDOW MANUFACTURER PRIOR TO INSTALLATION.
5. SEAL HEAD FLASHING TO WINDOW IN VERY HIGH & EXTRA HIGH WIND ZONES.
6. REFER TO E2/AS1 FOR ALTERNATIVE
7. ARCHITRAVE'S ARE SHOWN FOR CONSISTENCY ONLY, DETAIL MAY BE USED WITH REBATED LINER.
8. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
9. REFER TO MRM COP.

GENERAL NOTES:


- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2026

Roofing Industries
roof.co.nz

RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING
WINDOW / DOOR SILL FLASHING (RECESSED)

Detail Number: RI-C925HW-032C
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

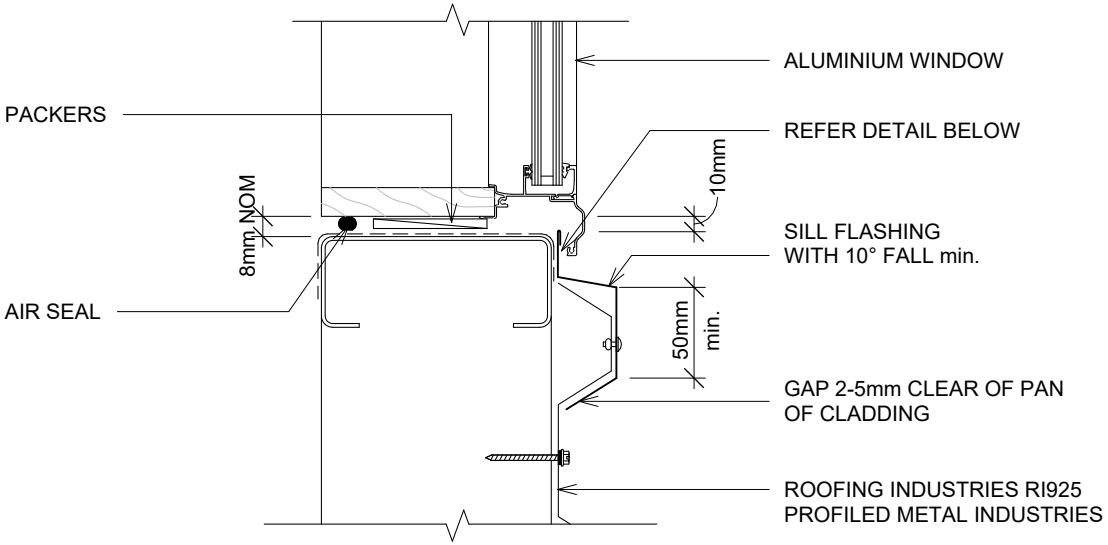




SILL FLASHING ON CAVITY
Sill flashings stop ended to receive jamb flashings

DESIGN ANNOTATION:

1. REFER TO E2/AS1 FOR GENERAL WINDOW OPENING FOR WRAPPING OF FRAMED OPENING PRIOR TO WINDOW INSTALLATION.
2. A min.. OF 8mm EFFECTIVE COVER AT SILLS SHALL BE PERMITTED WHERE NECESSARY TO ALLOW FOR TOLERANCES.
3. WINDOW PROFILE TO BE SELECTED TO ACHIEVE COVER SHOWN IN DETAIL. * Back tray size may require to increase to ensure coverage at ends of head flashings. Back Tray to run from top of head flashing to ground or exit point. * (Dimensions are indicative only) * Turn down end of head flashing
4. WHERE SUPPORT BRACKETS ARE REQUIRED BY THE WINDOW MANUFACTURER TO CARRY THE FRAME AND GLAZING LOADS THEY MUST BE SUPPLIED AS AN INTEGRAL PART OF THE WINDOW MANUFACTURER'S RECOMMENDATIONS.
5. LIAISE WITH WINDOW MANUFACTURER PRIOR TO INSTALLATION.
6. SEAL HEAD FLASHING TO WINDOW IN VERY HIGH & EXTRA HIGH WIND ZONES.
7. REFER TO E2/AS1 FOR ALTERNATIVE.
8. IF UNDERLAY USED AS A VAPOUR BARRIER IT MAY REQUIRE A 20MM min. GAP BETWEEN THE UNDERSIDE OF THE ROOFING & UNDERLAY.
9. ARCHITRAVE'S ARE SHOWN FOR CONSISTENCY ONLY, DETAIL MAY BE USED WITH REBATED LINER.
10. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED
11. REFER TO MRM COP.



GENERAL NOTES:


- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2026

Roofing Industries
roof.co.nz

RI925 HORIZONTAL WALL CLADDING ON STEEL FRAMING
ROLLER DOOR JAMB

Detail Number: RI-C925HW-090B
Date drawn: 14/10/2026
Scale: 1 : 5@ A4

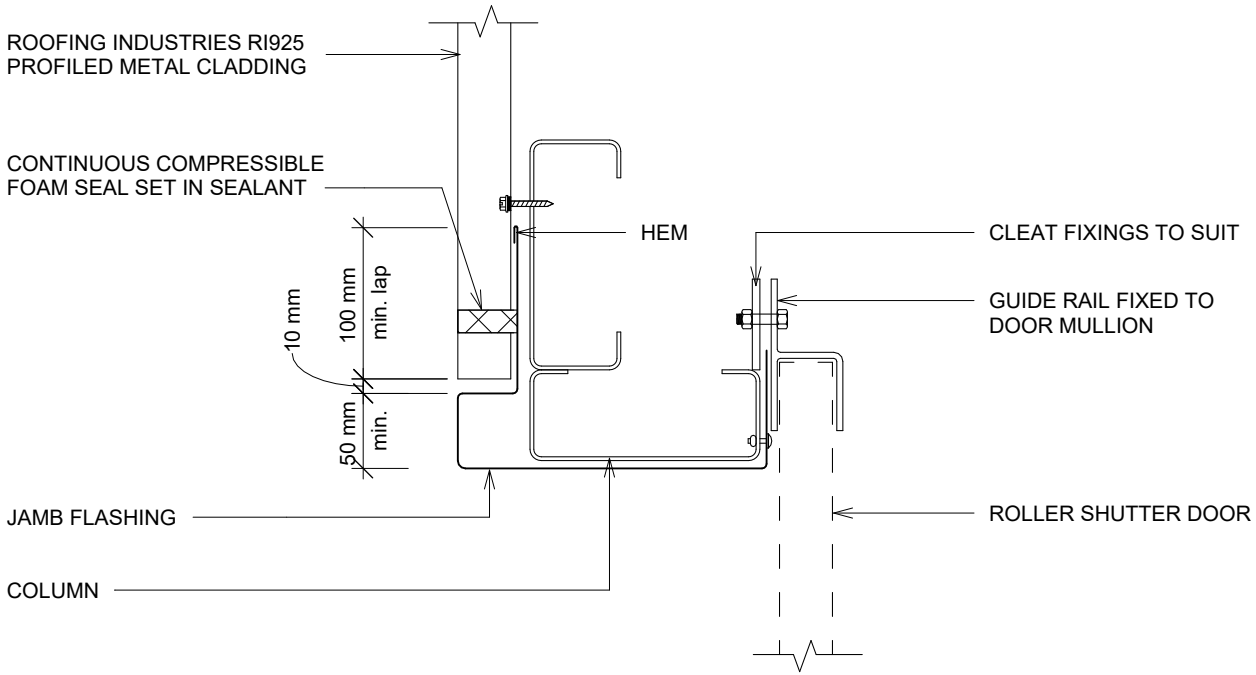

DESIGN ANNOTATION:

1. IF UNDERLAY USED AS A VAPOUR BARRIER IT MAY REQUIRE A 20MM min. GAP BETWEEN THE UNDERSIDE OF THE ROOFING & UNDERLAY.
2. REFER TO NZMRM CODE OF PRACTICE FOR FLASHING COVER.
3. FASTENERS TO BE COMPATIBLE WITH MATERIAL BEING FIXED AND THE SUITABLE GRADE FOR THE ENVIRONMENT IN WHICH LOCATED.
4. FIXINGS: “THE DESIGNER NEEDS TO CHECK THE SCREW MANUFACTURERS TECHNICAL DATA OF THE SELECTED SCREW TYPE FOR THE DESIGN LOAD AND THE MATERIAL BEING FASTENED TO”.
5. REFER TO MRM COP.

GENERAL NOTES:

- These details to be read with Roofing Industries RI925 Product Technical Statement and Installation Guide.
- The building designer is ultimately responsible to ensure that the details used meet the requirements of the NZ Building Code for the specific project.
- Details of the supporting structure (including cavity battens if used) are indicative only and are the responsibility of the building designer. For steel framed buildings thermal break cavity battens may be required.
- Roof/wall underlay selection are the responsibility of the designer. Underlay to be installed in accordance with underlay manufacturer's recommendations and requirements.
- These details are for Roofing Industries profile/s as nominated and may not be applicable to other profiles.
- This drawing is the copyright of 'Roofing Industries' and can only be copied or reproduced with their permission.
- Further information can be obtained from the NZ Metal Roof & Wall Cladding Code of Practice: www.metalroofing.org.nz or E2/AS1 where applicable.
- Details are for steel-based materials, other substrates may require some changes.
- All dimensions are nominal.
- Fixing: The designer needs to check the screw manufacturers technical data of the selected screw type for the design wind load and the material being fastened to.

Copyright detail © 2026

Roofing Industries
roof.co.nz