

## PROFESSIONAL FIRE SAFETY TESTING

t: (02) 6111 2909 | ABN: 36 620 256 617  
[mail@ignislabs.com.au](mailto:mail@ignislabs.com.au) | [www.ignislabs.com.au](http://www.ignislabs.com.au)  
3 Cooper Place, Queanbeyan, NSW 2620  
PO Box 5174 Braddon ACT 2612

**Australian Standard / New Zealand  
Standard AS/NZS 3837-1998:  
Method of test for heat and smoke  
release rates for materials and  
products using an oxygen  
consumption calorimeter**

**Viroc**

**PRODUCT EVALUATION  
AND TESTING**

---

IGNL-3069-07 I01 R00

Tested: 11.07.2019

Issued: 12.08.2019

## DOCUMENT REVISION HISTORY

Issue	Revision	Date	Purpose of Issue	Prepared by	Reviewed by
01	00 D01	09.08.2019	Issued for internal review	RP	BHB
01	00	12.08.2019	Finalised	BHB	FW

## SPONSOR

### Modinex Manufacturing Pty Ltd


PO Box 5043  
Brassall QLD 4305

## Test Technicians

Darrel Laker  
Laboratory Technician

Ram Prakash  
Laboratory Engineer

## SIGNATORY



Authorised by  
**Benjamin Hughes-Brown** | FIEAust CPEng NER APEC Engineer IntPE(Aus) CMEngNZ  
Chartered Professional Engineer  
CPEng, NER (Fire Safety / Mech) 2590091, CMEngNZ 1150772, RPEQ 11498, BPB-C10-1875, EF-39394  
MFireSafety (UWS), BEng (UTS), GradDipBushFire (UWS), DipEngPrac (UTS), DipEng (CIT)

## CONTACT INFORMATION and LOCATION OF TESTING

### Ignis Labs Pty Ltd

t: (02) 6111 2909 | ABN: 36 620 256 617  
[mail@ignislabs.com.au](mailto:mail@ignislabs.com.au) | [www.ignislabs.com.au](http://www.ignislabs.com.au)  
3 Cooper Place, Queanbeyan, NSW 2620  
PO Box 5174 Braddon ACT 2612

## Copyright ©

All rights reserved. No part of the content of this document may be reproduced, published, transmitted or adapted in any form or by any means without the written permission of the Ignis Labs Pty Ltd.

## Disclaimer

The information contained in this document is provided for the sole use of the recipient and no reliance should be placed on the information by any other person. In the event that the information is disclosed or furnished to any other person, Ignis Labs Pty Ltd accepts no liability for any loss or damage incurred by that person whatsoever as a result of using the information.

# 1. TEST SUMMARY

## General information

<b>Trade Name:</b>	Viroc	<b>Sponsor:</b>	Modinex Manufacturing Pty Ltd, PO Box 5043, Brassall QLD 4305		
<b>Manufacturer:</b>	Modinex Manufacturing Pty Ltd	<b>Specimen Identification code:</b>	3069-07		
<b>Sample Description:</b>	Red/Brown cement board				
<b>Specimen Installation:</b>					
<b>Test Date:</b>	11/07/2019	<b>Issue Date:</b>	9/08/2019	<b>Test Type:</b> Full	
<b>Expiry Date:</b>	11/07/2024	<b>Project Number:</b>	3069-00-07		

## Input

<b>Test Heat Flux (kW/m<sup>2</sup>)</b>	<b>50.0</b>	<b>Sp 1</b>	<b>Sp 2</b>	<b>Sp 3</b>	<b>Sp 4</b>	<b>Sp 5</b>	<b>Sp 6</b>	<b>Mean</b>
Thickness (mm)		11.75	11.49	11.47	-	-	-	11.57
Surface Area (m <sup>2</sup> )	<b>A<sub>s</sub></b>	0.00884	0.00884	0.00884	-	-	-	0.00884
Mass before the Test (g)	<b>m<sub>i</sub></b>	155.8912	156.6955	151.4432	-	-	-	154.6766
Mass after the Test (g)	<b>m<sub>f</sub></b>	114.7893	114.4164	108.5689	-	-	-	112.5916
Time to Ignition (sec)	<b>t<sub>ig</sub></b>	482	418	301	-	-	-	400.3333
Test start time (sec)	<b>t<sub>start</sub></b>	0	0	0	-	-	-	0

## Calculation

Density (kg/m <sup>3</sup> )	<b>ρ</b>	1500.83	1542.71	1493.599	-	-	-	1512.38
Irradiance (kW/m <sup>2</sup> )		50.38	50.38	50	-	-	-	50.25333
Exhaust System Flow Rate (m <sup>3</sup> /sec)		0.024	0.024	0.024	-	-	-	0.024
Mass Loss (kg/m <sup>2</sup> )		4.649528	4.782702	4.850027	-	-	-	4.760752
Average rate of Mass Loss per unit area (g/m <sup>2</sup> .s)		6.90866	8.231846	6.423876	-	-	-	7.188127
Total Mass Pyrolyzed (%)		26.36572	26.98168	28.31044	-	-	-	27.21928
Time to 50kW/m <sup>2</sup> (sec)	<b>t<sub>50</sub></b>	-	571.9	556.7	-	-	-	564.3
Ignitability Index (1/min)	<b>I<sub>ig</sub></b>	60/(t <sub>50</sub> -t <sub>start</sub> )	0.105	0.108	-	-	-	0.1
Test duration (sec)		1155	999	1056	-	-	-	1070.0

Peak Rate of Heat Release (0-60s)		31.62628	27.87843	27.79689	-	-	-	29.1
Peak Rate of Heat Release (0-180s)		49.60643	53.09308	42.08375	-	-	-	48.3
Peak Rate of Heat Release (0-300s)		49.60643	55.03892	52.47376	-	-	-	52.4
Average Rate of Heat Release (0-60s)		29.08797	24.06916	23.50463	-	-	-	25.6
Average Rate of Heat Release (0-180s)		36.73898	34.26829	30.33365	-	-	-	33.8
Average Rate of Heat Release (0-300s)		37.50557	39.1972	36.14378	-	-	-	37.6
Total Heat Released (MJ/m <sup>2</sup> )		-	19.72421	30.65213	-	-	-	25.2
Average Effective Heat of Combustion (MJ/kg)	<b>Δh<sub>c,eff(avg)</sub></b>	3.623344	3.865714	6.312287	-	-	-	4.6
Average Specific Extinction Area (m <sup>2</sup> /kg)	<b>σ<sub>f(avg)</sub></b>	0.007789	0.017273	0.003712	-	-	-	0.0







Rate of Heat Release Index (m=0.34)	<b>I<sub>Q1</sub></b>	-	2862.833	3706.228	-	-	-	3284.5
Rate of Heat Release Index (m=0.93)	<b>I<sub>Q2</sub></b>	-	351.1557	355.6881	-	-	-	353.4
Integral Limit at 10 min	<b>I<sub>Q, 10 min</sub></b>	6800 - 540 I <sub>g</sub>	6743.349	6741.796	-	-	-	6742.6
Integral Limit at 2 min	<b>I<sub>Q, 2 min</sub></b>	2475 - 165 I <sub>g</sub>	2457.69	2457.215	-	-	-	2457.5
Integral Limit at 12 min	<b>I<sub>Q, 12 min</sub></b>	1650 - 165 I <sub>g</sub>	1632.69	1632.215	-	-	-	1632.5

## Result







<b>BCA Group Classification Prediction</b>	1	1	1	-	-	-
--	---	---	---	---	---	---

## 2. TEST PLOTS







**FIGURE 1:**  
SPECIMEN 1

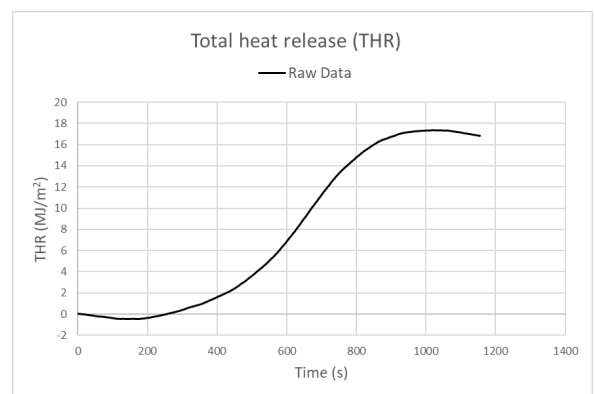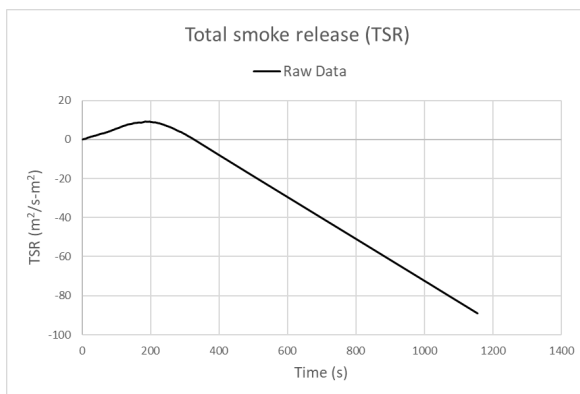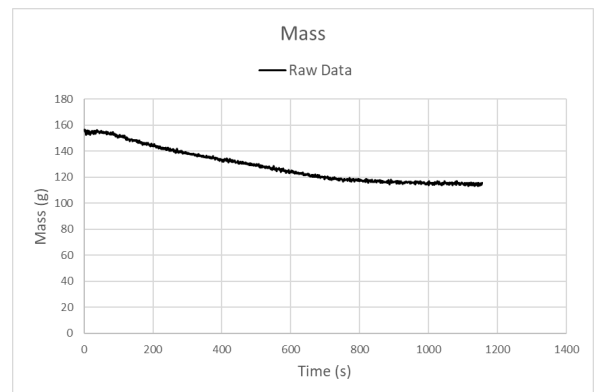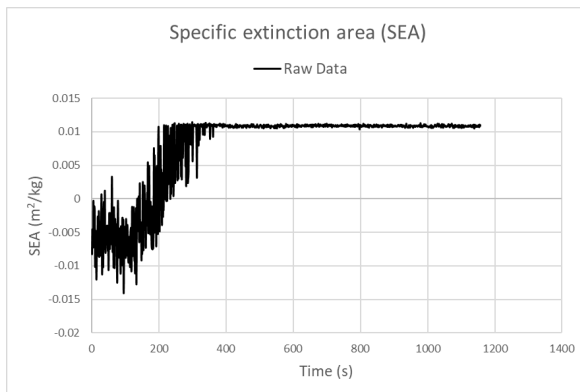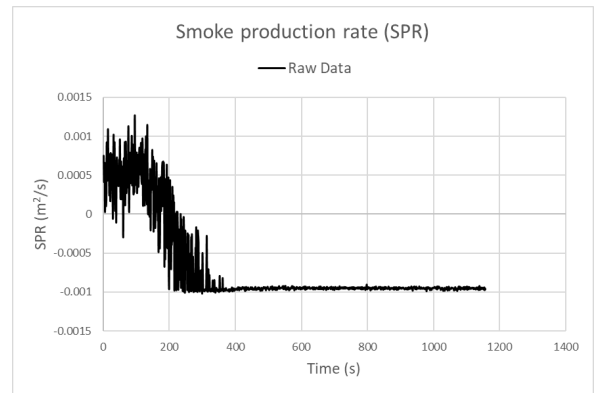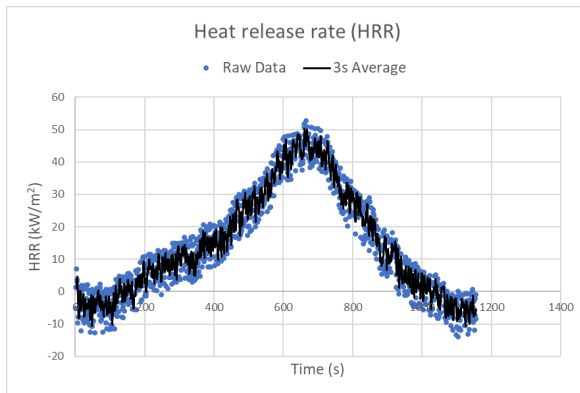

**FIGURE 2:**  
SPECIMEN 2

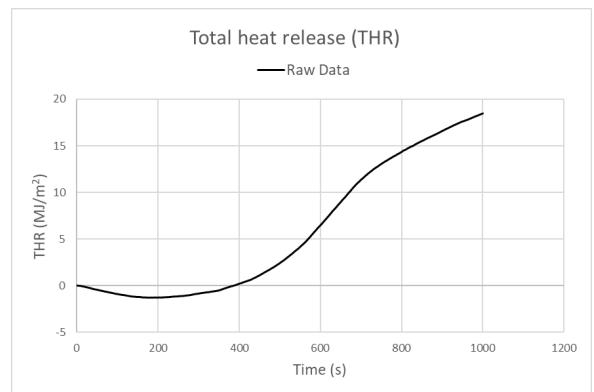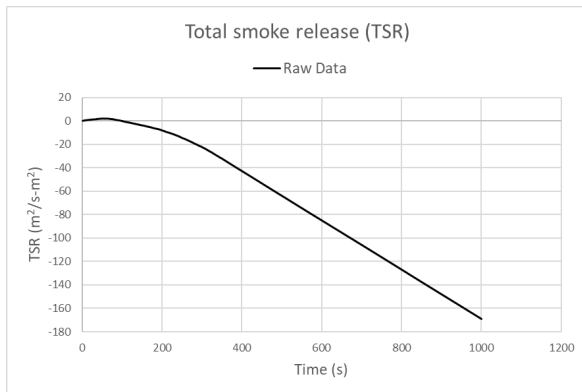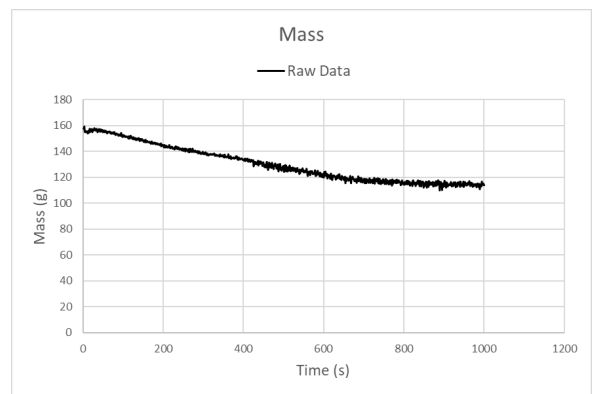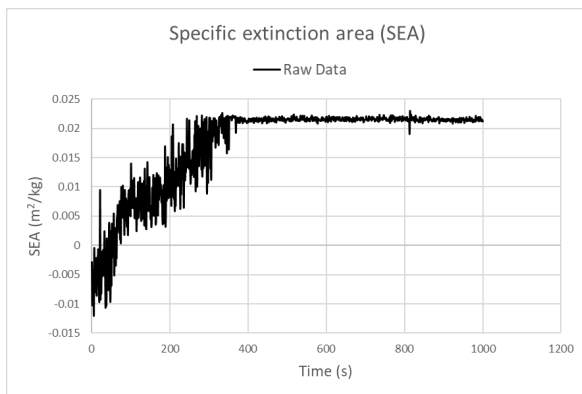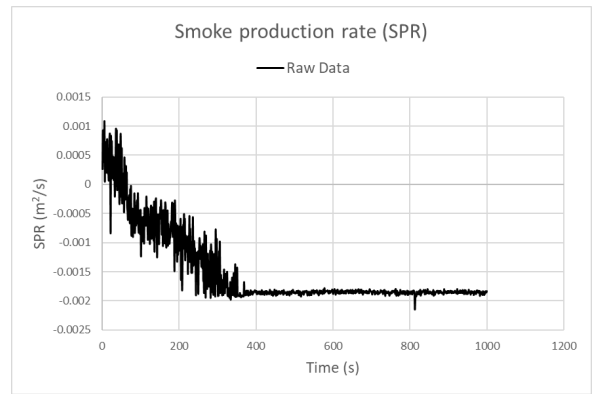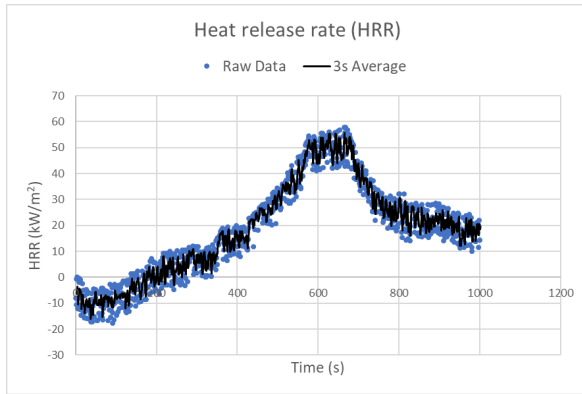

**FIGURE 3:**  
SPECIMEN 3

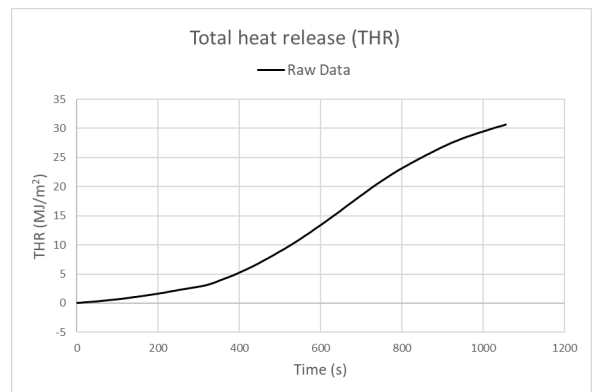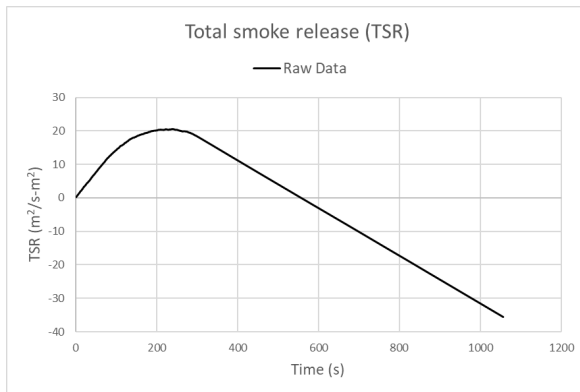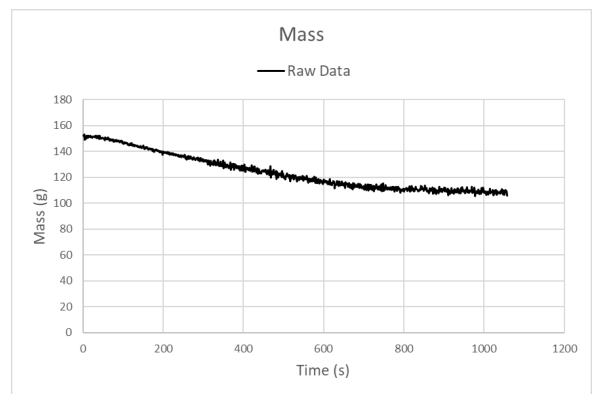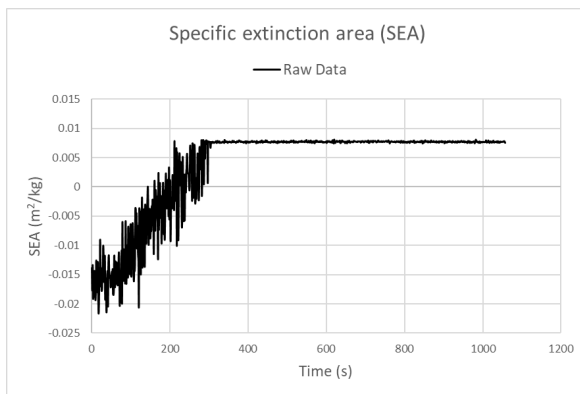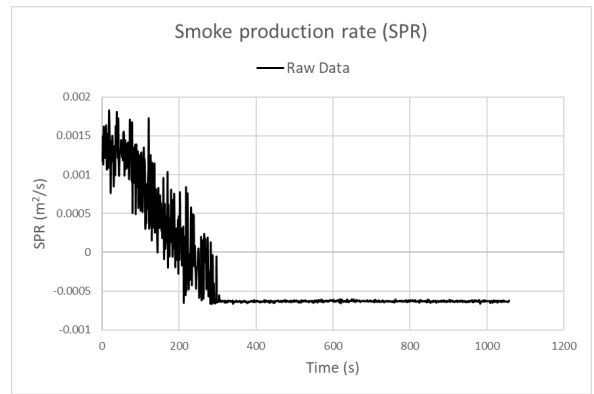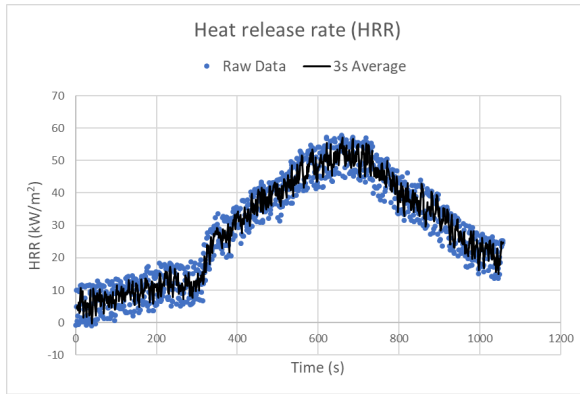

### 3. APPLICATION OF TEST RESULTS

---

#### 3.1 TEST LIMITATIONS

The results of this fire test may be used to directly assess fire hazard, but it should be recognized that a single test method will not provide a full assessment of fire hazard under all fire conditions. The results reported herein shall not be used to derive a Group Number in accordance with the NCC without undertaking validation of the performance that is predicted.

#### 3.2 UNCERTAINTY OF MEASUREMENT

Because of the nature of fire hazard property testing and the consequent difficulty in quantifying the uncertainty of measurement of fire hazard properties, it is not possible to provide a stated degree of accuracy of the result.



## **Ignis Labs Pty Ltd**

Laboratory reference No: 3069-07

T: (02) 6111 2909

[mail@ignislabs.com.au](mailto:mail@ignislabs.com.au)

[www.ignislabs.com.au](http://www.ignislabs.com.au)

3 Cooper Place Queanbeyan East NSW 2620

PO Box 5174 Braddon ACT 2612

ABN: 36 620 256 617

